

**ASX13**  
**SPLIT SYSTEM AIR CONDITIONER**

**13 SEER**

**COOLING CAPACITY: 18,000 - 60,000 BTU/H**

**Standard Features**

- Energy-efficient scroll compressor
- R-410A chlorine-free refrigerant
- High-density foam compressor sound blanket
- Copeland<sup>®</sup> ComfortAlert™ diagnostics
- Loss-of-charge switch
- Factory-installed filter dryer
- Two-speed condenser fan motor
- Copper tube / enhanced aluminum fin coil
- Sweat connection service valves with easy access to gauge ports
- 13 SEER performance with flowrater expansion device
- Contactor with lug connection
- Ground lug connection
- AHRI Certified; ETL Listed

**Cabinet Features**

- Amana<sup>®</sup> brand sound control top design
- Attractive Architectural Gray powder-paint finish with 500-hour salt-spray approval
- Heavy-gauge, galvanized-steel cabinet with rust-resistant screws
- Wire fan discharge grille
- Steel louver coil guard
- Compact footprint
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets the 2001 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



**Contents**

Nomenclature .....	2
Product Specifications .....	3
Expanded Cooling Data .....	4
AHRI Ratings .....	20
Dimensions .....	45
Wiring Diagram .....	46
Accessories .....	48



\* Complete warranty details available from your local dealer or at [www.amana-hac.com](http://www.amana-hac.com). To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.

# NOMENCLATURE

	A	S	X	13	036	1	A	A	
	1	2	3	4,5	6,7,8	9	10	11	
<b>Brand</b>	A Amana® Brand						<b>Engineering *</b>		
							Minor Revision		
<b>Product Category</b>	S Split System					<b>Engineering *</b>			
						Major Revision			
<b>Unit Type</b>	C Condenser R-22						<b>Electrical</b>		
	X Condenser R-410A						1 208/230 V, 1 Phase, 60 Hz		
	H Heat Pump R-22						2 220/240 V, 1 Phase, 50 Hz		
	Z Heat Pump R-410A						3 208/230 V, 3 Phase, 60 Hz		
							4 460 V, 3 Phase, 60 Hz		
							5 380/415 V, 3 Phase, 50 Hz		
<b>Efficiency</b>	13 13 SEER				<b>Nominal Capacity</b>				
	14 14 SEER				018 1½ Tons 048 4 Tons				
	16 16 SEER				024 2 Tons 060 5 Tons				
	18 18 SEER				030 2½ Tons 090 7½ tons				
					036 3 Tons 120 10 Tons				
					042 3½ Tons				

\* Neither used for order entry or inventory management.

# SPECIFICATIONS

	ASX13 0181B/C	ASX13 0241B/C	ASX13 0301B/C	ASX13 0361B/C	ASX13 0421B/C	ASX13 0481B/C	ASX13 0601A*	ASX13 0601B/C
<b>CAPACITIES</b>								
Nominal Cooling (BTU/h)	18,000	24,000	30,000	36,000	42,000	48,000	60,000	60,000
SEER / EER	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11	13 / 11
Decibels	71	71	72	74	74	74	75	77
<b>COMPRESSOR</b>								
RLA	9.0	13.5	12.8	16.7	17.9	19.9	26.4	25.0
LRA	48	58.3	64	79	112	109	134	134
<b>CONDENSER FAN MOTOR</b>								
Horsepower	1/6	1/6	1/6	1/6	1/4	1/4	1/4	1/4
FLA	0.9	0.9	0.9	0.9	1.5	1.5	1.5	1.5
<b>REFRIGERATION SYSTEM</b>								
Refrigerant Line Size <sup>1</sup>								
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	3/4"	7/8"	1 1/8"	1 1/8"	1 1/8"	1 1/8"
Refrigerant Connection Size								
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) <sup>4 5</sup>	3/4"	3/4"	3/4"	3/4" <sup>4</sup>	7/8" <sup>5</sup>	7/8" <sup>5</sup>	7/8" <sup>5</sup>	7/8" <sup>5</sup>
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	69	76	78	89	121	125	184	122
Shipped with Orifice Size	0.051	0.057	0.061	0.070	0.076	0.080	0.092	0.086
<b>ELECTRICAL DATA</b>								
Voltage-Hz / Phase	208/230-60/1		208/230-60/1		208/230-60/1		208/230-60/1	
Minimum Circuit Ampacity <sup>2</sup>	12.2	17.8	16.9	21.8	23.9	26.4	35	32.8
Max. Overcurrent Protection <sup>3</sup>	20 amps	30 amps	25 amps	35 amps	40 amps	45 amps	60 amps	50 amps
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
<b>SHIP WEIGHT (LBS)</b>	149	151	152	159	194	195	240	200

<sup>1</sup> Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240. For other line-set lengths or sizes, refer to the installation & Operating instructions and/or the long line-set guidelines.

<sup>2</sup> Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

<sup>3</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

<sup>4</sup> Installer will need to supply 3/4" to 7/8" adapters for suction line connections.

<sup>5</sup> Installer will need to supply 7/8" to 1 1/8" adapters for suction line connections.

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

# EXPANDED COOLING DATA — ASX130181B/C

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	525	MBh	15.8	16.4	17.9	-	15.4	16.0	17.5	-	15.1	15.6	17.1	-	14.7	15.2	16.7	-	14.0	14.5	15.9	-	12.9	13.4	14.7	-	
		S/T	0.67	0.56	0.39	-	0.69	0.58	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.77	0.64	0.44	-	
		ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-	
	600	kW	1.27	1.30	1.34	-	1.36	1.39	1.43	-	1.44	1.47	1.51	-	1.51	1.54	1.59	-	1.57	1.60	1.65	-	1.62	1.65	1.71	-	
		Amps	4.6	4.7	4.8	-	4.9	5.0	5.2	-	5.3	5.5	5.6	-	5.7	5.8	6.0	-	6.0	6.2	6.4	-	6.4	6.6	6.8	-	
		HI/PR	203	218	230	-	228	245	259	-	259	279	294	-	295	317	335	-	332	357	377	-	366	394	416	-	
	675	LO PR	103	109	119	-	109	116	126	-	113	120	131	-	119	126	138	-	124	132	144	-	129	137	149	-	
		MBh	17.1	17.7	19.4	-	16.7	17.3	19.0	-	16.3	16.9	18.5	-	15.9	16.5	18.1	-	15.1	15.7	17.2	-	14.0	14.5	15.9	-	
		S/T	0.69	0.58	0.40	-	0.72	0.60	0.41	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.79	0.66	0.46	-	
	75	525	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
			kW	1.30	1.33	1.37	-	1.39	1.42	1.46	-	1.48	1.51	1.55	-	1.55	1.58	1.63	-	1.61	1.64	1.69	-	1.66	1.70	1.75	-
			Amps	4.7	4.8	5.0	-	5.1	5.2	5.3	-	5.5	5.6	5.8	-	5.9	6.0	6.2	-	6.2	6.4	6.6	-	6.6	6.7	7.0	-
600		HI/PR	209	225	238	-	235	252	267	-	267	287	303	-	304	327	345	-	342	368	389	-	378	407	429	-	
		LO PR	106	113	123	-	112	119	130	-	116	124	135	-	122	130	142	-	128	136	149	-	133	141	154	-	
		MBh	17.6	18.3	20.0	-	17.2	17.9	19.6	-	16.8	17.4	19.1	-	16.4	17.0	18.6	-	15.6	16.2	17.7	-	14.4	15.0	16.4	-	
675		S/T	0.73	0.61	0.42	-	0.75	0.63	0.43	-	0.77	0.64	0.45	-	0.80	0.66	0.46	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-	
		ΔT	17	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-	
		kW	1.31	1.34	1.38	-	1.40	1.43	1.48	-	1.49	1.52	1.56	-	1.56	1.59	1.64	-	1.62	1.65	1.71	-	1.67	1.71	1.76	-	
75		525	Amps	4.7	4.8	5.0	-	5.1	5.2	5.4	-	5.5	5.7	5.8	-	5.9	6.0	6.2	-	6.3	6.4	6.6	-	6.6	6.8	7.0	-
			HI/PR	211	227	240	-	237	255	269	-	270	290	306	-	307	330	349	-	345	372	392	-	382	411	434	-
			LO PR	107	114	124	-	113	120	131	-	118	125	137	-	123	131	143	-	129	138	150	-	134	142	155	-
	600	MBh	16.1	16.5	17.9	19.2	15.7	16.2	17.5	18.8	15.3	15.8	17.1	18.3	15.0	15.4	16.7	17.9	14.2	14.6	15.8	17.0	13.2	13.5	14.7	15.7	
		S/T	0.76	0.68	0.51	0.33	0.79	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.38	0.87	0.78	0.59	0.38	
		ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10	
	675	kW	1.28	1.31	1.35	1.39	1.37	1.40	1.44	1.49	1.45	1.48	1.53	1.57	1.52	1.55	1.60	1.65	1.58	1.62	1.67	1.72	1.63	1.67	1.72	1.77	
		Amps	4.6	4.7	4.9	5.0	5.0	5.1	5.2	5.4	5.4	5.5	5.7	5.9	5.7	5.9	6.1	6.3	6.1	6.3	6.5	6.7	6.5	6.6	6.8	7.1	
		HI/PR	205	220	233	243	230	247	261	272	261	281	297	310	298	320	338	353	335	361	381	397	370	398	421	439	
	75	525	LO PR	104	111	121	128	110	117	127	136	114	121	132	141	120	127	139	148	126	134	146	155	130	138	151	161
			MBh	17.4	17.9	19.4	20.8	17.0	17.5	19.0	20.3	16.6	17.1	18.5	19.9	16.2	16.7	18.1	19.4	15.4	15.8	17.2	18.4	14.3	14.7	15.9	17.1
			S/T	0.79	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39
600		ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10	
		kW	1.31	1.34	1.38	1.42	1.40	1.43	1.48	1.52	1.49	1.52	1.56	1.61	1.56	1.59	1.64	1.69	1.62	1.65	1.71	1.76	1.67	1.71	1.76	1.82	
		Amps	4.7	4.8	5.0	5.2	5.1	5.2	5.4	5.6	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.5	6.3	6.4	6.6	6.9	6.6	6.8	7.0	7.3	
675		HI/PR	211	227	240	250	237	255	269	281	270	290	306	319	307	330	349	364	345	372	392	409	382	411	434	452	
		LO PR	107	114	124	132	113	120	131	140	118	125	137	145	124	131	143	153	129	138	150	160	134	142	156	166	
		MBh	17.9	18.5	20.0	21.5	17.5	18.0	19.5	21.0	17.1	17.6	19.1	20.5	16.7	17.2	18.6	20.0	15.9	16.3	17.7	19.0	14.7	15.1	16.4	17.6	
75		525	S/T	0.82	0.74	0.56	0.36	0.85	0.76	0.58	0.37	0.88	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.94	0.84	0.64	0.41	0.95	0.85	0.64	0.41
			ΔT	20	19	15	10	20	19	15	11	20	19	15	11	21	19	16	11	20	19	15	11	19	17	14	10
			kW	1.32	1.35	1.39	1.43	1.42	1.44	1.49	1.53	1.50	1.53	1.57	1.62	1.57	1.60	1.65	1.70	1.63	1.67	1.72	1.77	1.69	1.72	1.78	1.83
	600	Amps	4.8	4.9	5.0	5.2	5.1	5.3	5.4	5.6	5.6	5.7	5.9	6.1	6.0	6.1	6.3	6.5	6.3	6.5	6.7	6.9	6.7	6.9	7.1	7.4	
		HI/PR	213	230	242	253	239	258	272	284	272	293	309	323	310	334	352	368	349	375	396	413	385	415	438	457	
		LO PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167	
	75	525	MBh	16.1	16.5	17.9	19.2	15.7	16.2	17.5	18.8	15.3	15.8	17.1	18.3	15.0	15.4	16.7	17.9	14.2	14.6	15.8	17.0	13.2	13.5	14.7	15.7
			S/T	0.76	0.68	0.51	0.33	0.79	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.38	0.87	0.78	0.59	0.38
			ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
		600	kW	1.28	1.31	1.35	1.39	1.37	1.40	1.44	1.49	1.45	1.48	1.53	1.57	1.52	1.55	1.60	1.65	1.58	1.62	1.67	1.72	1.63	1.67	1.72	1.77
			Amps	4.6	4.7	4.9	5.0	5.0	5.1	5.2	5.4	5.4	5.5	5.7	5.9	5.7	5.9	6.1	6.3	6.1	6.3	6.5	6.7	6.5	6.6	6.8	7.1
			HI/PR	205	220	233	243	230	247	261	272	261	281	297	310	298	320	338	353	335	361	381	397	370	398	421	439
675		LO PR	104	111	121	128	110	117	127	136	114	121	132	141	120	127	139	148	126	134	146	155	130	138	151	161	
		MBh	17.4	17.9	19.4	20.8	17.0	17.5	19.0	20.3	16.6	17.1	18.5	19.9	16.2	16.7	18.1	19.4	15.4	15.8	17.2	18.4	14.3	14.7	15.9	17.1	
		S/T	0.79	0.70	0.53	0.34	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39	
75		525	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10
			kW	1.31	1.34	1.38	1.42	1.40	1.43	1.48	1.52	1.49	1.52	1.56	1.61	1.56	1.59	1.64	1.69	1.62	1.65	1.71	1.76	1.67	1.71	1.76	1.82
			Amps	4.7	4.8	5.0	5.2	5.1	5.2	5.4	5.6	5.5	5.7	5.8	6.1	5.9	6.0	6.2	6.5	6.3	6.4	6.6	6.9	6.6	6.8	7.0	7.3
	600	HI/PR	211	227	240	250	237	255	269	281	270	290	306	319	307	330	349	364	345	372	392	409					

# EXPANDED COOLING DATA — ASX130181B/C (CONT.)

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
80	525	MBh	16.4	16.7	17.9	19.1	16.0	16.3	17.4	18.6	15.6	15.9	17.0	18.2	15.2	15.6	16.6	17.8	14.5	14.8	15.8	16.9	13.4	13.7	14.6	15.6	
		S/T	0.83	0.78	0.63	0.47	0.86	0.81	0.66	0.49	0.88	0.83	0.67	0.50	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.95	0.90	0.73	0.54	
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	19	15	
	600	kW	1.29	1.32	1.36	1.40	1.38	1.41	1.45	1.50	1.46	1.49	1.54	1.59	1.53	1.57	1.61	1.66	1.59	1.63	1.68	1.73	1.65	1.68	1.73	1.79	
		Amps	4.6	4.8	4.9	5.1	5.0	5.1	5.3	5.5	5.4	5.6	5.7	6.0	5.8	5.9	6.1	6.4	6.2	6.3	6.5	6.8	6.5	6.7	6.9	7.2	
		HI/PR	207	223	235	245	232	250	264	275	264	284	300	313	301	324	342	357	338	364	385	401	374	402	425	443	
	675	LO/PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	147	157	131	140	152	162	
		MBh	17.7	18.1	19.4	20.7	17.3	17.7	18.9	20.2	16.9	17.3	18.5	19.7	16.5	16.8	18.0	19.2	15.7	16.0	17.1	18.3	14.5	14.8	15.8	16.9	
		S/T	0.86	0.81	0.66	0.49	0.89	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.56	
	85	525	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15
			kW	1.32	1.35	1.39	1.43	1.42	1.44	1.49	1.53	1.50	1.53	1.58	1.62	1.57	1.60	1.65	1.71	1.63	1.67	1.72	1.77	1.69	1.72	1.78	1.83
			Amps	4.8	4.9	5.0	5.2	5.1	5.3	5.4	5.6	5.6	5.7	5.9	6.1	6.0	6.1	6.3	6.5	6.3	6.5	6.7	6.9	6.7	6.9	7.1	7.4
600		HI/PR	213	230	242	253	239	258	272	284	272	293	309	323	310	334	352	368	349	375	396	413	385	415	438	457	
		LO/PR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167	
		MBh	18.3	18.7	19.9	21.3	17.8	18.2	19.5	20.8	17.4	17.8	19.0	20.3	17.0	17.4	18.5	19.8	16.1	16.5	17.6	18.8	14.9	15.3	16.3	17.4	
675		S/T	0.90	0.85	0.69	0.52	0.94	0.88	0.72	0.53	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.79	0.59	
		ΔT	22	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	22	22	19	15	20	21	18	14	
		kW	1.33	1.36	1.40	1.44	1.43	1.45	1.50	1.54	1.51	1.54	1.59	1.64	1.58	1.62	1.67	1.72	1.65	1.68	1.73	1.79	1.70	1.74	1.79	1.85	
85		600	Amps	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.8	6.0	6.2	6.0	6.2	6.4	6.6	6.4	6.5	6.8	7.0	6.8	6.9	7.2	7.4
			HI/PR	215	232	245	255	242	260	275	287	275	296	313	326	313	337	356	371	352	379	400	418	389	419	442	461
			LO/PR	109	116	127	135	117	124	135	144	120	128	139	148	126	134	146	156	132	140	153	163	137	145	159	169
85	675	MBh	18.6	18.9	19.8	21.2	18.1	18.5	19.4	20.7	17.7	18.1	18.9	20.2	17.3	17.6	18.4	19.7	16.4	16.7	17.5	18.7	15.2	15.5	16.2	17.3	
		S/T	0.95	0.91	0.83	0.67	0.98	0.95	0.86	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77	
		ΔT	24	24	22	19	24	24	23	20	24	24	23	20	24	24	23	20	24	25	23	20	23	23	22	19	
85	675	kW	1.33	1.36	1.40	1.44	1.43	1.45	1.50	1.54	1.51	1.54	1.59	1.64	1.58	1.62	1.67	1.72	1.65	1.68	1.73	1.79	1.70	1.74	1.79	1.85	
		Amps	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.8	6.0	6.2	6.0	6.2	6.4	6.6	6.4	6.5	6.8	7.0	6.8	6.9	7.2	7.4	
		HI/PR	215	232	245	255	242	260	275	287	275	296	313	326	313	337	356	371	352	379	400	418	389	419	442	461	
85	675	LO/PR	106	113	123	131	112	119	130	138	116	124	135	144	122	130	142	151	128	136	149	158	132	141	154	164	
		MBh	18.0	18.4	19.3	20.5	17.6	18.0	18.8	20.1	17.2	17.5	18.4	19.6	16.8	17.1	17.9	19.1	15.9	16.2	17.0	18.2	14.8	15.0	15.8	16.8	
		S/T	0.90	0.87	0.79	0.64	0.94	0.90	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.90	0.73	
85	675	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	21	24	25	23	20	23	23	22	19	
		kW	1.33	1.36	1.40	1.44	1.43	1.45	1.50	1.54	1.51	1.54	1.59	1.64	1.58	1.62	1.67	1.72	1.65	1.68	1.73	1.79	1.70	1.74	1.79	1.85	
		Amps	4.8	4.9	5.1	5.3	5.2	5.3	5.5	5.7	5.6	5.8	6.0	6.2	6.0	6.2	6.4	6.6	6.4	6.5	6.8	7.0	6.8	6.9	7.2	7.4	
85	675	HI/PR	215	232	245	255	242	260	275	287	275	296	313	326	313	337	356	371	352	379	400	418	389	419	442	461	
		LO/PR	109	116	127	135	115	123	134	143	120	128	139	148	126	134	146	156	132	140	153	163	137	145	159	169	
		MBh	18.6	18.9	19.8	21.2	18.1	18.5	19.4	20.7	17.7	18.1	18.9	20.2	17.3	17.6	18.4	19.7	16.4	16.7	17.5	18.7	15.2	15.5	16.2	17.3	
85	675	S/T	0.95	0.91	0.83	0.67	0.98	0.95	0.86	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.73	1.00	1.00	0.94	0.76	1.00	1.00	0.95	0.77	
		ΔT	24	24	22	19	24	24	23	20	24	24	23	20	24	24	23	20	24	23	22	19	21	21	21	18	
		kW	1.34	1.37	1.41	1.45	1.44	1.47	1.51	1.56	1.52	1.55	1.60	1.65	1.60	1.63	1.68	1.73	1.66	1.69	1.75	1.80	1.71	1.75	1.81	1.86	
85	675	Amps	4.9	5.0	5.1	5.3	5.2	5.4	5.5	5.7	5.7	5.8	6.0	6.2	6.1	6.2	6.4	6.7	6.4	6.6	6.8	7.1	6.8	7.0	7.2	7.5	
		HI/PR	218	234	247	258	244	263	278	289	278	299	316	329	316	340	359	375	356	383	404	422	393	423	447	466	
		LO/PR	110	117	128	136	117	124	135	144	121	129	141	150	127	135	148	157	133	142	155	165	138	147	160	171	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130241B/C

IDB	Airflow	Outdoor Ambient Temperature																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	MBh	21.1	21.8	23.9	-	20.6	21.3	23.4	-	20.1	20.8	22.8	-	19.6	20.3	22.3	-	18.6	19.3	21.1	-	17.3	17.9	19.6	-
		S/T	0.67	0.56	0.39	-	0.70	0.58	0.40	-	0.72	0.60	0.41	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.77	0.65	0.45
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	13	-	19	16	12	-	18	15	12	-
		kW	1.68	1.70	1.74	-	1.77	1.79	1.83	-	1.84	1.87	1.92	-	1.91	1.94	1.99	-	1.97	2.01	2.05	-	2.02	2.06	2.11
	Amps	5.7	5.8	6.0	-	6.1	6.3	6.5	-	6.7	6.8	7.1	-	7.1	7.3	7.5	-	7.6	7.8	8.0	-	8.0	8.2	8.5	-
		HI/PR	209	225	237	-	234	252	266	-	267	287	303	-	304	327	345	-	342	368	388	-	377	406	429
	LO PR	100	107	116	-	106	113	123	-	110	117	128	-	116	123	134	-	121	129	141	-	125	133	146	-
		MBh	22.8	23.7	25.9	-	22.3	23.1	25.3	-	21.8	22.6	24.7	-	21.2	22.0	24.1	-	20.2	20.9	22.9	-	18.7	19.4	21.2
	S/T	0.70	0.58	0.40	-	0.72	0.61	0.42	-	0.74	0.62	0.43	-	0.77	0.64	0.44	-	0.80	0.66	0.46	-	0.80	0.67	0.46	-
		ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	18	16	12	-	17	15	11
	kW	1.71	1.73	1.77	-	1.80	1.82	1.87	-	1.88	1.91	1.95	-	1.95	1.98	2.03	-	2.01	2.04	2.09	-	2.06	2.10	2.15	-
		Amps	5.8	6.0	6.2	-	6.3	6.5	6.7	-	6.9	7.0	7.3	-	7.3	7.5	7.8	-	7.8	8.0	8.3	-	8.3	8.5	8.7
HI/PR	215	232	245	-	242	260	275	-	275	296	312	-	313	337	356	-	352	379	400	-	389	419	442	-	
	LO PR	103	110	120	-	109	116	127	-	114	121	132	-	119	127	138	-	125	133	145	-	129	137	150	-
MBh	23.5	24.4	26.7	-	23.0	23.8	26.1	-	22.4	23.2	25.5	-	21.9	22.7	24.8	-	20.8	21.5	23.6	-	19.3	20.0	21.9	-	
	S/T	0.73	0.61	0.42	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.70	0.48	-	0.84	0.70	0.49	-
ΔT	18	15	12	-	18	15	12	-	18	15	12	-	18	16	12	-	18	15	12	-	17	14	11	-	
	kW	1.71	1.74	1.78	-	1.81	1.84	1.88	-	1.89	1.92	1.97	-	1.96	1.99	2.04	-	2.02	2.06	2.11	-	2.08	2.11	2.16	-
Amps	5.9	6.0	6.2	-	6.4	6.5	6.7	-	6.9	7.1	7.3	-	7.4	7.6	7.8	-	7.9	8.1	8.3	-	8.3	8.5	8.8	-	
	HI/PR	217	234	247	-	244	263	277	-	278	299	315	-	316	340	359	-	356	383	404	-	393	423	446	-
LO PR	104	111	121	-	110	117	128	-	115	122	133	-	120	128	140	-	126	134	147	-	131	139	152	-	

75	MBh	21.4	22.1	23.9	25.6	20.9	21.6	23.3	25.0	20.4	21.0	22.8	24.4	19.9	20.5	22.2	23.8	18.9	19.5	21.1	22.7	17.5	18.1	19.6	21.0
		S/T	0.77	0.69	0.52	0.33	0.79	0.71	0.54	0.35	0.81	0.73	0.55	0.35	0.84	0.75	0.57	0.37	0.87	0.78	0.59	0.38	0.88	0.79	0.60
	ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	20	19	15	11
		kW	1.69	1.71	1.75	1.79	1.78	1.80	1.84	1.89	1.86	1.88	1.93	1.98	1.93	1.96	2.00	2.05	1.99	2.02	2.07	2.12	2.04	2.07	2.12
	Amps	5.7	5.9	6.1	6.3	6.2	6.3	6.6	6.8	6.7	6.9	7.1	7.4	7.2	7.4	7.6	7.9	7.7	7.8	8.1	8.4	8.1	8.3	8.6	8.9
		HI/PR	211	227	240	250	237	255	269	281	269	290	306	319	307	330	348	363	345	371	392	409	381	410	433
	LO PR	101	108	118	125	107	114	124	132	111	118	129	138	117	124	136	145	122	130	142	151	127	135	147	157
		MBh	23.2	23.9	25.9	27.8	22.7	23.4	25.3	27.1	22.1	22.8	24.7	26.5	21.6	22.2	24.1	25.8	20.5	21.1	22.9	24.5	19.0	19.6	21.2
	S/T	0.79	0.71	0.54	0.35	0.82	0.74	0.56	0.36	0.84	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.82	0.62	0.40
		ΔT	21	20	16	11	21	20	16	11	21	20	16	11	22	20	16	11	21	20	16	11	20	18	15
	kW	1.71	1.74	1.78	1.82	1.81	1.84	1.88	1.92	1.89	1.92	1.97	2.01	1.96	1.99	2.04	2.09	2.02	2.06	2.11	2.16	2.08	2.11	2.17	2.22
		Amps	5.9	6.0	6.2	6.5	6.4	6.5	6.7	7.0	6.9	7.1	7.3	7.6	7.4	7.6	7.8	8.1	7.9	8.1	8.3	8.6	8.3	8.5	8.8
HI/PR	218	234	247	258	244	263	277	289	278	299	315	329	316	340	359	375	356	383	404	422	393	423	447	466	
	LO PR	104	111	121	129	110	117	128	136	115	122	133	142	120	128	140	149	126	134	147	156	131	139	152	161
MBh	23.9	24.6	26.7	28.6	23.4	24.1	26.0	27.9	22.8	23.5	25.4	27.3	22.2	22.9	24.8	26.6	21.1	21.8	23.6	25.3	19.6	20.2	21.8	23.4	
	S/T	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.38	0.89	0.79	0.60	0.39	0.91	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42
ΔT	20	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	20	19	15	11	19	18	14	10	
	kW	1.72	1.75	1.79	1.83	1.82	1.85	1.89	1.93	1.90	1.93	1.98	2.03	1.97	2.01	2.06	2.11	2.04	2.07	2.12	2.18	2.09	2.13	2.18	2.24
Amps	5.9	6.1	6.3	6.5	6.4	6.6	6.8	7.1	7.0	7.2	7.4	7.7	7.5	7.6	7.9	8.2	7.9	8.1	8.4	8.7	8.4	8.6	8.9	9.3	
	HI/PR	220	236	250	260	247	265	280	292	280	302	319	332	319	344	363	378	359	387	408	426	397	427	451	470
LO PR	105	112	122	130	111	119	129	138	116	123	135	143	122	129	141	150	127	136	148	158	132	140	153	163	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130241B/C (CONT.)

IDB	Airflow	Outdoor Ambient Temperature																													
		65					75					85					95					105					115				
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75
80	700	MBh	21.8	22.3	23.8	25.5	21.3	21.8	23.3	24.9	20.8	21.3	22.7	24.3	20.3	20.7	22.2	23.7	19.3	19.7	21.0	22.5	17.9	18.2	19.5	20.8					
		S/T	0.84	0.79	0.64	0.48	0.87	0.82	0.67	0.50	0.89	0.84	0.68	0.51	0.92	0.86	0.70	0.53	0.96	0.90	0.73	0.55	0.97	0.91	0.74	0.55					
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	25	24	20	16	24	23	20	16	23	22	19	15					
		kW	1.70	1.72	1.76	1.80	1.79	1.81	1.86	1.90	1.87	1.90	1.94	1.99	1.94	1.97	2.02	2.07	2.00	2.03	2.08	2.13	2.05	2.08	2.14	2.19					
		Amps	5.8	5.9	6.1	6.3	6.3	6.4	6.6	6.9	6.8	7.0	7.2	7.5	7.3	7.4	7.7	8.0	7.7	7.9	8.2	8.5	8.2	8.4	8.7	9.0					
	800	HI PR	213	229	242	253	239	257	272	283	272	293	309	322	310	333	352	367	348	375	396	413	385	414	438	456					
		LO PR	102	109	119	127	108	115	126	134	112	120	130	139	118	126	137	146	124	132	144	153	128	136	149	158					
		MBh	23.6	24.1	25.8	27.6	23.1	23.6	25.2	26.9	22.5	23.0	24.6	26.3	22.0	22.5	24.0	25.7	20.9	21.3	22.8	24.4	19.3	19.8	21.1	22.6					
		S/T	0.87	0.82	0.67	0.50	0.90	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.76	0.57	1.00	0.94	0.76	0.57					
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	19	15					
900	700	kW	1.72	1.75	1.79	1.83	1.82	1.85	1.89	1.93	1.90	1.93	1.98	2.03	1.97	2.01	2.06	2.11	2.04	2.07	2.12	2.18	2.09	2.13	2.18	2.24					
		Amps	5.9	6.1	6.3	6.5	6.4	6.6	6.8	7.1	7.0	7.2	7.4	7.7	7.5	7.6	7.9	8.2	7.9	8.1	8.4	8.7	8.4	8.6	8.9	9.3					
		HI PR	220	236	250	260	247	265	280	292	280	302	319	332	319	344	363	379	359	387	408	426	397	427	451	470					
		LO PR	105	112	123	130	111	119	129	138	116	123	135	143	122	129	141	150	127	136	148	158	132	140	153	163					
		MBh	24.3	24.9	26.6	28.4	23.8	24.3	26.0	27.7	23.2	23.7	25.3	27.1	22.6	23.1	24.7	26.4	21.5	22.0	23.5	25.1	19.9	20.4	21.8	23.3					
	800	S/T	0.91	0.86	0.70	0.52	0.95	0.89	0.72	0.54	1.00	0.91	0.74	0.55	1.00	0.94	0.77	0.57	1.00	1.00	0.79	0.59	1.00	1.00	0.80	0.60					
		ΔT	23	22	19	15	23	22	19	15	24	22	19	15	23	22	19	15	22	22	19	15	20	21	18	14					
		kW	1.73	1.76	1.80	1.84	1.83	1.86	1.90	1.95	1.91	1.94	1.99	2.04	1.99	2.02	2.07	2.12	2.05	2.08	2.14	2.19	2.10	2.14	2.19	2.25					
		Amps	6.0	6.1	6.3	6.6	6.5	6.6	6.9	7.1	7.0	7.2	7.5	7.7	7.5	7.7	8.0	8.3	8.0	8.2	8.5	8.8	8.5	8.7	9.0	9.3					
		HI PR	222	239	252	263	249	268	283	295	283	305	322	336	323	347	367	382	363	390	412	430	401	431	456	475					
85	700	LO PR	107	113	124	132	113	120	131	139	117	124	136	145	123	131	143	152	129	137	150	159	133	142	155	165					
		MBh	22.2	22.6	23.7	25.3	21.7	22.1	23.1	24.7	21.2	21.6	22.6	24.1	20.6	21.0	22.0	23.5	19.6	20.0	20.9	22.3	18.2	18.5	19.4	20.7					
		S/T	0.88	0.85	0.77	0.62	0.91	0.88	0.80	0.65	0.94	0.90	0.82	0.66	0.97	0.93	0.84	0.68	1.00	0.97	0.87	0.71	1.00	0.98	0.88	0.71					
		ΔT	26	25	24	21	26	26	24	21	26	26	24	21	26	26	24	21	26	25	24	21	24	24	22	19					
		kW	1.70	1.73	1.77	1.81	1.80	1.82	1.87	1.91	1.88	1.91	1.95	2.00	1.95	1.98	2.03	2.08	2.01	2.04	2.09	2.15	2.06	2.10	2.15	2.21					
	800	Amps	5.8	6.0	6.2	6.4	6.3	6.5	6.7	6.9	6.9	7.0	7.3	7.5	7.3	7.5	7.8	8.0	7.8	8.0	8.3	8.6	8.3	8.5	8.7	9.1					
		HI PR	215	232	245	255	242	260	274	286	275	296	312	326	313	337	356	371	352	379	400	417	389	419	442	461					
		LO PR	103	110	120	128	109	116	127	135	113	121	132	140	119	127	138	147	125	133	145	155	129	137	150	160					
		MBh	24.0	24.5	25.7	27.4	23.5	23.9	25.1	26.8	22.9	23.4	24.5	26.1	22.4	22.8	23.9	25.5	21.2	21.7	22.7	24.2	19.7	20.1	21.0	22.4					
		S/T	0.91	0.88	0.80	0.65	0.95	0.91	0.82	0.67	0.97	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.91	0.74					
900	700	ΔT	25	25	23	20	26	25	24	21	26	25	24	21	26	25	24	21	24	25	24	20	23	23	22	19					
		kW	1.73	1.76	1.80	1.84	1.83	1.86	1.90	1.95	1.91	1.94	1.99	2.04	1.99	2.02	2.07	2.12	2.05	2.08	2.14	2.19	2.10	2.14	2.19	2.25					
		Amps	6.0	6.1	6.3	6.6	6.5	6.6	6.9	7.1	7.0	7.2	7.5	7.7	7.5	7.7	8.0	8.3	8.0	8.2	8.5	8.8	8.5	8.7	9.0	9.3					
		HI PR	222	239	252	263	249	268	283	295	283	305	322	336	323	347	367	382	363	390	412	430	401	431	456	475					
		LO PR	107	113	124	132	113	120	131	139	117	124	136	145	123	131	143	152	129	137	150	159	133	142	155	165					
	800	MBh	24.8	25.2	26.4	28.2	24.2	24.7	25.8	27.6	23.6	24.1	25.2	26.9	23.0	23.5	24.6	26.2	21.9	22.3	23.4	24.9	20.3	20.7	21.6	23.1					
		S/T	0.96	0.92	0.83	0.68	0.99	0.96	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78					
		ΔT	24	24	23	20	25	24	23	20	24	24	23	20	24	24	23	20	22	23	23	20	21	21	21	18					
		kW	1.74	1.77	1.81	1.85	1.84	1.87	1.91	1.96	1.92	1.96	2.00	2.05	2.00	2.03	2.08	2.14	2.06	2.10	2.15	2.21	2.12	2.15	2.21	2.27					
		Amps	6.1	6.2	6.4	6.6	6.5	6.7	6.9	7.2	7.1	7.3	7.5	7.8	7.6	7.8	8.0	8.4	8.1	8.3	8.6	8.9	8.6	8.8	9.1	9.4					
900	HI PR	224	241	255	266	251	271	286	298	286	308	325	339	326	351	370	386	366	394	416	434	405	436	460	480						
	LO PR	108	114	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	138	151	161	135	143	156	166						

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp. + fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130301B/C

IDB	Airflow	Outdoor Ambient Temperature												105												115											
		65				75				85				95				105				115															
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71												
70	1181	MBh	24.9	25.8	28.3	-	24.4	25.2	27.7	-	23.8	24.6	27.0	-	23.2	24.0	26.3	-	22.0	22.8	25.0	-	20.4	21.2	23.2	-											
		S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.61	0.43	-	0.76	0.63	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-											
		ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-											
		kW	1.94	1.98	2.03	-	2.08	2.12	2.18	-	2.20	2.25	2.32	-	2.31	2.36	2.43	-	2.40	2.45	2.53	-	2.48	2.54	2.62	-											
		Amps	6.8	7.0	7.2	-	7.4	7.6	7.8	-	8.0	8.2	8.5	-	8.6	8.8	9.1	-	9.1	9.3	9.7	-	9.7	9.9	10.2	-											
		HI/PR	228	245	259	-	256	275	291	-	291	313	331	-	332	357	377	-	373	401	424	-	412	443	468	-											
	1050	LO/PR	102	109	119	-	108	115	125	-	112	119	130	-	118	125	137	-	124	131	143	-	128	136	148	-											
		MBh	27.0	28.0	30.7	-	26.4	27.4	30.0	-	25.8	26.7	29.3	-	25.1	26.1	28.5	-	23.9	24.7	27.1	-	22.1	22.9	25.1	-											
		S/T	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.82	0.69	0.48	-											
		ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-											
		kW	1.98	2.02	2.08	-	2.13	2.17	2.24	-	2.25	2.30	2.37	-	2.37	2.42	2.49	-	2.46	2.51	2.59	-	2.54	2.60	2.68	-											
		Amps	7.0	7.2	7.4	-	7.6	7.8	8.0	-	8.2	8.4	8.7	-	8.8	9.0	9.3	-	9.4	9.6	9.9	-	9.9	10.2	10.5	-											
919	HI/PR	235	253	267	-	264	284	300	-	300	323	341	-	342	368	388	-	384	414	437	-	425	457	483	-												
	LO/PR	105	112	122	-	111	118	129	-	116	123	134	-	122	129	141	-	127	135	148	-	132	140	153	-												
	MBh	27.8	28.8	31.6	-	27.2	28.2	30.9	-	26.5	27.5	30.1	-	25.9	26.8	29.4	-	24.6	25.5	27.9	-	22.8	23.6	25.9	-												
	S/T	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.86	0.72	0.50	-												
	ΔT	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	17	15	11	-	16	14	11	-												
	kW	2.00	2.04	2.10	-	2.14	2.19	2.25	-	2.27	2.32	2.39	-	2.39	2.44	2.51	-	2.48	2.53	2.62	-	2.56	2.62	2.70	-												
75	1181	Amps	7.1	7.2	7.5	-	7.7	7.8	8.1	-	8.3	8.5	8.8	-	8.9	9.1	9.4	-	9.5	9.7	10.0	-	10.0	10.3	10.6	-											
		HI/PR	237	256	270	-	266	287	303	-	303	326	344	-	345	371	392	-	388	418	441	-	429	462	488	-											
		LO/PR	106	113	124	-	112	120	131	-	117	124	136	-	123	131	143	-	129	137	149	-	133	142	155	-											
		MBh	25.4	26.1	28.3	30.3	24.8	25.5	27.6	29.6	24.2	24.9	26.9	28.9	23.6	24.3	26.3	28.2	22.4	23.1	25.0	26.8	20.8	21.4	23.1	24.8											
		S/T	0.79	0.70	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.58	0.38	0.90	0.80	0.61	0.39	0.90	0.81	0.61	0.39											
		ΔT	21	19	16	11	21	20	16	11	21	20	16	11	21	20	16	11	21	19	16	11	20	18	15	10											
	1050	kW	1.95	1.99	2.05	2.11	2.09	2.14	2.20	2.27	2.22	2.26	2.33	2.41	2.33	2.38	2.45	2.53	2.42	2.47	2.55	2.63	2.50	2.56	2.64	2.72											
		Amps	6.9	7.1	7.3	7.6	7.4	7.6	7.9	8.2	8.1	8.3	8.6	8.9	8.6	8.9	9.2	9.5	9.2	9.4	9.7	10.1	9.7	10.0	10.3	10.7											
		HI/PR	230	248	262	273	259	278	294	306	294	316	334	349	335	360	381	397	377	405	428	447	416	448	473	493											
		LO/PR	103	110	120	128	109	116	127	135	113	121	132	140	119	127	138	147	125	133	145	154	129	137	150	160											
		MBh	27.5	28.3	30.6	32.9	26.8	27.6	29.9	32.1	26.2	27.0	29.2	31.3	25.6	26.3	28.5	30.6	24.3	25.0	27.1	29.0	22.5	23.2	25.1	26.9											
		S/T	0.82	0.73	0.55	0.36	0.85	0.76	0.57	0.37	0.87	0.78	0.59	0.38	0.90	0.80	0.61	0.39	0.93	0.83	0.63	0.40	0.94	0.84	0.63	0.41											
919	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10												
	kW	2.00	2.04	2.10	2.16	2.14	2.19	2.25	2.32	2.27	2.32	2.39	2.47	2.39	2.44	2.51	2.59	2.48	2.53	2.62	2.70	2.57	2.62	2.70	2.79												
	Amps	7.1	7.2	7.5	7.8	7.7	7.8	8.1	8.4	8.3	8.5	8.8	9.1	8.9	9.1	9.4	9.8	9.5	9.7	10.0	10.4	10.0	10.3	10.6	11.0												
	HI/PR	238	256	270	282	267	287	303	316	303	326	344	359	345	372	392	409	388	418	441	460	429	462	488	509												
	LO/PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165												
	MBh	28.3	29.1	31.5	33.9	27.6	28.5	30.8	33.1	27.0	27.8	30.1	32.3	26.3	27.1	29.3	31.5	25.0	25.8	27.9	29.9	23.2	23.9	25.8	27.7												
70	S/T	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.91	0.81	0.62	0.40	0.94	0.84	0.64	0.41	0.97	0.87	0.66	0.42	0.98	0.88	0.67	0.43												
	ΔT	20	18	15	10	20	18	15	10	20	18	15	10	20	19	15	11	20	18	15	10	19	17	14	10												
	kW	2.01	2.05	2.11	2.18	2.16	2.20	2.27	2.34	2.29	2.34	2.41	2.49	2.40	2.46	2.53	2.61	2.50	2.56	2.64	2.72	2.59	2.64	2.73	2.82												
	Amps	7.1	7.3	7.6	7.8	7.7	7.9	8.2	8.5	8.4	8.6	8.9	9.2	9.0	9.2	9.5	9.9	9.6	9.8	10.1	10.5	10.1	10.4	10.7	11.1												
	HI/PR	240	258	273	284	269	290	306	319	306	329	348	363	349	375	396	413	392	422	446	465	433	466	493	514												
	LO/PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166												

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130301B/C (CONT.)

IDB	Airflow	Outdoor Ambient Temperature												Entering Indoor Wet Bulb Temperature												
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	1181	MBh	25.8	26.4	28.2	30.1	25.2	25.8	27.5	29.4	24.6	25.1	26.9	28.7	24.0	24.5	26.2	28.0	22.8	23.3	24.9	26.6	21.1	21.6	23.1	24.7
		S/T	0.86	0.81	0.66	0.49	0.90	0.84	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.98	0.92	0.75	0.56	0.99	0.93	0.76	0.57
	ΔT	23	22	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15	
	kW	1.97	2.01	2.07	2.13	2.11	2.15	2.22	2.29	2.24	2.28	2.35	2.43	2.35	2.40	2.47	2.55	2.44	2.49	2.57	2.66	2.52	2.58	2.66	2.75	
	Amps	7.0	7.1	7.3	7.6	7.5	7.7	7.9	8.2	8.2	8.4	8.6	9.0	8.7	8.9	9.2	9.6	9.3	9.5	9.8	10.2	9.8	10.1	10.4	10.8	
	HI PR	233	250	264	276	261	281	297	310	297	320	338	352	338	364	384	401	381	410	432	451	420	452	478	498	
	LO PR	104	111	121	129	110	117	128	136	114	122	133	142	120	128	140	149	126	134	146	156	130	139	151	161	
	MBh	28.0	28.6	30.5	32.6	27.3	27.9	29.8	31.9	26.7	27.2	29.1	31.1	26.0	26.6	28.4	30.4	24.7	25.3	27.0	28.8	22.9	23.4	25.0	26.7	
	S/T	0.90	0.84	0.68	0.51	0.93	0.87	0.71	0.53	0.95	0.89	0.73	0.54	0.98	0.92	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.96	0.78	0.59	
	ΔT	23	22	19	15	23	22	19	16	23	22	19	16	23	23	20	16	23	23	20	16	21	21	18	14	
kW	2.01	2.05	2.12	2.18	2.16	2.20	2.27	2.34	2.29	2.34	2.41	2.49	2.40	2.46	2.53	2.61	2.50	2.56	2.64	2.72	2.59	2.64	2.73	2.82		
Amps	7.1	7.3	7.6	7.8	7.7	7.9	8.2	8.5	8.4	8.6	8.9	9.2	9.0	9.2	9.5	9.9	9.6	9.8	10.1	10.5	10.1	10.4	10.7	11.1		
HI PR	240	258	273	284	269	290	306	319	306	330	348	363	349	375	396	413	392	422	446	465	433	466	493	514		
LO PR	107	114	125	133	114	121	132	140	118	126	137	146	124	132	144	153	130	138	151	161	134	143	156	166		
MBh	28.8	29.4	31.4	33.6	28.1	28.7	30.7	32.8	27.5	28.1	30.0	32.1	26.8	27.4	29.3	31.3	25.5	26.0	27.8	29.7	23.6	24.1	25.7	27.5		
S/T	0.94	0.88	0.72	0.54	1.00	0.91	0.74	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.82	0.62		
ΔT	22	21	18	15	23	22	19	15	22	21	19	15	22	22	19	15	21	21	19	15	19	20	17	14		
kW	2.03	2.07	2.13	2.20	2.18	2.22	2.29	2.36	2.31	2.36	2.43	2.51	2.42	2.48	2.55	2.64	2.52	2.58	2.66	2.74	2.61	2.66	2.75	2.84		
Amps	7.2	7.4	7.6	7.9	7.8	8.0	8.2	8.6	8.5	8.7	9.0	9.3	9.1	9.3	9.6	10.0	9.6	9.9	10.2	10.6	10.2	10.5	10.8	11.2		
HI PR	242	261	275	287	272	293	309	322	309	333	351	367	352	379	400	417	396	426	450	470	438	471	498	519		
LO PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168		
85	1181	MBh	26.3	26.8	28.0	29.9	25.7	26.1	27.4	29.2	25.0	25.5	26.7	28.5	24.4	24.9	26.1	27.8	23.2	23.7	24.8	26.4	21.5	21.9	23.0	24.5
		S/T	0.91	0.87	0.79	0.64	0.94	0.91	0.82	0.66	0.96	0.93	0.84	0.68	0.99	0.96	0.86	0.70	1.00	0.99	0.90	0.73	1.00	1.00	0.91	0.73
	ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	20	24	25	23	20	23	23	22	19	
	kW	1.98	2.02	2.08	2.15	2.13	2.17	2.24	2.31	2.25	2.30	2.37	2.45	2.37	2.42	2.49	2.57	2.46	2.51	2.59	2.68	2.54	2.60	2.68	2.77	
	Amps	7.0	7.2	7.4	7.7	7.6	7.8	8.0	8.3	8.2	8.4	8.7	9.0	8.8	9.0	9.3	9.7	9.4	9.6	9.9	10.3	9.9	10.2	10.5	10.9	
	HI PR	235	253	267	279	264	284	300	313	300	323	341	356	342	368	388	405	384	414	437	456	425	457	483	503	
	LO PR	105	112	122	130	111	118	129	138	116	123	134	143	121	129	141	150	127	135	148	157	132	140	153	163	
	MBh	28.5	29.0	30.4	32.4	27.8	28.3	29.7	31.7	27.1	27.7	29.0	30.9	26.5	27.0	28.3	30.1	25.1	25.6	26.8	28.6	23.3	23.7	24.9	26.5	
	S/T	0.94	0.91	0.82	0.66	0.97	0.94	0.85	0.69	1.00	0.96	0.87	0.71	1.00	0.99	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76	
	ΔT	25	24	23	20	25	24	23	20	25	24	23	20	24	25	23	20	24	25	23	20	21	22	21	19	
kW	2.03	2.07	2.13	2.20	2.18	2.22	2.29	2.36	2.31	2.36	2.43	2.51	2.42	2.48	2.55	2.64	2.52	2.58	2.66	2.74	2.61	2.66	2.75	2.84		
Amps	7.2	7.4	7.6	7.9	7.8	8.0	8.2	8.6	8.5	8.7	9.0	9.3	9.1	9.3	9.6	10.0	9.6	9.9	10.2	10.6	10.2	10.5	10.8	11.2		
HI PR	242	261	275	287	272	293	309	322	309	333	351	367	352	379	400	417	396	426	450	470	438	471	498	519		
LO PR	109	116	126	134	115	122	133	142	119	127	138	147	125	133	145	155	131	140	152	162	136	144	158	168		
MBh	29.3	29.9	31.3	33.4	28.6	29.2	30.6	32.6	27.9	28.5	29.8	31.8	27.3	27.8	29.1	31.1	25.9	26.4	27.7	29.5	24.0	24.5	25.6	27.3		
S/T	0.98	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.76	1.00	1.00	0.98	0.79	1.00	1.00	0.98	0.80		
ΔT	24	23	22	19	23	23	22	19	23	23	22	19	22	23	22	19	22	23	22	19	20	20	21	18		
kW	2.04	2.08	2.15	2.21	2.19	2.24	2.31	2.38	2.33	2.37	2.45	2.53	2.44	2.49	2.57	2.66	2.54	2.60	2.68	2.77	2.63	2.69	2.77	2.86		
Amps	7.3	7.4	7.7	8.0	7.9	8.1	8.3	8.6	8.5	8.8	9.0	9.4	9.1	9.4	9.7	10.0	9.7	10.0	10.3	10.7	10.3	10.6	10.9	11.3		
HI PR	245	263	278	290	275	296	312	326	312	336	355	370	356	383	404	422	400	431	455	474	442	476	503	524		
LO PR	110	117	127	136	116	123	135	143	120	128	140	149	126	135	147	156	133	141	154	164	137	146	159	170		

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130361B/C

IDB		Outdoor Ambient Temperature												Entering Indoor Wet Bulb Temperature											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	Airflow	31.1	32.2	35.3	-	30.4	31.5	34.5	-	29.6	30.7	33.7	-	28.9	30.0	32.8	-	27.5	28.5	31.2	-	25.4	26.4	28.9	-
	MBh	0.70	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.67	0.46	-
	S/T	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	13	-	18	15	12	-
	ΔT	2.40	2.44	2.52	-	2.57	2.63	2.71	-	2.73	2.78	2.87	-	2.86	2.92	3.02	-	2.98	3.04	3.14	-	3.08	3.15	3.25	-
	Amps	8.7	8.9	9.2	-	9.4	9.7	10.0	-	10.3	10.5	10.9	-	11.0	11.3	11.6	-	11.7	12.0	12.4	-	12.4	12.7	13.1	-
	HI PR	214	231	244	-	241	259	273	-	274	294	311	-	312	335	354	-	351	377	398	-	387	417	440	-
	LO PR	99	106	115	-	105	112	122	-	109	116	127	-	115	122	133	-	120	128	139	-	124	132	144	-
	MBh	33.7	34.9	38.2	-	32.9	34.1	37.4	-	32.1	33.3	36.5	-	31.3	32.5	35.6	-	29.8	30.8	33.8	-	27.6	28.6	31.3	-
	S/T	0.72	0.60	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.44	-	0.79	0.66	0.46	-	0.82	0.69	0.48	-	0.83	0.69	0.48	-
	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
1200	kW	2.45	2.50	2.58	-	2.63	2.69	2.77	-	2.79	2.85	2.94	-	2.93	3.00	3.09	-	3.05	3.12	3.22	-	3.16	3.23	3.33	-
	Amps	9.0	9.2	9.5	-	9.7	10.0	10.3	-	10.6	10.8	11.2	-	11.3	11.6	12.0	-	12.0	12.3	12.8	-	12.8	13.1	13.5	-
	HI PR	221	238	251	-	248	267	282	-	282	304	321	-	321	346	365	-	361	389	411	-	399	430	454	-
	LO PR	102	109	119	-	108	115	126	-	112	120	131	-	118	126	137	-	124	132	144	-	128	136	149	-
	MBh	34.7	36.0	39.4	-	33.9	35.1	38.5	-	33.1	34.3	37.6	-	32.3	33.4	36.6	-	30.7	31.8	34.8	-	28.4	29.4	32.2	-
	S/T	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.80	0.67	0.47	-	0.83	0.69	0.48	-	0.86	0.72	0.50	-	0.87	0.73	0.50	-
	ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-
	kW	2.47	2.52	2.60	-	2.65	2.71	2.79	-	2.82	2.88	2.97	-	2.96	3.02	3.12	-	3.08	3.15	3.25	-	3.18	3.25	3.36	-
	Amps	9.1	9.3	9.6	-	9.8	10.0	10.4	-	10.7	10.9	11.3	-	11.4	11.7	12.1	-	12.1	12.5	12.9	-	12.9	13.2	13.7	-
	HI PR	223	240	254	-	250	270	285	-	285	307	324	-	324	349	369	-	365	393	415	-	403	434	458	-
LO PR	103	110	120	-	109	116	127	-	114	121	132	-	119	127	139	-	125	133	145	-	129	138	150	-	

1050	MBh	31.6	32.5	35.2	37.8	30.9	31.8	34.4	36.9	30.1	31.0	33.6	36.1	29.4	<b>30.3</b>	32.8	35.2	27.9	28.8	31.1	33.4	25.9	26.6	28.8	31.0
	S/T	0.79	0.71	0.54	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.37	0.87	<b>0.78</b>	0.59	0.38	0.90	0.81	0.61	0.39	0.91	0.81	0.61	0.40
	ΔT	22	20	17	11	22	20	17	12	22	20	17	12	22	<b>21</b>	17	12	22	20	17	11	21	19	16	11
	kW	2.41	2.46	2.54	2.62	2.59	2.65	2.73	2.81	2.75	2.81	2.89	2.99	2.89	<b>2.95</b>	3.04	3.14	3.00	3.07	3.17	3.27	3.11	3.17	3.28	3.38
	Amps	8.8	9.0	9.3	9.7	9.5	9.8	10.1	10.5	10.4	10.6	11.0	11.4	11.1	<b>11.4</b>	11.7	12.2	11.8	12.1	12.5	13.0	12.5	12.8	13.3	13.8
	HI PR	217	233	246	257	243	262	276	288	276	297	314	328	315	<b>339</b>	358	373	354	381	402	420	391	421	445	464
	LO PR	100	107	117	124	106	113	123	131	110	117	128	136	116	<b>123</b>	134	143	121	129	141	150	125	133	146	155
	MBh	34.2	35.3	38.2	41.0	33.5	34.4	37.3	40.0	32.7	33.6	36.4	39.1	31.9	<b>32.8</b>	35.5	38.1	30.3	31.2	33.7	36.2	28.0	28.9	31.2	33.5
	S/T	0.82	0.73	0.56	0.36	0.85	0.76	0.58	0.37	0.87	0.78	0.59	0.38	0.90	<b>0.80</b>	0.61	0.39	0.93	0.83	0.63	0.41	0.94	0.84	0.64	0.41
	ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	<b>20</b>	17	11	22	20	16	11	20	19	15	11
1200	kW	2.47	2.52	2.60	2.68	2.65	2.71	2.79	2.88	2.82	2.88	2.97	3.06	2.96	<b>3.02</b>	3.12	3.22	3.08	3.15	3.25	3.35	3.18	3.25	3.36	3.47
	Amps	9.1	9.3	9.6	10.0	9.8	10.0	10.4	10.8	10.7	10.9	11.3	11.7	11.4	<b>11.7</b>	12.1	12.5	12.2	12.5	12.9	13.4	12.9	13.2	13.7	14.2
	HI PR	223	240	254	265	251	270	285	297	285	307	324	338	325	<b>349</b>	369	385	365	393	415	433	403	434	458	478
	LO PR	103	110	120	128	109	116	127	135	114	121	132	141	119	<b>127</b>	139	148	125	133	145	155	129	138	150	160
	MBh	35.3	36.3	39.3	42.2	34.5	35.5	38.4	41.2	33.6	34.6	37.5	40.2	32.8	<b>33.8</b>	36.6	39.3	31.2	32.1	34.7	37.3	28.9	29.7	32.2	34.5
	S/T	0.86	0.77	0.58	0.37	0.89	0.80	0.60	0.39	0.91	0.82	0.62	0.40	0.94	<b>0.84</b>	0.64	0.41	0.98	0.88	0.66	0.43	0.99	0.88	0.67	0.43
	ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	<b>19</b>	16	11	21	19	16	11	19	18	15	10
	kW	2.49	2.54	2.62	2.70	2.68	2.73	2.82	2.91	2.84	2.90	2.99	3.09	2.98	<b>3.05</b>	3.14	3.25	3.10	3.17	3.27	3.38	3.21	3.28	3.39	3.50
	Amps	9.1	9.4	9.7	10.0	9.9	10.1	10.5	10.9	10.8	11.0	11.4	11.8	11.5	<b>11.8</b>	12.2	12.7	12.3	12.6	13.0	13.5	13.0	13.3	13.8	14.3
	HI PR	226	243	256	267	253	272	288	300	288	310	327	341	328	<b>353</b>	372	388	369	397	419	437	407	438	463	483
LO PR	104	111	121	129	110	117	128	137	115	122	133	142	121	<b>128</b>	140	149	126	134	147	156	131	139	152	162	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130361B/C (CONT.)

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
80	1050	MBh	32.2	32.9	35.1	37.5	31.4	32.1	34.3	36.7	30.7	31.3	33.5	35.8	29.9	30.6	32.7	34.9	28.4	29.1	31.0	33.2	26.3	26.9	28.8	30.7	
		S/T	0.87	0.81	0.66	0.49	0.90	0.84	0.69	0.51	0.92	0.86	0.70	0.53	0.95	0.89	0.73	0.54	0.99	0.93	0.75	0.56	1.00	0.93	0.76	0.57	
		ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	25	24	20	16	23	22	19	15	
	1200	kW	2.43	2.48	2.56	2.64	2.61	2.67	2.75	2.84	2.77	2.83	2.92	3.01	2.91	2.97	3.07	3.17	3.03	3.09	3.19	3.30	3.13	3.20	3.30	3.41	
		Amps	8.9	9.1	9.4	9.8	9.6	9.9	10.2	10.6	10.5	10.7	11.1	11.5	11.2	11.5	11.9	12.3	11.9	12.2	12.6	13.1	12.6	13.0	13.4	13.9	
		HI/PR	219	235	249	259	245	264	279	291	279	300	317	331	318	342	361	377	358	385	406	424	395	425	449	468	
	1350	LO/PR	101	108	118	125	107	114	124	132	111	118	129	138	117	124	136	145	123	130	142	152	127	135	147	157	
		MBh	34.9	35.6	38.1	40.7	34.0	34.8	37.2	39.7	33.2	34.0	36.3	38.8	32.4	33.1	35.4	37.8	30.8	31.5	33.6	36.0	28.5	29.2	31.2	33.3	
		S/T	0.90	0.84	0.69	0.51	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	0.99	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	0.97	0.79	0.59	
	85	1050	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	25	23	20	16	24	23	20	16	22	22	19	15
			kW	2.49	2.54	2.62	2.70	2.68	2.73	2.82	2.91	2.84	2.90	2.99	3.09	2.98	3.05	3.14	3.25	3.11	3.17	3.27	3.38	3.21	3.28	3.39	3.50
			Amps	9.1	9.4	9.7	10.0	9.9	10.1	10.5	10.9	10.8	11.0	11.4	11.8	11.5	11.8	12.2	12.7	12.3	12.6	13.0	13.5	13.0	13.3	13.8	14.3
1200		HI/PR	226	243	256	267	253	272	288	300	288	310	327	341	328	353	373	389	369	397	419	437	407	438	463	483	
		LO/PR	105	111	121	129	110	117	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	
		MBh	35.9	36.7	39.2	41.9	35.1	35.8	38.3	40.9	34.2	35.0	37.4	40.0	33.4	34.1	36.5	39.0	31.7	32.4	34.6	37.0	29.4	30.0	32.1	34.3	
1350		S/T	0.94	0.88	0.72	0.54	1.00	0.92	0.75	0.56	1.00	0.94	0.76	0.57	1.00	0.97	0.79	0.59	1.00	1.00	0.82	0.61	1.00	1.00	0.83	0.62	
		ΔT	23	22	19	15	24	22	19	16	23	22	19	16	23	23	20	16	22	22	19	15	20	20	18	14	
		kW	2.51	2.56	2.64	2.72	2.70	2.75	2.84	2.93	2.86	2.92	3.01	3.11	3.01	3.07	3.17	3.27	3.13	3.20	3.30	3.41	3.24	3.31	3.42	3.53	
1500		Amps	9.2	9.5	9.8	10.1	10.0	10.2	10.6	11.0	10.9	11.1	11.5	11.9	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.6	13.1	13.5	13.9	14.5	
		HI/PR	228	245	259	270	256	275	290	303	291	313	330	345	331	356	376	392	372	401	423	441	412	443	468	488	
		LO/PR	106	112	123	131	112	119	130	138	116	123	135	143	122	130	141	151	128	136	148	158	132	140	153	163	

85	1050	MBh	32.7	33.4	34.9	37.3	32.0	32.6	34.1	36.4	31.2	31.8	33.3	35.6	30.5	31.0	32.5	34.7	28.9	29.5	30.9	33.0	26.8	27.3	28.6	30.5	
		S/T	0.91	0.88	0.79	0.64	0.94	0.91	0.82	0.67	0.97	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	1.00	0.90	0.73	1.00	1.00	0.91	0.74	
		ΔT	26	26	24	21	26	26	25	21	26	26	25	21	27	26	25	21	25	26	24	21	23	24	23	20	
	1200	kW	2.45	2.50	2.58	2.66	2.63	2.69	2.77	2.86	2.79	2.85	2.94	3.04	2.93	3.00	3.09	3.19	3.05	3.12	3.22	3.33	3.16	3.23	3.33	3.44	
		Amps	9.0	9.2	9.5	9.9	9.7	10.0	10.3	10.7	10.6	10.8	11.2	11.6	11.3	11.6	12.0	12.4	12.0	12.3	12.8	13.2	12.8	13.1	13.5	14.0	
		HI/PR	221	238	251	262	248	267	282	294	282	303	320	334	321	346	365	381	361	389	411	428	399	430	454	473	
	1500	LO/PR	102	109	119	127	108	115	126	134	112	120	131	139	118	126	137	146	124	132	144	153	128	136	149	158	
		MBh	35.5	36.2	37.9	40.4	34.6	35.3	37.0	39.5	33.8	34.5	36.1	38.5	33.0	33.6	35.2	37.6	31.3	31.9	33.5	35.7	29.0	29.6	31.0	33.1	
		S/T	0.94	0.91	0.82	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.87	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.94	0.76	
	85	1050	ΔT	26	25	24	21	26	26	24	21	26	26	24	21	25	26	24	21	24	24	24	21	22	23	22	19
			kW	2.51	2.56	2.64	2.72	2.70	2.75	2.84	2.93	2.86	2.92	3.01	3.11	3.01	3.07	3.17	3.27	3.13	3.20	3.30	3.41	3.24	3.31	3.42	3.53
			Amps	9.2	9.5	9.8	10.1	10.0	10.2	10.6	11.0	10.9	11.1	11.5	11.9	11.6	11.9	12.3	12.8	12.4	12.7	13.1	13.6	13.1	13.5	13.9	14.5
1200		HI/PR	228	245	259	270	256	275	290	303	291	313	330	345	331	356	376	392	372	401	423	441	412	443	468	488	
		LO/PR	106	112	123	131	112	119	130	138	116	123	135	143	122	130	141	151	128	136	148	158	132	140	153	163	
		MBh	36.5	37.2	39.0	41.6	35.7	36.4	38.1	40.6	34.8	35.5	37.2	39.7	34.0	34.6	36.3	38.7	32.3	32.9	34.5	36.8	29.9	30.5	31.9	34.1	
1500		S/T	0.99	0.95	0.86	0.70	1.00	0.99	0.89	0.72	1.00	1.00	0.91	0.74	1.00	1.00	0.94	0.77	1.00	1.00	0.98	0.80	1.00	1.00	0.99	0.80	
		ΔT	25	24	23	20	24	24	23	20	24	24	23	20	23	24	23	20	22	22	23	20	20	21	21	19	
		kW	2.53	2.58	2.66	2.74	2.72	2.77	2.86	2.95	2.88	2.95	3.04	3.14	3.03	3.10	3.20	3.30	3.16	3.22	3.33	3.44	3.26	3.33	3.44	3.56	
1500		Amps	9.3	9.5	9.9	10.2	10.1	10.3	10.7	11.1	11.0	11.2	11.6	12.1	11.7	12.0	12.4	12.9	12.5	12.8	13.2	13.8	13.3	13.6	14.0	14.6	
		HI/PR	230	248	261	273	258	278	293	306	294	316	334	348	334	360	380	396	376	405	427	446	416	447	472	493	
		LO/PR	107	113	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	159	133	142	155	165	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130421B/C

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	1225	MBh	36.0	37.3	40.9	-	35.2	36.4	39.9	-	34.3	35.6	39.0	-	33.5	34.7	38.0	-	31.8	33.0	36.1	-	29.5	30.5	33.5	-	
		S/T	0.69	0.57	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.79	0.66	0.46	-	
		ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-	
	1400	kW	2.78	2.84	2.92	-	2.98	3.04	3.13	-	3.15	3.21	3.31	-	3.30	3.37	3.47	-	3.43	3.50	3.61	-	3.54	3.61	3.73	-	
		Amps	10.7	10.9	11.2	-	11.5	11.8	12.1	-	12.5	12.7	13.2	-	13.3	13.6	14.0	-	14.1	14.5	14.9	-	14.9	15.3	15.8	-	
		Hi PR	209	225	238	-	235	253	267	-	267	288	304	-	304	328	346	-	343	369	389	-	378	407	430	-	
	1575	Lo PR	101	107	117	-	106	113	124	-	111	118	129	-	116	124	135	-	122	130	141	-	126	134	146	-	
		MBh	39.0	40.4	44.3	-	38.1	39.5	43.3	-	37.2	38.5	42.2	-	36.3	37.6	41.2	-	34.5	35.7	39.1	-	31.9	33.1	36.3	-	
		S/T	0.71	0.59	0.41	-	0.74	0.62	0.43	-	0.76	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.68	0.47	-	0.82	0.68	0.47	-	
	75	1225	ΔT	18	16	12	-	18	16	12	-	18	16	12	-	19	16	12	-	18	16	12	-	17	15	11	-
			kW	2.84	2.90	2.98	-	3.05	3.11	3.20	-	3.22	3.29	3.39	-	3.38	3.45	3.55	-	3.51	3.58	3.70	-	3.63	3.70	3.82	-
			Amps	10.9	11.2	11.6	-	11.8	12.1	12.5	-	12.8	13.1	13.5	-	13.7	14.0	14.4	-	14.5	14.9	15.3	-	15.4	15.7	16.2	-
1400		Hi PR	216	232	245	-	242	261	275	-	276	297	313	-	314	338	357	-	353	380	401	-	390	420	443	-	
		Lo PR	104	111	121	-	110	117	127	-	114	121	132	-	120	127	139	-	126	134	146	-	130	138	151	-	
		MBh	40.2	41.6	45.6	-	39.2	40.7	44.6	-	38.3	39.7	43.5	-	37.4	38.7	42.4	-	35.5	36.8	40.3	-	32.9	34.1	37.3	-	
1575		S/T	0.75	0.62	0.43	-	0.77	0.65	0.45	-	0.79	0.66	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.86	0.72	0.50	-	
		ΔT	18	15	11	-	18	15	12	-	18	15	12	-	18	15	12	-	18	15	12	-	16	14	11	-	
		kW	2.87	2.92	3.01	-	3.07	3.13	3.22	-	3.25	3.31	3.41	-	3.41	3.48	3.58	-	3.54	3.61	3.73	-	3.66	3.73	3.85	-	
75		1225	Amps	11.0	11.3	11.7	-	11.9	12.2	12.6	-	12.9	13.2	13.6	-	13.8	14.1	14.6	-	14.6	15.0	15.5	-	15.5	15.9	16.4	-
			Hi PR	218	235	248	-	245	263	278	-	278	300	316	-	317	341	360	-	357	384	405	-	394	424	448	-
			Lo PR	105	112	122	-	111	118	129	-	115	123	134	-	121	129	141	-	127	135	147	-	131	140	152	-
75	1225	MBh	36.6	37.7	40.8	43.8	35.8	36.8	39.9	42.8	34.9	35.9	38.9	41.8	34.1	35.1	38.0	40.7	32.4	33.3	36.1	38.7	30.0	30.9	33.4	35.8	
		S/T	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.90	0.80	0.61	0.39	
		ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	20	19	15	10	
	1400	kW	2.80	2.86	2.94	3.03	3.00	3.06	3.15	3.24	3.17	3.24	3.33	3.44	3.33	3.39	3.50	3.61	3.46	3.53	3.64	3.75	3.57	3.64	3.76	3.88	
		Amps	10.8	11.0	11.3	11.8	11.6	11.9	12.2	12.7	12.6	12.9	13.3	13.8	13.4	13.7	14.2	14.7	14.2	14.6	15.1	15.6	15.1	15.4	15.9	16.5	
		Hi PR	212	228	240	251	237	256	270	281	270	291	307	320	308	331	350	365	346	372	393	410	382	411	434	453	
	1575	Lo PR	102	108	118	126	108	114	125	133	112	119	130	138	117	125	136	145	123	131	143	152	127	135	148	157	
		MBh	39.7	40.8	44.2	47.4	38.7	39.9	43.2	46.3	37.8	38.9	42.2	45.2	36.9	38.0	41.1	44.1	35.1	36.1	39.1	41.9	32.5	33.4	36.2	38.8	
		S/T	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.37	0.86	0.77	0.58	0.37	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.93	0.83	0.63	0.40	
	75	1225	ΔT	21	19	16	11	21	20	16	11	21	20	16	11	22	20	16	11	21	20	16	11	20	18	15	10
			kW	2.87	2.92	3.01	3.10	3.07	3.13	3.22	3.32	3.25	3.31	3.41	3.52	3.41	3.48	3.58	3.70	3.54	3.61	3.73	3.84	3.66	3.73	3.85	3.97
			Amps	11.0	11.3	11.7	12.1	11.9	12.2	12.6	13.0	12.9	13.2	13.6	14.1	13.8	14.1	14.6	15.1	14.6	15.0	15.5	16.1	15.5	15.9	16.4	17.0
1400		Hi PR	218	235	248	259	245	263	278	290	278	300	316	330	317	341	360	376	357	384	405	423	394	424	448	467	
		Lo PR	105	112	122	130	111	118	129	137	115	123	134	143	121	129	141	150	127	135	147	157	131	140	152	162	
		MBh	40.9	42.1	45.5	48.9	39.9	41.1	44.5	47.7	39.0	40.1	43.4	46.6	38.0	39.1	42.4	45.5	36.1	37.2	40.2	43.2	33.4	34.4	37.3	40.0	
1575		S/T	0.85	0.76	0.57	0.37	0.88	0.79	0.60	0.38	0.90	0.81	0.61	0.39	0.93	0.83	0.63	0.41	0.97	0.86	0.65	0.42	0.97	0.87	0.66	0.42	
		ΔT	20	19	15	11	20	19	15	11	21	19	15	11	21	19	16	11	20	19	15	11	19	18	14	10	
		kW	2.89	2.94	3.03	3.12	3.09	3.15	3.25	3.35	3.27	3.34	3.44	3.55	3.43	3.50	3.61	3.72	3.57	3.64	3.76	3.87	3.68	3.76	3.88	4.00	
75		1575	Amps	11.1	11.4	11.8	12.2	12.0	12.3	12.7	13.2	13.0	13.3	13.8	14.3	13.9	14.2	14.7	15.2	14.8	15.1	15.6	16.2	15.6	16.0	16.5	17.2
			Hi PR	220	237	250	261	247	266	281	293	281	303	320	333	320	345	364	380	360	388	409	427	398	428	452	472
			Lo PR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	128	136	149	158	133	141	154	164

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130421B/C (CONT.)

IDB	Airflow	Outdoor Ambient Temperature															105															115														
		65					75					85					95					105					115																			
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75															
80	1225	MBh	37.3	38.1	40.7	43.5	36.4	37.2	39.7	42.5	35.5	36.3	38.8	41.5	34.7	35.4	37.8	40.5	32.9	33.6	36.0	38.4	30.5	31.2	33.3	35.6																				
		S/T	0.86	0.80	0.65	0.49	0.89	0.83	0.68	0.51	0.91	0.85	0.69	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	0.98	0.92	0.75	0.56																				
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	22	19	15																				
		kW	2.82	2.88	2.96	3.05	3.02	3.08	3.17	3.27	3.20	3.26	3.36	3.46	3.35	3.42	3.53	3.64	3.48	3.56	3.67	3.78	3.60	3.67	3.79	3.91																				
		Amps	10.8	11.1	11.4	11.9	11.7	12.0	12.4	12.8	12.7	13.0	13.4	13.9	13.5	13.8	14.3	14.8	14.4	14.7	15.2	15.8	15.2	15.6	16.1	16.7																				
		HiPR	214	230	243	253	240	258	273	284	273	294	310	323	311	334	353	368	350	376	397	414	386	416	439	458																				
	1400	LoPR	103	109	119	127	109	116	126	134	113	120	131	140	119	126	138	147	124	132	144	154	129	137	149	159																				
		MBh	40.4	41.3	44.1	47.1	39.4	40.3	43.1	46.0	38.5	39.3	42.0	44.9	37.6	38.4	41.0	43.8	35.7	36.5	39.0	41.6	33.0	33.8	36.1	38.6																				
		S/T	0.89	0.83	0.68	0.51	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.95	0.77	0.58	1.00	0.96	0.78	0.58																				
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	22	21	18	15																				
		kW	2.89	2.94	3.03	3.12	3.09	3.15	3.25	3.35	3.27	3.34	3.44	3.55	3.43	3.50	3.61	3.72	3.57	3.64	3.76	3.88	3.68	3.76	3.88	4.01																				
		Amps	11.1	11.4	11.8	12.2	12.0	12.3	12.7	13.2	13.0	13.3	13.8	14.3	13.9	14.2	14.7	15.2	14.8	15.1	15.6	16.2	15.6	16.0	16.5	17.2																				
1575	HiPR	220	237	250	261	247	266	281	293	281	303	320	333	320	345	364	380	360	388	410	427	398	428	452	472																					
	LoPR	106	113	123	131	112	119	130	139	116	124	135	144	122	130	142	151	128	136	149	158	133	141	154	164																					
	MBh	41.6	42.5	45.4	48.5	40.6	41.5	44.3	47.4	39.6	40.5	43.3	46.3	38.7	39.5	42.2	45.1	36.7	37.6	40.1	42.9	34.0	34.8	37.2	39.7																					
	S/T	0.93	0.87	0.71	0.53	0.96	0.90	0.74	0.55	1.00	0.93	0.75	0.56	1.00	0.96	0.78	0.58	1.00	1.00	0.81	0.60	1.00	1.00	0.82	0.61																					
	ΔT	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	23	22	19	15	20	20	18	14																					
	kW	2.91	2.96	3.05	3.14	3.11	3.18	3.27	3.37	3.30	3.36	3.47	3.58	3.46	3.53	3.64	3.75	3.60	3.67	3.79	3.91	3.71	3.79	3.91	4.04																					
85	1225	Amps	11.2	11.5	11.9	12.3	12.1	12.4	12.8	13.3	13.1	13.5	13.9	14.4	14.0	14.4	14.8	15.4	14.9	15.3	15.8	16.4	15.8	16.2	16.7	17.3																				
		HiPR	223	240	253	264	250	269	284	296	284	306	323	337	324	348	368	383	364	392	414	431	402	433	457	477																				
		LoPR	104	110	121	128	110	117	127	136	114	121	132	141	120	127	139	148	126	134	146	155	130	138	151	161																				
		MBh	41.1	41.9	43.9	46.8	40.1	40.9	42.8	45.7	39.2	39.9	41.8	44.6	38.2	39.0	40.8	43.5	36.3	37.0	38.8	41.3	33.6	34.3	35.9	38.3																				
		S/T	0.93	0.90	0.81	0.66	0.96	0.93	0.84	0.68	0.99	0.95	0.86	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.75	1.00	1.00	0.93	0.75																				
		ΔT	25	25	23	20	25	25	24	20	25	25	24	20	25	25	24	20	25	24	23	20	22	23	22	19																				
	1400	kW	2.91	2.96	3.05	3.14	3.11	3.18	3.27	3.37	3.30	3.36	3.47	3.58	3.46	3.53	3.64	3.75	3.60	3.67	3.79	3.91	3.71	3.79	3.91	4.04																				
		Amps	11.2	11.5	11.9	12.3	12.1	12.4	12.8	13.3	13.1	13.5	13.9	14.4	14.0	14.4	14.8	15.4	14.9	15.3	15.8	16.4	15.8	16.2	16.7	17.3																				
		HiPR	223	240	253	264	250	269	284	296	284	306	323	337	324	348	368	383	364	392	414	431	402	433	457	477																				
		LoPR	107	114	124	132	113	120	131	140	118	125	137	145	123	131	143	153	129	138	150	160	134	142	155	166																				
		MBh	42.3	43.1	45.2	48.2	41.3	42.1	44.1	47.1	40.3	41.1	43.1	45.9	39.4	40.1	42.0	44.8	37.4	38.1	39.9	42.6	34.6	35.3	37.0	39.4																				
		S/T	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.78	1.00	1.00	0.98	0.79																				
1575	ΔT	24	24	22	19	24	24	24	20	24	24	23	20	23	23	23	20	22	23	20	22	20	21	21	18																					
	kW	2.93	2.99	3.07	3.17	3.14	3.20	3.30	3.40	3.32	3.39	3.49	3.60	3.49	3.56	3.67	3.78	3.62	3.70	3.82	3.94	3.74	3.82	3.94	4.07																					
	Amps	11.3	11.6	12.0	12.4	12.2	12.5	12.9	13.4	13.3	13.6	14.0	14.5	14.2	14.5	15.0	15.5	15.0	15.4	15.9	16.5	15.9	16.3	16.9	17.5																					
	HiPR	225	242	255	266	252	271	287	299	287	309	326	340	327	352	371	387	368	396	418	436	406	437	462	481																					
	LoPR	108	115	126	134	114	122	133	141	119	126	138	147	125	133	145	154	131	139	152	162	135	144	157	167																					
	S/T	1.00	0.98	0.94	0.85	0.69	1.00	0.98	0.88	0.71	1.00	1.00	0.90	0.73	1.00	1.00	0.93	0.76	1.00	1.00	0.97	0.78	1.00	1.00	0.98	0.79																				

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130481B/C

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	1400	MBh	40.4	41.9	45.9	-	39.5	40.9	44.8	-	38.5	39.9	43.7	-	37.6	38.9	42.7	-	35.7	37.0	40.5	-	33.1	34.3	37.5	-	
		S/T	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.81	0.68	0.47	-	
		ΔT	19	16	12	-	19	16	12	-	19	16	13	-	19	17	13	-	19	16	12	-	18	15	12	-	
	1600	kW	3.17	3.23	3.32	-	3.39	3.46	3.56	-	3.59	3.66	3.77	-	3.77	3.84	3.96	-	3.91	4.00	4.12	-	4.04	4.13	4.26	-	
		Amps	11.6	11.9	12.3	-	12.6	12.9	13.3	-	13.7	14.0	14.5	-	14.6	15.0	15.5	-	15.5	15.9	16.5	-	16.5	16.9	17.4	-	
		Hi PR	215	231	244	-	241	259	274	-	274	295	311	-	312	336	354	-	351	377	399	-	388	417	440	-	
	1800	Lo PR	104	111	121	-	110	117	128	-	115	122	133	-	120	128	140	-	126	134	146	-	130	139	151	-	
		MBh	43.8	45.4	49.7	-	42.7	44.3	48.5	-	41.7	43.2	47.4	-	40.7	42.2	46.2	-	38.7	40.1	43.9	-	35.8	37.1	40.7	-	
		S/T	0.73	0.61	0.43	-	0.76	0.64	0.44	-	0.78	0.65	0.45	-	0.81	0.67	0.47	-	0.84	0.70	0.48	-	0.84	0.70	0.49	-	
	75	1400	ΔT	18	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	17	15	11	-
			kW	3.24	3.30	3.40	-	3.47	3.54	3.65	-	3.67	3.75	3.87	-	3.86	3.94	4.06	-	4.01	4.09	4.22	-	4.14	4.23	4.36	-
			Amps	12.0	12.3	12.7	-	12.9	13.2	13.7	-	14.1	14.4	14.9	-	15.0	15.4	15.9	-	16.0	16.4	16.9	-	16.9	17.4	17.9	-
1600		Hi PR	221	238	251	-	248	267	282	-	282	304	321	-	321	346	365	-	362	389	411	-	400	430	454	-	
		Lo PR	108	114	125	-	114	121	132	-	118	126	137	-	124	132	144	-	130	138	151	-	134	143	156	-	
		MBh	45.1	46.7	51.2	-	44.0	45.6	50.0	-	43.0	44.5	48.8	-	41.9	43.5	47.6	-	39.8	41.3	45.2	-	36.9	38.2	41.9	-	
1800		S/T	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.82	0.68	0.47	-	0.85	0.71	0.49	-	0.88	0.73	0.51	-	0.88	0.74	0.51	-	
		ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	15	12	-	17	14	11	-	
		kW	3.26	3.33	3.42	-	3.50	3.57	3.67	-	3.70	3.78	3.90	-	3.89	3.97	4.09	-	4.04	4.13	4.26	-	4.18	4.26	4.40	-	
70		Amps	12.1	12.4	12.8	-	13.0	13.4	13.8	-	14.2	14.5	15.0	-	15.2	15.5	16.0	-	16.1	16.5	17.1	-	17.1	17.5	18.1	-	
		Hi PR	223	240	254	-	251	270	285	-	285	307	324	-	325	349	369	-	365	393	415	-	404	434	459	-	
		Lo PR	109	116	126	-	115	122	133	-	119	127	139	-	125	133	146	-	131	140	152	-	136	144	158	-	

75	1400	MBh	41.1	42.3	45.8	49.1	40.1	41.3	44.7	48.0	39.2	40.3	43.7	46.8	38.2	39.3	42.6	45.7	36.3	37.4	40.5	43.4	33.6	34.6	37.5	40.2	
		S/T	0.81	0.72	0.55	0.35	0.83	0.75	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.60	0.38	0.92	0.82	0.62	0.40	0.92	0.83	0.63	0.40	
		ΔT	22	20	16	11	22	20	17	11	22	20	17	11	22	20	17	12	22	20	16	11	20	19	15	11	
	1600	kW	3.19	3.25	3.35	3.45	3.42	3.49	3.59	3.70	3.62	3.69	3.80	3.92	3.79	3.87	3.99	4.12	3.95	4.03	4.15	4.29	4.08	4.16	4.29	4.43	
		Amps	11.7	12.0	12.4	12.9	12.7	13.0	13.4	13.9	13.8	14.1	14.6	15.1	14.7	15.1	15.6	16.2	15.7	16.1	16.6	17.2	16.6	17.0	17.6	18.3	
		Hi PR	217	233	246	257	243	262	276	288	277	298	314	328	315	339	358	373	354	381	403	420	391	421	445	464	
	75	Lo PR	105	112	122	130	111	118	129	138	116	123	134	143	122	129	141	150	127	136	148	158	132	140	153	163	
		MBh	44.5	45.8	49.6	53.2	43.5	44.8	48.4	52.0	42.4	43.7	47.3	50.8	41.4	42.6	46.1	49.5	39.3	40.5	43.8	47.0	36.4	37.5	40.6	43.6	
		S/T	0.84	0.75	0.57	0.36	0.87	0.77	0.59	0.38	0.89	0.79	0.60	0.39	0.92	0.82	0.62	0.40	0.95	0.85	0.64	0.41	0.96	0.86	0.65	0.42	
	75	1400	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	22	20	16	11	20	18	15	10
			kW	3.26	3.33	3.42	3.53	3.50	3.57	3.68	3.79	3.70	3.78	3.90	4.02	3.89	3.97	4.09	4.22	4.04	4.13	4.26	4.39	4.18	4.26	4.40	4.54
			Amps	12.1	12.4	12.8	13.2	13.1	13.4	13.8	14.3	14.2	14.5	15.0	15.6	15.2	15.5	16.1	16.7	16.1	16.5	17.1	17.7	17.1	17.5	18.1	18.8
1600		Hi PR	223	240	254	265	251	270	285	297	285	307	324	338	325	349	369	385	365	393	415	433	404	434	459	478	
		Lo PR	109	116	126	134	115	122	133	142	119	127	139	148	125	133	146	155	131	140	153	162	136	145	158	168	
		MBh	45.8	47.2	51.1	54.8	44.8	46.1	49.9	53.6	43.7	45.0	48.7	52.3	42.6	43.9	47.5	51.0	40.5	41.7	45.1	48.5	37.5	38.6	41.8	44.9	
75		S/T	0.88	0.78	0.59	0.38	0.91	0.81	0.61	0.40	0.93	0.83	0.63	0.41	0.96	0.86	0.65	0.42	1.00	0.89	0.67	0.43	1.00	0.90	0.68	0.44	
		ΔT	21	19	15	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10	
		kW	3.29	3.35	3.45	3.55	3.52	3.59	3.70	3.82	3.73	3.81	3.93	4.05	3.92	4.00	4.12	4.26	4.07	4.16	4.29	4.43	4.21	4.30	4.44	4.58	
70		Amps	12.2	12.5	12.9	13.4	13.2	13.5	13.9	14.5	14.3	14.7	15.1	15.7	15.3	15.7	16.2	16.8	16.3	16.7	17.2	17.9	17.3	17.7	18.3	19.0	
		Hi PR	226	243	256	267	253	272	288	300	288	310	327	341	328	353	373	389	369	397	419	437	408	439	463	483	
		Lo PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130481B/C (CONT.)

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
80	1400	MBh	41.8	42.7	45.6	48.8	40.8	41.7	44.6	47.7	39.9	40.7	43.5	46.5	38.9	39.7	42.5	45.4	36.9	37.8	40.3	43.1	34.2	35.0	37.4	39.9	
		S/T	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.94	0.88	0.72	0.54	0.97	0.91	0.74	0.55	1.01	0.94	0.77	0.57	1.01	0.95	0.77	0.58	
		ΔT	24	23	20	16	25	24	20	16	25	24	20	16	25	24	21	16	24	23	20	16	23	22	19	15	
	1600	kW	3.21	3.28	3.37	3.47	3.44	3.51	3.62	3.73	3.65	3.72	3.83	3.95	3.82	3.90	4.03	4.15	3.98	4.06	4.19	4.32	4.11	4.20	4.33	4.47	
		Amps	11.9	12.1	12.5	13.0	12.8	13.1	13.6	14.1	13.9	14.3	14.7	15.3	14.9	15.2	15.8	16.3	15.8	16.2	16.8	17.4	16.8	17.2	17.8	18.5	
		Hi PR	219	236	249	259	246	264	279	291	279	301	317	331	318	342	362	377	358	385	407	424	395	426	449	469	
	1800	Lo PR	106	113	124	132	112	120	131	139	117	124	136	145	123	131	143	152	129	137	149	159	133	142	155	165	
		MBh	45.3	46.3	49.5	52.9	44.2	45.2	48.3	51.6	43.2	44.1	47.2	50.4	42.1	43.1	46.0	49.2	40.0	40.9	43.7	46.7	37.1	37.9	40.5	43.3	
		S/T	0.92	0.86	0.70	0.52	0.95	0.89	0.72	0.54	0.97	0.91	0.74	0.56	1.00	0.94	0.77	0.57	1.00	0.98	0.80	0.60	1.00	0.99	0.80	0.60	
	85	1400	ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	23	22	19	15	21	21	19	15
			kW	3.29	3.35	3.45	3.56	3.52	3.59	3.70	3.82	3.73	3.81	3.93	4.05	3.92	4.00	4.12	4.26	4.07	4.16	4.29	4.43	4.21	4.30	4.44	4.58
			Amps	12.2	12.5	12.9	13.4	13.2	13.5	13.9	14.5	14.3	14.7	15.2	15.7	15.3	15.7	16.2	16.8	16.3	16.7	17.3	17.9	17.3	17.7	18.3	19.0
1600		Hi PR	226	243	256	267	253	272	288	300	288	310	327	341	328	353	373	389	369	397	419	437	408	439	463	483	
		Lo PR	110	117	127	136	116	123	135	143	120	128	140	149	127	135	147	157	133	141	154	164	137	146	159	170	
		MBh	46.7	47.7	50.9	54.4	45.6	46.6	49.7	53.2	44.5	45.5	48.6	51.9	43.4	44.3	47.4	50.6	41.2	42.1	45.0	48.1	38.2	39.0	41.7	44.6	
1800		S/T	0.96	0.90	0.73	0.55	1.00	0.93	0.76	0.57	1.00	0.96	0.78	0.58	1.00	1.00	0.80	0.60	1.00	1.00	0.83	0.62	1.00	1.00	0.84	0.63	
		ΔT	23	22	19	15	23	22	19	15	22	22	19	15	22	23	19	16	21	21	19	15	20	20	18	14	
		kW	3.31	3.38	3.48	3.58	3.55	3.62	3.73	3.85	3.76	3.84	3.96	4.08	3.95	4.03	4.16	4.29	4.11	4.19	4.33	4.47	4.24	4.33	4.47	4.62	
1400		Amps	12.3	12.6	13.0	13.5	13.3	13.6	14.1	14.6	14.4	14.8	15.3	15.9	15.4	15.8	16.4	17.0	16.4	16.8	17.4	18.1	17.4	17.9	18.5	19.2	
		Hi PR	228	245	259	270	256	275	291	303	291	313	331	345	331	356	376	393	373	401	423	442	412	443	468	488	
		Lo PR	111	118	129	137	117	125	136	145	122	129	141	151	128	136	148	158	134	143	156	166	139	147	161	171	
1600	MBh	46.1	47.0	49.2	52.5	45.0	45.9	48.1	51.3	43.9	44.8	46.9	50.1	42.9	43.7	45.8	48.8	40.7	41.5	43.5	46.4	37.7	38.5	40.3	43.0		
	S/T	0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	0.98	0.89	0.72	1.00	1.00	0.92	0.74	1.00	1.00	0.95	0.77	1.00	1.00	0.96	0.78		
	ΔT	25	25	24	20	26	25	24	21	25	25	24	21	25	25	24	21	23	24	24	21	22	22	22	19		
1800	kW	3.31	3.38	3.48	3.58	3.55	3.62	3.73	3.85	3.76	3.84	3.96	4.08	3.95	4.03	4.16	4.29	4.11	4.19	4.33	4.47	4.24	4.33	4.47	4.62		
	Amps	12.3	12.6	13.0	13.5	13.3	13.6	14.1	14.6	14.4	14.8	15.3	15.9	15.4	15.8	16.4	17.0	16.4	16.8	17.4	18.1	17.4	17.9	18.5	19.2		
	Hi PR	228	245	259	270	256	275	291	303	291	313	331	345	331	356	376	393	373	401	423	442	412	443	468	488		
1400	Lo PR	111	118	129	137	117	125	136	145	122	129	141	151	128	136	148	158	134	143	156	166	139	147	161	171		
	MBh	47.5	48.4	50.7	54.1	46.4	47.3	49.5	52.8	45.3	46.1	48.3	51.6	44.2	45.0	47.1	50.3	42.0	42.8	44.8	47.8	38.9	39.6	41.5	44.3		
	S/T	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.93	0.76	1.00	1.00	0.96	0.78	1.00	1.00	1.00	0.81	1.00	1.00	1.00	0.82		
1600	ΔT	24	24	23	20	24	24	23	20	23	24	23	20	23	23	23	20	23	23	23	20	20	20	21	18		
	kW	3.34	3.40	3.50	3.61	3.58	3.65	3.76	3.88	3.79	3.87	3.99	4.11	3.98	4.06	4.19	4.32	4.14	4.23	4.36	4.50	4.28	4.37	4.51	4.65		
	Amps	12.4	12.7	13.1	13.6	13.4	13.7	14.2	14.7	14.6	14.9	15.4	16.0	15.6	16.0	16.5	17.1	16.6	17.0	17.6	18.2	17.6	18.0	18.6	19.3		
1800	Hi PR	230	248	262	273	258	278	294	306	294	316	334	348	335	360	380	397	376	405	428	446	416	448	473	493		
	Lo PR	112	119	130	138	118	126	137	146	123	131	143	152	129	137	150	160	135	144	157	167	140	149	163	173		

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130601A\*

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	2025	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-	
		S/T	0.70	0.59	0.41	-	0.73	0.61	0.42	-	0.75	0.62	0.43	-	0.77	0.64	0.45	-	0.80	0.67	0.46	-	0.81	0.67	0.47	-	
		ΔT	18	15	12	-	18	16	12	-	18	16	12	-	18	16	12	-	18	16	12	-	17	15	11	-	
	1800	KW	4.08	4.16	4.29	-	4.38	4.47	4.61	-	4.64	4.74	4.89	-	4.88	4.98	5.14	-	5.07	5.18	5.35	-	5.25	5.36	5.53	-	
		Amps	14.6	14.9	15.4	-	15.8	16.1	16.7	-	17.1	17.6	18.1	-	18.3	18.8	19.4	-	19.5	20.0	20.7	-	20.7	21.2	21.9	-	
		Hi/PR	233	251	265	-	262	281	297	-	297	320	338	-	339	365	385	-	381	410	433	-	421	453	479	-	
	1575	LO PR	106	112	123	-	112	119	130	-	116	123	135	-	122	130	142	-	128	136	148	-	132	141	153	-	
		MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-	
		S/T	0.67	0.56	0.39	-	0.69	0.58	0.40	-	0.71	0.60	0.41	-	0.74	0.61	0.43	-	0.76	0.64	0.44	-	0.77	0.64	0.45	-	
	75	2025	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-	19	16	12	-
			KW	4.05	4.13	4.25	-	4.35	4.43	4.57	-	4.61	4.70	4.85	-	4.84	4.94	5.10	-	5.03	5.14	5.31	-	5.20	5.32	5.49	-
			Amps	14.4	14.8	15.3	-	15.6	16.0	16.5	-	17.0	17.4	18.0	-	18.2	18.6	19.2	-	19.3	19.8	20.5	-	20.5	21.0	21.7	-
1800		Hi/PR	231	248	262	-	259	279	294	-	295	317	335	-	335	361	381	-	377	406	429	-	417	449	474	-	
		LO PR	105	111	122	-	111	118	128	-	115	122	133	-	121	128	140	-	126	135	147	-	131	139	152	-	
		MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.6	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
1575		S/T	0.65	0.54	0.37	-	0.67	0.56	0.39	-	0.69	0.57	0.40	-	0.71	0.59	0.41	-	0.74	0.61	0.43	-	0.74	0.62	0.43	-	
		ΔT	19	16	12	-	19	17	13	-	19	17	13	-	19	17	13	-	19	16	12	-	18	15	12	-	
		KW	3.96	4.04	4.16	-	4.24	4.33	4.46	-	4.50	4.59	4.73	-	4.72	4.82	4.97	-	4.91	5.02	5.18	-	5.08	5.19	5.35	-	
75		2025	Amps	14.0	14.4	14.9	-	15.2	15.6	16.1	-	16.5	16.9	17.5	-	17.7	18.1	18.7	-	18.8	19.3	19.9	-	19.9	20.4	21.1	-
			Hi/PR	224	241	254	-	251	270	285	-	286	307	325	-	325	350	370	-	366	394	416	-	404	435	460	-
			LO PR	101	108	118	-	107	114	125	-	111	119	129	-	117	125	136	-	123	130	142	-	127	135	147	-
75	2025	MBh	56.8	58.5	63.3	67.9	55.5	57.1	61.8	66.4	54.2	55.8	60.4	64.8	52.8	54.4	58.9	63.2	50.2	51.7	55.9	60.0	46.5	47.9	51.8	55.6	
		S/T	0.80	0.71	0.54	0.35	0.83	0.74	0.56	0.36	0.85	0.76	0.57	0.37	0.88	0.78	0.59	0.38	0.91	0.81	0.62	0.40	0.92	0.82	0.62	0.40	
		ΔT	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	21	19	16	11	19	18	15	10	
	1800	KW	4.11	4.19	4.32	4.45	4.41	4.50	4.64	4.79	4.68	4.78	4.93	5.09	4.92	5.02	5.18	5.35	5.12	5.23	5.39	5.57	5.29	5.40	5.58	5.76	
		Amps	14.7	15.1	15.6	16.1	15.9	16.3	16.8	17.5	17.3	17.7	18.3	19.0	18.5	19.0	19.6	20.3	19.7	20.2	20.9	21.7	20.9	21.4	22.1	23.0	
		Hi/PR	235	253	268	279	264	284	300	313	301	323	342	356	342	368	389	406	385	414	438	456	425	458	483	504	
	1575	LO PR	107	114	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	
		MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0	
		S/T	0.76	0.68	0.52	0.33	0.79	0.71	0.53	0.34	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.87	0.78	0.59	0.38	0.88	0.78	0.59	0.38	
	75	2025	ΔT	21	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	20	19	15	11
			KW	4.08	4.16	4.29	4.42	4.38	4.47	4.61	4.75	4.64	4.74	4.89	5.05	4.88	4.98	5.14	5.30	5.07	5.18	5.35	5.52	5.25	5.36	5.53	5.71
			Amps	14.6	14.9	15.4	16.0	15.8	16.1	16.7	17.3	17.1	17.6	18.1	18.8	18.3	18.8	19.4	20.2	19.5	20.0	20.7	21.5	20.7	21.2	21.9	22.8
1800		Hi/PR	233	251	265	276	262	282	297	310	298	320	338	353	339	365	385	402	381	410	433	452	421	453	479	499	
		LO PR	106	112	123	131	112	119	130	138	116	123	135	144	122	130	142	151	128	136	148	158	132	141	153	163	
		MBh	50.9	52.4	56.7	60.9	49.7	51.2	55.4	59.5	48.5	50.0	54.1	58.1	47.3	48.8	52.8	56.6	45.0	46.3	50.1	53.8	41.7	42.9	46.4	49.8	
1575		S/T	0.73	0.66	0.50	0.32	0.76	0.68	0.52	0.33	0.78	0.70	0.53	0.34	0.81	0.72	0.55	0.35	0.84	0.75	0.57	0.36	0.84	0.75	0.57	0.37	
		ΔT	22	20	16	11	22	20	17	12	22	20	17	12	22	21	17	12	22	20	17	11	21	19	15	11	
		KW	3.99	4.07	4.19	4.32	4.28	4.37	4.50	4.64	4.53	4.63	4.77	4.92	4.76	4.86	5.01	5.17	4.95	5.06	5.22	5.39	5.12	5.23	5.40	5.57	
75		2025	Amps	14.2	14.5	15.0	15.6	15.3	15.7	16.2	16.8	16.7	17.1	17.6	18.3	17.8	18.3	18.9	19.6	19.0	19.4	20.1	20.9	20.1	20.6	21.3	22.1
			Hi/PR	226	243	257	268	254	273	288	301	289	311	328	342	329	354	374	390	370	398	420	438	409	440	464	484
			LO PR	103	109	119	127	108	115	126	134	113	120	131	139	118	126	137	146	124	132	144	153	128	136	149	159

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 Amps = outdoor unit amps (comp.+fan)  
 kW = Total system power

EXPANDED COOLING DATA — ASX130601A\* (CONT.)

IDB	Airflow	Outdoor Ambient Temperature																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	2025	MBh	57.8	59.1	63.1	67.5	56.5	57.7	61.6	65.9	55.1	56.3	60.2	64.3	53.8	55.0	58.7	62.8	51.1	52.2	55.8	59.6	47.3	48.4	51.7	55.2
		S/T	0.88	0.82	0.67	0.50	0.91	0.85	0.69	0.52	0.93	0.87	0.71	0.53	0.96	0.90	0.73	0.55	1.00	0.94	0.76	0.57	1.00	0.94	0.77	0.57
		ΔT	23	22	19	15	23	22	19	16	23	22	19	16	23	22	20	16	23	22	19	15	21	21	18	14
		kW	4.14	4.23	4.35	4.49	4.45	4.54	4.68	4.83	4.72	4.82	4.97	5.13	4.96	5.06	5.22	5.39	5.16	5.27	5.44	5.62	5.33	5.45	5.62	5.81
		Amps	14.8	15.2	15.7	16.3	16.1	16.4	17.0	17.6	17.5	17.9	18.5	19.2	18.7	19.1	19.8	20.5	19.9	20.4	21.1	21.9	21.1	21.6	22.4	23.2
		HI PR	238	256	270	282	267	287	303	316	304	327	345	360	346	372	393	410	389	419	442	461	430	462	488	509
	1800	LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167
		MBh	56.1	57.4	61.3	65.5	54.8	56.0	59.9	64.0	53.5	54.7	58.4	62.5	52.2	53.4	57.0	60.9	49.6	50.7	54.2	57.9	45.9	46.9	50.2	53.6
		S/T	0.84	0.78	0.64	0.48	0.87	0.81	0.66	0.49	0.89	0.83	0.68	0.51	0.92	0.86	0.70	0.52	0.95	0.89	0.73	0.54	0.96	0.90	0.73	0.55
		ΔT	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	24	23	20	16	23	22	19	15
		kW	4.11	4.19	4.32	4.45	4.41	4.50	4.64	4.79	4.68	4.78	4.93	5.09	4.92	5.02	5.18	5.35	5.12	5.23	5.39	5.57	5.29	5.40	5.58	5.76
		Amps	14.7	15.1	15.6	16.1	15.9	16.3	16.8	17.5	17.3	17.7	18.3	19.0	18.5	19.0	19.6	20.4	19.7	20.2	20.9	21.7	20.9	21.4	22.1	23.0
1575	HI PR	236	253	268	279	264	284	300	313	301	323	342	356	342	368	389	406	385	414	438	456	426	458	484	504	
	LO PR	107	114	124	132	113	120	131	140	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165	
	MBh	51.8	52.9	56.6	60.5	50.6	51.7	55.2	59.1	49.4	50.5	53.9	57.6	48.2	49.2	52.6	56.2	45.8	46.8	50.0	53.4	42.4	43.3	46.3	49.5	
	S/T	0.81	0.76	0.62	0.46	0.84	0.78	0.64	0.48	0.86	0.80	0.65	0.49	0.88	0.83	0.67	0.50	0.92	0.86	0.70	0.52	0.93	0.87	0.71	0.53	
	ΔT	24	23	20	16	25	24	21	16	25	24	21	16	25	24	21	17	25	24	20	16	23	22	19	15	
	kW	4.02	4.10	4.22	4.35	4.31	4.40	4.53	4.68	4.57	4.67	4.81	4.96	4.80	4.90	5.05	5.22	4.99	5.10	5.26	5.43	5.16	5.27	5.44	5.62	
85	Amps	14.3	14.6	15.1	15.7	15.5	15.8	16.4	17.0	16.8	17.2	17.8	18.5	18.0	18.4	19.1	19.8	19.2	19.6	20.3	21.1	20.3	20.8	21.5	22.3	
	HI PR	228	246	260	271	256	276	291	304	292	314	331	346	332	357	377	394	374	402	424	443	413	444	469	489	
	LO PR	104	110	120	128	109	116	127	135	114	121	132	141	119	127	139	148	125	133	145	155	129	138	150	160	
	MBh	58.8	60.0	62.8	67.0	57.5	58.6	61.3	65.4	56.1	57.2	59.9	63.9	54.7	55.8	58.4	62.3	52.0	53.0	55.5	59.2	48.2	49.1	51.4	54.8	
	S/T	0.92	0.89	0.80	0.65	0.95	0.92	0.83	0.67	0.98	0.94	0.85	0.69	1.00	0.97	0.88	0.71	1.00	1.00	0.91	0.74	1.00	1.00	0.92	0.75	
	ΔT	25	24	23	20	25	24	23	20	25	24	23	20	25	25	23	20	24	24	23	20	22	22	21	19	
2025	kW	4.17	4.26	4.39	4.52	4.48	4.58	4.72	4.87	4.75	4.86	5.01	5.17	4.99	5.10	5.26	5.44	5.20	5.31	5.48	5.66	5.38	5.49	5.67	5.86	
	Amps	15.0	15.3	15.8	16.4	16.2	16.6	17.1	17.8	17.6	18.1	18.7	19.4	18.8	19.3	20.0	20.7	20.1	20.6	21.3	22.1	21.3	21.8	22.6	23.4	
	HI PR	240	259	273	285	270	290	306	320	307	330	348	363	349	376	397	414	393	423	446	466	434	467	493	514	
	LO PR	109	116	126	135	115	122	134	142	120	127	139	148	126	134	146	155	132	140	153	163	136	145	158	168	
	MBh	57.1	58.2	61.0	65.0	55.8	56.9	59.6	63.5	54.5	55.5	58.1	62.0	53.1	54.2	56.7	60.5	50.5	51.4	53.9	57.5	46.7	47.7	49.9	53.2	
	S/T	0.88	0.85	0.76	0.62	0.91	0.88	0.79	0.64	0.93	0.90	0.81	0.66	0.96	0.93	0.84	0.68	1.00	0.96	0.87	0.70	1.00	0.97	0.88	0.71	
1800	ΔT	26	25	24	21	26	25	24	21	26	25	24	21	26	26	24	21	26	25	24	21	24	24	22	19	
	kW	4.14	4.23	4.35	4.49	4.45	4.54	4.68	4.83	4.72	4.82	4.97	5.13	4.96	5.06	5.22	5.39	5.16	5.27	5.44	5.62	5.33	5.45	5.62	5.81	
	Amps	14.8	15.2	15.7	16.3	16.1	16.4	17.0	17.6	17.5	17.9	18.5	19.2	18.7	19.1	19.8	20.5	19.9	20.4	21.1	21.9	21.1	21.6	22.4	23.2	
	HI PR	238	256	270	282	267	287	303	316	304	327	345	360	346	372	393	410	389	419	442	461	430	462	488	509	
	LO PR	108	115	125	133	114	121	132	141	118	126	137	146	124	132	144	154	130	139	151	161	135	143	157	167	
	MBh	52.7	53.7	56.3	60.0	51.5	52.5	55.0	58.6	50.3	51.2	53.7	57.2	49.0	50.0	52.3	55.8	46.6	47.5	49.7	53.1	43.1	44.0	46.1	49.1	
1575	S/T	0.85	0.82	0.74	0.60	0.88	0.85	0.76	0.62	0.90	0.87	0.78	0.63	0.93	0.89	0.81	0.65	0.96	0.93	0.84	0.68	0.97	0.94	0.84	0.69	
	ΔT	26	26	24	21	26	26	24	21	26	26	24	21	27	26	25	21	26	26	24	21	24	24	23	20	
	kW	4.05	4.13	4.25	4.38	4.34	4.43	4.57	4.71	4.61	4.70	4.85	5.00	4.84	4.94	5.09	5.26	5.03	5.14	5.30	5.48	5.20	5.31	5.48	5.66	
	Amps	14.4	14.8	15.3	15.8	15.6	16.0	16.5	17.1	17.0	17.4	18.0	18.7	18.2	18.6	19.2	20.0	19.3	19.8	20.5	21.3	20.5	21.0	21.7	22.6	
	HI PR	231	248	262	273	259	279	294	307	294	317	335	349	335	361	381	397	377	406	429	447	417	449	474	494	
	LO PR	105	111	121	129	110	118	128	137	115	122	133	142	121	128	140	149	126	134	147	156	131	139	152	162	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 Amps = outdoor unit amps (comp.-fan)  
 kW = Total system power

# EXPANDED COOLING DATA — ASX130601B/C

IDB	Airflow	Outdoor Ambient Temperature																									
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
70	1500	MBh	50.1	51.9	56.8	-	48.9	50.7	55.5	-	47.7	49.5	54.2	-	46.6	48.3	52.9	-	44.2	45.8	50.2	-	41.0	42.5	46.5	-	
		S/T	0.67	0.56	0.39	-	0.69	0.58	0.40	-	0.71	0.59	0.41	-	0.73	0.61	0.42	-	0.76	0.64	0.44	-	0.77	0.64	0.44	-	
	1750	ΔT	21	18	13	-	21	18	14	-	21	18	14	-	21	18	14	-	21	18	14	-	19	17	13	-	
		kW	3.87	3.95	4.07	-	4.16	4.24	4.38	-	4.41	4.50	4.65	-	4.63	4.73	4.89	-	4.82	4.93	5.09	-	4.99	5.10	5.26	-	
	2000	Amps	14.4	14.8	15.3	-	15.6	16.0	16.5	-	17.0	17.4	18.0	-	18.2	18.6	19.2	-	19.3	19.8	20.5	-	20.5	21.0	21.7	-	
		HI PR	229	246	260	-	257	276	292	-	292	314	332	-	333	358	378	-	374	403	425	-	413	445	470	-	
	75	1500	LO PR	101	108	118	-	107	114	125	-	111	119	129	-	117	125	136	-	123	130	142	-	127	135	147	-
			MBh	54.2	56.2	61.6	-	53.0	54.9	60.1	-	51.7	53.6	58.7	-	50.4	52.3	57.3	-	47.9	49.7	54.4	-	44.4	46.0	50.4	-
		1750	S/T	0.69	0.58	0.40	-	0.72	0.60	0.42	-	0.74	0.62	0.43	-	0.76	0.64	0.44	-	0.79	0.66	0.46	-	0.80	0.66	0.46	-
			ΔT	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	20	17	13	-	19	16	12	-
		2000	kW	3.96	4.04	4.17	-	4.26	4.35	4.48	-	4.52	4.62	4.76	-	4.75	4.85	5.01	-	4.95	5.05	5.22	-	5.12	5.23	5.40	-
			Amps	14.8	15.2	15.7	-	16.1	16.4	17.0	-	17.5	17.9	18.5	-	18.7	19.1	19.8	-	19.9	20.4	21.1	-	21.1	21.6	22.4	-
75		1500	HI PR	236	254	268	-	265	285	301	-	301	324	342	-	343	369	390	-	386	415	438	-	426	459	484	-
			LO PR	105	111	122	-	111	118	128	-	115	122	133	-	121	128	140	-	126	135	147	-	131	139	152	-
		1750	MBh	55.9	57.9	63.4	-	54.6	56.5	62.0	-	53.3	55.2	60.5	-	52.0	53.9	59.0	-	49.4	51.2	56.1	-	45.7	47.4	51.9	-
			S/T	0.73	0.61	0.42	-	0.75	0.63	0.44	-	0.77	0.65	0.45	-	0.80	0.67	0.46	-	0.83	0.69	0.48	-	0.83	0.70	0.48	-
		2000	ΔT	19	16	12	-	19	16	12	-	19	16	12	-	19	16	13	-	19	16	12	-	18	15	12	-
			kW	3.99	4.07	4.20	-	4.29	4.38	4.52	-	4.56	4.65	4.80	-	4.79	4.89	5.05	-	4.99	5.10	5.26	-	5.16	5.27	5.44	-
	75	1500	Amps	15.0	15.3	15.8	-	16.2	16.6	17.2	-	17.6	18.1	18.7	-	18.9	19.3	20.0	-	20.1	20.6	21.3	-	21.3	21.8	22.6	-
			HI PR	231	249	263	274	259	279	295	307	295	317	335	350	336	362	382	398	378	407	430	448	418	449	475	495
		1750	LO PR	103	109	119	127	108	115	126	134	113	120	131	139	118	126	137	146	124	132	144	153	128	136	149	159
			MBh	55.1	56.8	61.5	66.0	53.9	55.5	60.0	64.4	52.6	54.1	58.6	62.9	51.3	52.8	57.2	61.4	48.7	50.2	54.3	58.3	45.1	46.5	50.3	54.0
		2000	S/T	0.79	0.71	0.53	0.34	0.82	0.73	0.55	0.36	0.84	0.75	0.57	0.36	0.86	0.77	0.59	0.38	0.90	0.80	0.61	0.39	0.91	0.81	0.61	0.39
			ΔT	23	21	17	12	23	21	17	12	23	21	17	12	23	21	18	12	23	21	17	12	21	20	16	11
75		1500	kW	3.99	4.07	4.20	4.33	4.29	4.38	4.52	4.66	4.56	4.65	4.80	4.96	4.79	4.89	5.05	5.22	4.99	5.10	5.26	5.44	5.16	5.27	5.44	5.63
			Amps	15.0	15.3	15.8	16.4	16.2	16.6	17.2	17.8	17.6	18.1	18.7	19.4	18.9	19.3	20.0	20.8	20.1	20.6	21.3	22.1	21.3	21.8	22.6	23.5
		1750	HI PR	238	256	271	282	267	288	304	317	304	327	346	360	346	373	394	411	390	419	443	462	431	463	489	510
			LO PR	106	112	123	131	112	119	130	138	116	123	135	144	122	130	142	151	128	136	148	158	132	141	153	163
		2000	MBh	56.8	58.5	63.3	67.9	55.5	57.1	61.8	66.4	54.2	55.8	60.4	64.8	52.8	54.4	58.9	63.2	50.2	51.7	55.9	60.0	46.5	47.9	51.8	55.6
			S/T	0.83	0.74	0.56	0.36	0.86	0.77	0.58	0.37	0.88	0.79	0.59	0.38	0.91	0.81	0.61	0.39	0.94	0.84	0.64	0.41	0.95	0.85	0.64	0.41
	75	1500	ΔT	22	20	16	11	22	20	16	11	22	20	16	11	22	20	17	11	22	20	16	11	20	19	15	11
			kW	4.02	4.11	4.23	4.37	4.33	4.42	4.56	4.70	4.59	4.69	4.84	5.00	4.83	4.93	5.09	5.26	5.03	5.14	5.31	5.48	5.20	5.32	5.49	5.67
		1750	Amps	15.1	15.5	16.0	16.6	16.4	16.8	17.3	18.0	17.8	18.2	18.8	19.6	19.0	19.5	20.2	20.9	20.3	20.8	21.5	22.3	21.5	22.0	22.8	23.7
			HI PR	241	259	274	285	270	291	307	320	307	331	349	364	350	376	398	415	394	424	447	466	435	468	494	515
		2000	LO PR	107	114	124	132	113	120	131	139	117	125	136	145	123	131	143	152	129	137	150	160	133	142	155	165

kW = Total system power

Amps = outdoor unit amps (comp.+fan)

Shaded area reflects ACCA (TVA) conditions

IDB: Entering Indoor Dry Bulb Temperature  
High and low pressures are measured at the liquid and suction service valves.



# AHRI RATINGS

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181B*	ADPF182416B*		18,000	13,000	13.0	11.0	3539994
	AEPF183016C*		18,000	13,000	14.0	11.6	3539995
	AR*F182416B*		18,000	13,000	13.0	11.0	3539996
	ASPF183016B*		19,000	13,700	14.0	12.2	3539997
	AT*F182416A*		18,000	13,000	13.0	11.0	3539998
	AWUF18XX16A*		17,400	12,500	13.0	11.0	3539999
	AWUF18XX16B*		17,400	12,500	13.0	11.0	3570274
	AWUF31XX16A*		17,400	12,500	14.0	11.5	3629347
	CA*F1824*6B*	A*V90453B**	18,000	13,000	14.0	11.6	3540000
	CA*F1824*6B*	A*V80704B**	18,000	13,000	14.0	11.6	3540001
	CA*F1824*6B*	A*VC950453BXA*	18,000	13,000	14.0	11.6	3596375
	CA*F1824*6B*	A*VC80704BXA*	18,000	13,000	14.0	11.6	3629781
	CA*F1824*6B*+EEP		18,000	13,000	13.0	11.0	3539969
	CA*F1824*6C*	A*V80704B**	18,000	13,000	14.0	11.6	3620197
	CA*F1824*6C*	A*V90453B**	18,000	13,000	14.0	11.6	3620198
	CA*F1824*6C*	A*VC950453BXA*	18,000	13,000	14.0	11.6	3620199
	CA*F1824*6C*+EEP		18,000	13,000	13.0	11.0	3620195
	CHPF1824A6B*+EEP		18,000	13,000	13.0	11.0	3540002
	CHPF2430B6B*	A*V80704B**	18,400	13,200	14.0	11.6	3540004
	CHPF2430B6B*	A*V90453B**	18,400	13,200	14.0	11.6	3540005
	CHPF2430B6B*	A*VC950453BXA*	18,400	13,200	14.0	11.6	3596385
	CHPF2430B6B*+EEP		18,000	13,000	13.0	11.0	3540003
	CHPF2430B6B*	MBE1200**-1B*	18,400	13,200	14.0	11.6	3541587
	CSCF1824N6B*	A*V90453B**	18,000	13,000	14.0	11.6	3540006
	CSCF1824N6B*	A*V80704B**	18,000	13,000	14.0	11.6	3540007
	CSCF1824N6B*	A*VC950453BXA*	18,000	13,000	14.0	11.6	3596376
	CSCF1824N6B*	A*VC80704BXA*	18,000	13,000	14.0	11.6	3629782
	CSCF1824N6B*+EEP		18,000	13,000	13.0	11.0	3540008
	CT*F1824*6A*	A*V90453B**	18,000	13,000	14.0	11.6	3540009
	CT*F1824*6A*	A*V80704B**	18,000	13,000	14.0	11.6	3540010
	CT*F1824*6A*	A*VC950453BXA*	18,000	13,000	14.0	11.6	3596377
	CT*F1824*6A*	A*VC80704BXA*	18,000	13,000	14.0	11.6	3629783
CT*F1824*6A*+EEP		18,000	13,000	13.0	11.0	3540011	
CT*F1824*6A*	MBE1200**-1B*	18,400	13,200	14.0	11.6	3541588	
CT*F1824*6A*	MBVC1200**-1A*	18,400	13,200	14.0	11.6	3610284	
ASX13 0181C*	ADPF182416B*		18,000	13,000	13.0	9.8	3838968
	ADPF182416B*		23,000	16,600	13.0	11.0	3839003
	ADPF182416C*		18,000	13,000	13.0	9.8	3895989
	ADPF182416C*		23,000	16,600	13.0	11.0	3896005
	ADPF304216B*		28,400	20,400	13.0	11.0	3839048
	ADPF304216B*		35,000	25,200	13.0	11.0	3839103
	ADPF304216B*		40,000	28,800	13.0	11.1	3839166
	ADPF304216C*		28,400	20,400	13.0	11.0	3839049
	ADPF304216C*		35,000	25,200	13.0	11.0	3839104
	ADPF304216C*		40,000	28,800	13.0	11.1	3839167
	ADPF486016B*		46,000	33,100	13.0	11.2	3839200
	ADPF486016B*		57,000	41,000	13.0	11.1	3839234
	ADPF486016C*		46,000	33,100	13.0	11.2	4358395
	ADPF486016C*		46,000	33,100	13.0	11.2	4358399
	ADPF486016C*		57,000	41,000	13.0	11.1	4358403
	ADPF486016C*		57,000	41,000	13.0	11.1	4358407

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	AEPF183016C*		18,000	13,000	14.0	10.4	3838969
	AEPF183016C*		23,400	16,800	14.0	11.6	3839004
	AEPF183016C*		28,400	20,400	14.0	11.6	3839050
	AEPF313716A*		35,000	25,200	14.0	11.6	3839105
	AEPF426016C*		41,000	29,500	14.0	11.6	3839168
	AEPF426016C*		46,000	33,100	14.0	11.5	3839201
	AEPF426016C*		57,500	41,400	13.4	11.3	3839235
	AR*F182416B*		18,000	13,000	13.0	9.8	3838970
	AR*F182416B*		23,000	16,600	13.0	11.0	3839005
	AR*F182416B*+TXV		27,400	19,700	13.0	11.0	3839051
	AR*F182416C*		18,000	13,000	13.0	9.8	3895990
	AR*F182416C*		23,000	16,600	13.0	11.0	3896006
	AR*F182416C*+TXV		27,400	19,700	13.0	11.0	4559612
	AR*F303016B*		28,400	20,400	13.0	11.0	3839052
	AR*F303016C*		28,400	20,400	13.0	11.0	4244309
	AR*F363616B*		34,400	24,800	13.0	11.0	3839106
	AR*F363616C*		34,400	24,800	13.0	11.0	4260518
	AR*F364216B*		35,000	25,200	13.0	11.0	3839107
	AR*F364216B*		40,000	28,800	13.0	11.1	3839169
	AR*F364216C*		35,000	25,200	13.0	11.0	3839108
	AR*F364216C*		40,000	28,800	13.0	11.1	3839170
	AR*F486016B*		46,000	33,100	13.0	11.2	3839202
	AR*F486016B*		56,000	40,300	13.0	11.1	3839236
	AR*F486016C*		46,000	33,100	13.0	11.2	3896010
	AR*F486016C*		56,000	40,300	13.0	11.1	3896011
	AR*F496116A*		46,000	33,100	13.0	11.2	3839203
	AR*F496116A*		57,000	41,000	13.0	11.1	3839237
	AR*F496116C*		46,000	33,100	13.0	11.2	4358396
	AR*F496116C*		46,000	33,100	13.0	11.2	4358400
	AR*F496116C*		57,000	41,000	13.0	11.1	4358404
	AR*F496116C*		57,000	41,000	13.0	11.1	4358408
	ASPF183016B*		19,000	13,700	14.0	10.9	3838971
	ASPF183016B*		23,400	16,800	14.0	11.6	3839006
	ASPF183016B*		28,400	20,400	14.0	11.6	3839053
	ASPF183016C*		19,000	13,700	14.0	10.9	4244315
	ASPF183016C*		23,400	16,800	14.0	11.6	4244320
	ASPF183016C*		28,400	20,400	14.0	11.6	4244325
	ASPF183016D*		19,000	13,700	14.0	10.9	4149330
	ASPF183016D*		23,400	16,800	14.0	11.6	4149332
	ASPF183016D*		28,400	20,400	14.0	11.6	4149334
	ASPF183016E*		19,000	13,700	14.0	10.9	4244316
	ASPF183016E*		23,400	16,800	14.0	11.6	4244321
	ASPF183016E*		28,400	20,400	14.0	11.6	4244326
	ASPF313716C*		35,000	25,200	14.0	11.6	4355486
	ASPF313716D*		35,000	25,200	14.0	11.6	4149336
	ASPF313716E*		35,000	25,200	14.0	11.6	4355489
	ASPF426016B*		41,000	29,500	14.0	11.6	3839171
	ASPF426016B*		46,000	33,100	14.0	11.5	3839204
	ASPF426016B*		57,500	41,400	13.4	11.4	3839238
	ASPF426016C*		41,000	29,500	14.0	11.6	4358391
ASPF426016C*		41,000	29,500	14.0	11.6	4358393	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	ASPF426016C*		46,000	33,100	14.0	11.5	4358397
	ASPF426016C*		46,000	33,100	14.0	11.5	4358401
	ASPF426016C*		57,500	41,400	13.4	11.4	4358405
	ASPF426016C*		57,500	41,400	13.4	11.4	4358409
	ASPF426016D*		41,000	29,500	14.0	11.6	4149338
	ASPF426016D*		46,000	33,100	14.0	11.5	4149340
	ASPF426016D*		57,500	41,400	13.4	11.4	4149342
	ASPF426016E*		41,000	29,500	14.0	11.6	4358392
	ASPF426016E*		41,000	29,500	14.0	11.6	4358394
	ASPF426016E*		46,000	33,100	14.0	11.5	4358398
	ASPF426016E*		46,000	33,100	14.0	11.5	4358402
	ASPF426016E*		57,500	41,400	13.4	11.4	4358406
	ASPF426016E*		57,500	41,400	13.4	11.4	4358410
	AT*F303016A*		28,400	20,400	13.0	11.0	3839055
	AT*F363616A*		34,400	24,800	13.0	11.0	3839111
	AT*F364216A*		35,000	25,200	13.0	11.0	3839112
	AT*F364216A*		40,000	28,800	13.0	11.1	3839172
	AVPTC183014A*		18,000	13,000	14.0	10.4	4431331
	AVPTC183014A*		23,400	16,800	14.0	11.6	4431332
	AVPTC183014A*		28,400	20,400	14.0	11.6	4431333
	AVPTC313714A*		35,000	25,200	14.0	11.6	4431334
	AVPTC426014A*		41,000	29,500	14.0	11.6	4431335
	AVPTC426014A*		46,000	33,100	14.0	11.5	4431336
	AVPTC426014A*		57,500	41,400	13.4	11.3	4431337
	AWUF18XX16B*		17,400	12,500	13.0	9.8	3838974
	AWUF24XX16B*		23,000	16,600	13.0	11.0	3839009
	AWUF30XX16B*		27,600	19,900	13.0	11.0	4559609
	AWUF30XX16B*		27,600	19,900	13.0	11.0	4559613
	AWUF31XX16A*		17,400	12,500	14.0	10.3	3838975
	AWUF31XX16A*		23,000	16,600	14.0	11.5	3839010
	AWUF32XX16A*		23,000	16,600	14.0	11.5	3839011
	AWUF36XX16B*		27,800	20,000	13.0	11.0	4559610
	AWUF36XX16B*		27,800	20,000	13.0	11.0	4559614
	AWUF36XX16B*		33,400	24,000	13.0	11.0	3839113
	AWUF37XX16B*		28,000	20,200	13.0	11.0	4559611
	AWUF37XX16B*		28,000	20,200	13.0	11.0	4559615
	AWUF37XX16B*		34,000	24,500	13.0	11.0	3839115
	CA*F1824*6B*	A*VC950453BXA*	18,000	13,000	14.0	10.4	3838979
	CA*F1824*6B*	A*VC80704BXA*	18,000	13,000	14.0	10.4	3838978
	CA*F1824*6B*	A*V90453BX**	18,000	13,000	14.0	10.4	3838977
	CA*F1824*6B*	A*V80704BX**	18,000	13,000	14.0	10.4	3838976
	CA*F1824*6B*	A*VC950714CXA*	23,000	16,600	14.0	11.6	4202211
	CA*F1824*6B*	A*VC950704CXA*	23,000	16,600	14.0	11.6	3839018
	CA*F1824*6B*	A*VC950453BXA*	23,000	16,600	14.0	11.6	3839017
	CA*F1824*6B*	A*VC90704CXA*	23,000	16,600	14.0	11.6	3839016
	CA*F1824*6B*	A*VC80704BXA*	23,000	16,600	14.0	11.6	3839015
	CA*F1824*6B*	A*V90704CX**	23,000	16,600	14.0	11.6	3839014
CA*F1824*6B*	A*V90453BX**	23,000	16,600	14.0	11.6	3839013	
CA*F1824*6B*	A*V80704BX**	23,000	16,600	14.0	11.6	3839012	
CA*F1824*6B*+EEP		18,000	13,000	13.0	9.8	3838980	
CA*F1824*6B*+EEP		23,000	16,600	13.0	11.0	3839019	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CA*F1824*6C*	A*VC950453BXA*	18,000	13,000	14.0	10.4	3838983
	CA*F1824*6C*	A*V90453BX**	18,000	13,000	14.0	10.4	3838982
	CA*F1824*6C*	A*V80704BX**	18,000	13,000	14.0	10.4	3838981
	CA*F1824*6C*	A*VC950714CXA*	23,000	16,600	14.0	11.6	4202212
	CA*F1824*6C*	A*VC950704CXA*	23,000	16,600	14.0	11.6	3839025
	CA*F1824*6C*	A*VC950453BXA*	23,000	16,600	14.0	11.6	3839024
	CA*F1824*6C*	A*VC90704CXA*	23,000	16,600	14.0	11.6	3839023
	CA*F1824*6C*	A*V90704CX**	23,000	16,600	14.0	11.6	3839022
	CA*F1824*6C*	A*V90453BX**	23,000	16,600	14.0	11.6	3839021
	CA*F1824*6C*	A*V80704BX**	23,000	16,600	14.0	11.6	3839020
	CA*F1824*6C*+EEP		18,000	13,000	13.0	9.8	3838984
	CA*F1824*6C*+EEP		23,000	16,600	13.0	11.0	3839026
	CA*F1824*6D*	A*VC950453BXA*	18,000	13,000	14.0	10.4	4150337
	CA*F1824*6D*	A*VC80704BXA*	18,000	13,000	14.0	10.4	4150336
	CA*F1824*6D*	A*VC950704CXA*	23,000	16,600	14.0	11.6	4150348
	CA*F1824*6D*	A*VC950453BXA*	23,000	16,600	14.0	11.6	4150347
	CA*F1824*6D*	A*VC90704CXA*	23,000	16,600	14.0	11.6	4150346
	CA*F1824*6D*	A*VC80704BXA*	23,000	16,600	14.0	11.6	4150345
	CA*F1824*6D*+EEP		18,000	13,000	13.0	9.8	4150338
	CA*F1824*6D*+EEP		23,000	16,600	13.0	11.0	4150349
	CA*F3030*6B*	A*VC80703BXA*	28,400	20,400	13.0	11.3	4208056
	CA*F3030*6B*	A*VC950714CXA*	28,400	20,400	14.0	11.6	4202227
	CA*F3030*6B*	A*VC950704CXA*	28,400	20,400	14.0	11.6	3839063
	CA*F3030*6B*	A*VC950453BXA*	28,400	20,400	14.0	11.6	3839062
	CA*F3030*6B*	A*VC90704CXA*	28,400	20,400	14.0	11.6	3839061
	CA*F3030*6B*	A*VC80704BXA*	28,400	20,400	13.0	11.3	3839060
	CA*F3030*6B*	A*V90704CX**	28,400	20,400	14.0	11.6	3839059
	CA*F3030*6B*	A*V90453BX**	28,400	20,400	14.0	11.6	3839058
	CA*F3030*6B*	A*V80704BX**	28,400	20,400	13.0	11.3	3839057
	CA*F3030*6B*+EEP		28,400	20,400	13.0	11.0	3839064
	CA*F3030*6D*	A*VC80704BXA*	28,400	20,400	13.0	11.3	4355523
	CA*F3030*6D*	A*VC80703BXA*	28,400	20,400	13.0	11.3	4355522
	CA*F3030*6D*	A*VC950714CXA*	28,400	20,400	14.0	11.6	4355521
	CA*F3030*6D*	A*VC950453BXA*	28,400	20,400	14.0	11.6	4355520
	CA*F3030*6D*	A*VC950704CXA*	28,400	20,400	14.0	11.6	4355519
	CA*F3030*6D*	A*VC90704CXA*	28,400	20,400	14.0	11.6	4355518
	CA*F3030*6D*+EEP		28,400	20,400	13.0	11.0	4355524
	CA*F3131*6C*	A*VC80703BXA*	28,600	20,600	14.0	11.6	4208057
	CA*F3131*6C*	A*VC950714CXA*	28,600	20,600	14.0	11.6	4202228
	CA*F3131*6C*	MBVC1200**-1A*	28,400	20,400	14.0	11.6	3839074
	CA*F3131*6C*	MBE1200**-1B*	28,400	20,400	14.0	11.6	3839073
	CA*F3131*6C*	A*VC950704CXA*	28,600	20,600	14.0	11.6	3839071
	CA*F3131*6C*	A*VC950453BXA*	28,600	20,600	14.0	11.6	3839070
	CA*F3131*6C*	A*VC90704CXA*	28,600	20,600	14.0	11.6	3839069
	CA*F3131*6C*	A*VC80704BXA*	28,600	20,600	14.0	11.6	3839068
	CA*F3131*6C*	A*V90704CX**	28,600	20,600	14.0	11.6	3839067
	CA*F3131*6C*	A*V90453BX**	28,600	20,600	14.0	11.6	3839066
	CA*F3131*6C*	A*V80704BX**	28,600	20,600	14.0	11.6	3839065
	CA*F3131*6C*+EEP		28,600	20,600	13.0	11.0	3839072
	CA*F3131*6D*	MBVC1200**-1A*	28,400	20,400	14.0	11.6	4385601
CA*F3131*6D*	A*VC80703BXA*	28,600	20,600	14.0	11.6	4385599	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CA*F3131*6D*	A*VC950714CXA*	28,600	20,600	14.0	11.6	4385598
	CA*F3131*6D*	A*VC90704CXA*	28,600	20,600	14.0	11.6	4385597
	CA*F3131*6D*	A*VC950453BXA*	28,600	20,600	14.0	11.6	4385596
	CA*F3131*6D*	A*VC950704CXA*	28,400	20,400	14.0	11.6	4385595
	CA*F3131*6D*	A*VC80704BXA*	28,600	20,600	14.0	11.6	4385594
	CA*F3131*6D*+EEP		28,600	20,600	13.0	11.0	4385600
	CA*F3636*6B*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4199510
	CA*F3636*6B*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199508
	CA*F3636*6B*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594740
	CA*F3636*6B*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199541
	CA*F3636*6C*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4199513
	CA*F3636*6C*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199512
	CA*F3636*6C*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594741
	CA*F3636*6C*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199542
	CA*F3636*6C*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594742
	CA*F3636*6C*	A*VC950714CXA*	35,000	25,200	13.5	11.3	4586529
	CA*F3636*6C*	G*VC950714CXA*	35,000	25,200	13.5	11.3	4202250
	CA*F3636*6C*	A*VC950905CXA*	35,000	25,200	13.5	11.3	4200232
	CA*F3636*6C*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199561
	CA*F3636*6C*	A*VC951155DXA*	35,000	25,200	13.5	11.3	3839120
	CA*F3636*6C*	A*VC950905DXA*	35,000	25,200	13.5	11.3	3839119
	CA*F3636*6C*	A*VC90905DXA*	35,000	25,200	13.5	11.3	3839118
	CA*F3636*6C*	A*V91155DX**	35,000	25,200	13.5	11.3	3839117
	CA*F3636*6C*	A*V90905DX**	35,000	25,200	13.5	11.3	3839116
	CA*F3636*6C*+EEP		35,000	25,200	13.0	11.0	3839121
	CA*F3636*6D*	A*VC950714CXA*	35,000	25,200	13.5	11.3	4586530
	CA*F3636*6D*	G*VC950714CXA*	35,000	25,200	13.5	11.3	4392701
	CA*F3636*6D*	A*VC951155DXA*	35,000	25,200	13.5	11.3	4392700
	CA*F3636*6D*	A*VC950905DXA*	35,000	25,200	13.5	11.3	4392699
	CA*F3636*6D*	A*VC950905CXA*	35,000	25,200	13.5	11.3	4392698
	CA*F3636*6D*	A*VC90905DXA*	35,000	25,200	13.5	11.3	4392697
	CA*F3636*6D*+EEP		35,000	25,200	13.0	11.0	4392702
	CA*F3642*6B*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4199518
	CA*F3642*6B*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199515
	CA*F3642*6B*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594743
	CA*F3642*6B*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199544
	CA*F3642*6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4199522
	CA*F3642*6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199519
	CA*F3642*6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594744
	CA*F3642*6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199546
	CA*F3642*6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594745
	CA*F3642*6C*	A*VC950714CXA*	35,000	25,200	13.5	11.3	4586531
	CA*F3642*6C*	G*VC950714CXA*	35,000	25,200	13.5	11.3	4202251
	CA*F3642*6C*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200234
	CA*F3642*6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199563
	CA*F3642*6C*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3839128
	CA*F3642*6C*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3839127
	CA*F3642*6C*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3839126
	CA*F3642*6C*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3839125
	CA*F3642*6C*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3839124
	CA*F3642*6C*	A*V91155DX**	35,400	25,500	14.0	11.6	3839123

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CA*F3642*6C*	A*V90905DX**	35,400	25,500	14.0	11.6	3839122
	CA*F3642*6C*+EEP		40,000	28,800	13.0	11.1	3839173
	CA*F3642*6D*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4199525
	CA*F3642*6D*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199524
	CA*F3642*6D*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594746
	CA*F3642*6D*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199548
	CA*F3642*6D*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594747
	CA*F3642*6D*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586532
	CA*F3642*6D*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202252
	CA*F3642*6D*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200236
	CA*F3642*6D*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199565
	CA*F3642*6D*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3880864
	CA*F3642*6D*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3880862
	CA*F3642*6D*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3880855
	CA*F3642*6D*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3880854
	CA*F3642*6D*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3880853
	CA*F3642*6D*	A*V91155DX**	35,400	25,500	14.0	11.6	3880852
	CA*F3642*6D*	A*V90905DX**	35,400	25,500	14.0	11.6	3880851
	CA*F3743*6A*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4199529
	CA*F3743*6A*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199527
	CA*F3743*6A*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594748
	CA*F3743*6A*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199550
	CA*F3743*6A*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594749
	CA*F3743*6A*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586533
	CA*F3743*6A*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202253
	CA*F3743*6A*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200238
	CA*F3743*6A*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199567
	CA*F3743*6A*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3839135
	CA*F3743*6A*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3839134
	CA*F3743*6A*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3839133
	CA*F3743*6A*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3839132
	CA*F3743*6A*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3839131
	CA*F3743*6A*	A*V91155DX**	35,400	25,500	14.0	11.6	3839130
	CA*F3743*6A*	A*V90905DX**	35,400	25,500	14.0	11.6	3839129
	CA*F3743*6D*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586534
	CA*F3743*6D*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4415264
	CA*F3743*6D*	A*VC951155DXA*	35,400	25,500	14.0	11.6	4415263
	CA*F3743*6D*	A*VC950905DXA*	35,400	25,500	14.0	11.6	4415262
	CA*F3743*6D*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4415261
	CA*F3743*6D*	A*VC90905DXA*	35,400	25,500	14.0	11.6	4415260
	CA*F3743*6D*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	4415256
	CA*F4860*6B*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4199580
	CA*F4860*6B*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199577
	CA*F4860*6B*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4594759
	CA*F4860*6B*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199594
	CA*F4860*6B*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4594760
	CA*F4860*6B*	A*VC950714CXA*	41,000	29,500	14.0	11.6	4202272
	CA*F4860*6B*	A*VC950905CXA*	41,000	29,500	14.0	11.6	4200274
	CA*F4860*6B*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199607
	CA*F4860*6B*	MBVC1600**-1A*	41,000	29,500	14.0	11.6	3839180
CA*F4860*6B*	MBE1600**-1B*	41,000	29,500	14.0	11.6	3839179	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CA*F4860*6B*	A*VC951155DXA*	41,000	29,500	14.0	11.6	3839178
	CA*F4860*6B*	A*VC950905DXA*	41,000	29,500	14.0	11.6	3839177
	CA*F4860*6B*	A*VC90905DXA*	41,000	29,500	14.0	11.6	3839176
	CA*F4860*6B*	A*V91155DX**	41,000	29,500	14.0	11.6	3839175
	CA*F4860*6B*	A*V90905DX**	41,000	29,500	14.0	11.6	3839174
	CA*F4860*6B*	MBVC2000**-1A*	56,500	40,700	13.5	11.5	3839242
	CA*F4860*6B*	MBE2000**-1B*	56,500	40,700	13.5	11.5	3839240
	CA*F4860*6B*+EEP		46,000	33,100	13.0	11.2	3839206
	CA*F4860*6B*+EEP		55,500	40,000	13.0	11.0	3839239
	CA*F4860*6B*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4199618
	CA*F4860*6B*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199617
	CA*F4860*6B*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594776
	CA*F4860*6B*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199634
	CA*F4860*6B*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594777
	CA*F4860*6B*+TXV	A*VC950714CXA*	46,000	33,100	14.0	11.5	4202285
	CA*F4860*6B*+TXV	A*VC950905CXA*	46,000	33,100	14.0	11.5	4200313
	CA*F4860*6B*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199645
	CA*F4860*6B*+TXV	A*VC951155DXA*	46,000	33,100	14.0	11.5	3839211
	CA*F4860*6B*+TXV	A*VC950905DXA*	46,000	33,100	14.0	11.5	3839210
	CA*F4860*6B*+TXV	A*VC90905DXA*	46,000	33,100	14.0	11.5	3839209
	CA*F4860*6B*+TXV	A*V91155DX**	46,000	33,100	14.0	11.5	3839208
	CA*F4860*6B*+TXV	A*V90905DX**	46,000	33,100	14.0	11.5	3839207
	CA*F4860*6B*+TXV	G*VC951155DXA*	55,000	39,600	13.1	11.0	3839251
	CA*F4860*6B*+TXV	G*VC81155CXA*	56,000	40,300	13.5	11.4	3839250
	CA*F4860*6B*+TXV	G*VC80905CXA*	56,000	40,300	13.5	11.4	3839249
	CA*F4860*6B*+TXV	G*E81155C**	55,500	40,000	13.4	11.3	3839248
	CA*F4860*6B*+TXV	G*E80905C**	55,500	40,000	13.4	11.3	3839247
	CA*F4860*6B*+TXV	A*VC951155DXA*	55,000	39,600	13.1	11.0	3839246
	CA*F4860*6B*+TXV	A*VC81155CXA*	56,000	40,300	13.5	11.4	3839245
	CA*F4860*6B*+TXV	A*VC80905CXA*	56,000	40,300	13.5	11.4	3839244
	CA*F4860*6B*+TXV	MBVC2000**-1A*	56,000	40,300	13.7	11.5	3839243
	CA*F4860*6B*+TXV	MBE2000**-1B*	56,000	40,300	13.7	11.5	3839241
	CA*F4860*6D*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4199583
	CA*F4860*6D*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199581
	CA*F4860*6D*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4594761
	CA*F4860*6D*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199595
	CA*F4860*6D*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4594762
	CA*F4860*6D*	A*VC950714CXA*	41,000	29,500	14.0	11.6	4202273
	CA*F4860*6D*	A*VC950905CXA*	41,000	29,500	14.0	11.6	4200276
	CA*F4860*6D*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199608
	CA*F4860*6D*	MBVC1600**-1A*	41,000	29,500	14.0	11.6	3880907
	CA*F4860*6D*	MBE1600**-1B*	41,000	29,500	14.0	11.6	3880899
	CA*F4860*6D*	A*VC951155DXA*	41,000	29,500	14.0	11.6	3880893
	CA*F4860*6D*	A*VC950905DXA*	41,000	29,500	14.0	11.6	3880892
	CA*F4860*6D*	A*VC90905DXA*	41,000	29,500	14.0	11.6	3880891
	CA*F4860*6D*	A*V91155DX**	41,000	29,500	14.0	11.6	3880890
	CA*F4860*6D*	A*V90905DX**	41,000	29,500	14.0	11.6	3880889
	CA*F4860*6D*	MBVC2000**-1A*	56,500	40,700	13.5	11.5	3880910
	CA*F4860*6D*	MBE2000**-1B*	56,500	40,700	13.5	11.5	3880903
	CA*F4860*6D*+EEP		55,500	40,000	13.0	11.0	3880896
	CA*F4860*6D*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4199621

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CA*F4860*6D*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199620
	CA*F4860*6D*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594778
	CA*F4860*6D*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199635
	CA*F4860*6D*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594779
	CA*F4860*6D*+TXV	A*VC950714CXA*	46,000	33,100	14.0	11.5	4202289
	CA*F4860*6D*+TXV	A*VC950905CXA*	46,000	33,100	14.0	11.5	4200315
	CA*F4860*6D*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199646
	CA*F4860*6D*+TXV	A*VC951155DXA*	46,000	33,100	14.0	11.5	3880943
	CA*F4860*6D*+TXV	A*VC950905DXA*	46,000	33,100	14.0	11.5	3880942
	CA*F4860*6D*+TXV	A*VC90905DXA*	46,000	33,100	14.0	11.5	3880941
	CA*F4860*6D*+TXV	A*V91155DX**	46,000	33,100	14.0	11.5	3880940
	CA*F4860*6D*+TXV	A*V90905DX**	46,000	33,100	14.0	11.5	3880939
	CA*F4860*6D*+TXV	G*VC951155DXA*	55,000	39,600	13.1	11.0	3880977
	CA*F4860*6D*+TXV	G*VC81155CXA*	56,000	40,300	13.5	11.4	3880976
	CA*F4860*6D*+TXV	G*VC80905CXA*	56,000	40,300	13.5	11.4	3880975
	CA*F4860*6D*+TXV	G*E81155C**	55,500	40,000	13.4	11.3	3880974
	CA*F4860*6D*+TXV	G*E80905C**	55,500	40,000	13.4	11.3	3880973
	CA*F4860*6D*+TXV	A*VC951155DXA*	55,000	39,600	13.1	11.0	3880972
	CA*F4860*6D*+TXV	A*VC81155CXA*	56,000	40,300	13.5	11.4	3880971
	CA*F4860*6D*+TXV	A*VC80905CXA*	56,000	40,300	13.5	11.4	3880970
	CA*F4860*6D*+TXV	MBVC2000**-1A*	56,000	40,300	13.7	11.5	3880912
	CA*F4860*6D*+TXV	MBE2000**-1B*	56,000	40,300	13.7	11.5	3880905
	CA*F4961*6A*	MBVC2000**-1A*	57,500	41,400	13.7	11.6	3839255
	CA*F4961*6A*	MBE2000**-1B*	57,500	41,400	13.7	11.6	3839253
	CA*F4961*6A*+EEP		57,000	41,000	13.0	11.1	3839252
	CA*F4961*6A*+TXV	A*VC950915DXA*	56,500	40,700	13.0	11.0	4199657
	CA*F4961*6A*+TXV	G*VC950915DXA*	56,500	40,700	13.0	11.0	4199655
	CA*F4961*6A*+TXV	A*VC950714CXA*	56,500	40,700	13.0	11.0	4202301
	CA*F4961*6A*+TXV	G*VC950905CXA*	56,500	40,700	13.0	11.0	4200336
	CA*F4961*6A*+TXV	A*VC950905CXA*	56,500	40,700	13.0	11.0	4200333
	CA*F4961*6A*+TXV	G*VC950915DXA*	56,500	40,700	13.0	11.0	4199665
	CA*F4961*6A*+TXV	A*VC950915DXA*	56,500	40,700	13.0	11.0	4199663
	CA*F4961*6A*+TXV	G*VC951155DXA*	56,000	40,300	13.4	11.2	3839266
	CA*F4961*6A*+TXV	G*VC950905DXA*	56,500	40,700	13.0	11.0	3839265
	CA*F4961*6A*+TXV	G*VC81155CXA*	57,000	41,000	13.5	11.3	3839264
	CA*F4961*6A*+TXV	G*VC80905CXA*	57,000	41,000	13.6	11.4	3839263
	CA*F4961*6A*+TXV	G*E81155C**	57,000	41,000	13.5	11.5	3839262
	CA*F4961*6A*+TXV	G*E80905C**	57,000	41,000	13.6	11.5	3839261
	CA*F4961*6A*+TXV	A*VC951155DXA*	56,000	40,300	13.4	11.2	3839260
	CA*F4961*6A*+TXV	A*VC950905DXA*	56,500	40,700	13.0	11.0	3839259
	CA*F4961*6A*+TXV	A*VC81155CXA*	57,000	41,000	13.5	11.3	3839258
	CA*F4961*6A*+TXV	A*VC80905CXA*	57,000	41,000	13.6	11.4	3839257
	CA*F4961*6A*+TXV	MBVC2000**-1A*	57,500	41,400	13.8	11.6	3839256
	CA*F4961*6A*+TXV	MBE2000**-1B*	57,500	41,400	13.8	11.6	3839254
CA*F4961*6D*+EEP		57,000	41,000	13.0	11.1	4431384	
CA*F4961*6D*	MBVC2000**-1A*	57,500	41,400	13.7	11.6	4431385	
CA*F4961*6D*+TXV	MBVC2000**-1A*	57,500	41,400	13.8	11.6	4431386	
CA*F4961*6D*+TXV	G*VC951155DXA*	56,000	40,300	13.4	11.2	4431399	
CA*F4961*6D*+TXV	G*VC950905DXA*	56,500	40,700	13.0	11.0	4431398	
CA*F4961*6D*+TXV	G*VC950905CXA*	56,500	40,700	13.0	11.0	4431397	
CA*F4961*6D*+TXV	G*VC81155CXA*	57,000	41,000	13.5	11.3	4431396	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CA*F4961*6D*+TXV	G*VC80905CXA*	57,000	41,000	13.6	11.4	4431395
	CA*F4961*6D*+TXV	G*E81155C**	57,000	41,000	13.5	11.5	4431394
	CA*F4961*6D*+TXV	G*E80905C**	57,000	41,000	13.6	11.5	4431393
	CA*F4961*6D*+TXV	A*VC951155DXA*	56,000	40,300	13.4	11.2	4431392
	CA*F4961*6D*+TXV	A*VC950905DXA*	56,500	40,700	13.0	11.0	4431391
	CA*F4961*6D*+TXV	A*VC950905CXA*	56,500	40,700	13.0	11.0	4431390
	CA*F4961*6D*+TXV	A*VC950714CXA*	56,500	40,700	13.0	11.0	4431389
	CA*F4961*6D*+TXV	A*VC81155CXA*	57,000	41,000	13.5	11.3	4431388
	CA*F4961*6D*+TXV	A*VC80905CXA*	57,000	41,000	13.6	11.4	4431387
	CHPF1824A6C*+EEP		18,000	13,000	13.0	9.8	3838985
	CHPF1824A6C*+EEP		23,000	16,600	13.0	11.0	3839027
	CHPF2430B6C*	MBE1200**-1B*	18,400	13,200	14.0	10.4	3838990
	CHPF2430B6C*	A*VC950453BXA*	18,400	13,200	14.0	10.4	3838988
	CHPF2430B6C*	A*V90453BX**	18,400	13,200	14.0	10.4	3838987
	CHPF2430B6C*	A*V80704BX**	18,400	13,200	14.0	10.4	3838986
	CHPF2430B6C*	MBE1200**-1B*	23,400	16,800	14.0	11.6	3839032
	CHPF2430B6C*	A*VC950453BXA*	23,400	16,800	14.0	11.6	3839030
	CHPF2430B6C*	A*V90453BX**	23,400	16,800	14.0	11.6	3839029
	CHPF2430B6C*	A*V80704BX**	23,400	16,800	14.0	11.6	3839028
	CHPF2430B6C*	MBE1200**-1B*	28,400	20,400	14.0	11.6	3839079
	CHPF2430B6C*	A*VC950453BXA*	28,400	20,400	14.0	11.6	3839077
	CHPF2430B6C*	A*V90453BX**	28,400	20,400	14.0	11.6	3839076
	CHPF2430B6C*	A*V80704BX**	28,400	20,400	14.0	11.6	3839075
	CHPF2430B6C*+EEP		18,000	13,000	13.0	9.8	3838989
	CHPF2430B6C*+EEP		23,000	16,600	13.0	11.0	3839031
	CHPF2430B6C*+EEP		28,400	20,400	13.0	11.0	3839078
	CHPF3636B6C*+EEP		35,400	25,500	13.0	11.0	3839136
	CHPF3642C6C*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3839139
	CHPF3642C6C*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3839138
	CHPF3642C6C*+EEP		35,400	25,500	13.0	11.0	3839137
	CHPF3642D6B*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4199532
	CHPF3642D6B*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199531
	CHPF3642D6B*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4594750
	CHPF3642D6B*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199552
	CHPF3642D6B*	G*VC950915DXA*	40,000	28,800	13.5	11.3	4594763
	CHPF3642D6B*	A*VC950915DXA*	40,000	28,800	13.5	11.3	4199585
	CHPF3642D6B*	G*VC950915DXA*	40,000	28,800	13.5	11.3	4594764
	CHPF3642D6B*	A*VC950915DXA*	40,000	28,800	13.5	11.3	4199597
	CHPF3642D6C*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4199535
	CHPF3642D6C*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199534
	CHPF3642D6C*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4594751
	CHPF3642D6C*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199554
	CHPF3642D6C*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4594752
	CHPF3642D6C*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586535
	CHPF3642D6C*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202254
	CHPF3642D6C*	A*VC950905CXA*	35,000	25,200	14.0	11.6	4200240
	CHPF3642D6C*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199569
	CHPF3642D6C*	A*VC951155DXA*	35,000	25,200	14.0	11.6	3839144
	CHPF3642D6C*	A*VC950905DXA*	35,000	25,200	14.0	11.6	3839143
	CHPF3642D6C*	A*VC90905DXA*	35,000	25,200	14.0	11.6	3839142
CHPF3642D6C*	A*V91155DX**	35,000	25,200	14.0	11.6	3839141	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #	
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>		
ASX13 0181C* (cont.)	CHPF3642D6C*	A*V90905DX**	35,000	25,200	14.0	11.6	3839140	
	CHPF3642D6C*	G*VC950915DXA*	40,000	28,800	13.5	11.3	4594765	
	CHPF3642D6C*	A*VC950915DXA*	40,000	28,800	13.5	11.3	4199587	
	CHPF3642D6C*	G*VC950915DXA*	40,000	28,800	13.5	11.3	4594766	
	CHPF3642D6C*	A*VC950915DXA*	40,000	28,800	13.5	11.3	4199599	
	CHPF3642D6C*	G*VC950915DXA*	40,000	28,800	13.5	11.3	4594767	
	CHPF3642D6C*	A*VC950714CXA*	40,000	28,800	13.5	11.3	4202271	
	CHPF3642D6C*	A*VC950905CXA*	40,000	28,800	13.5	11.3	4200278	
	CHPF3642D6C*	A*VC950915DXA*	40,000	28,800	13.5	11.3	4199610	
	CHPF3642D6C*	A*VC950905DXA*	40,000	28,800	13.5	11.3	3839183	
	CHPF3642D6C*	A*VC90905DXA*	40,000	28,800	13.5	11.3	3839182	
	CHPF3642D6C*	A*V90905DX**	40,000	28,800	13.5	11.3	3839181	
	CHPF3642D6C*+EEP			35,400	25,500	13.0	11.0	3839145
	CHPF4860D6C*		G*VC950915DXA*	41,000	29,500	14.0	11.6	4594768
	CHPF4860D6C*		A*VC950915DXA*	41,000	29,500	14.0	11.6	4199588
	CHPF4860D6C*		G*VC950915DXA*	41,000	29,500	14.0	11.6	4594769
	CHPF4860D6C*		A*VC950915DXA*	41,000	29,500	14.0	11.6	4199601
	CHPF4860D6C*+TXV		G*VC950915DXA*	46,000	33,100	14.0	11.5	4199625
	CHPF4860D6C*+TXV		A*VC950915DXA*	46,000	33,100	14.0	11.5	4199623
	CHPF4860D6C*+TXV		G*VC950915DXA*	46,000	33,100	14.0	11.5	4594780
	CHPF4860D6C*+TXV		A*VC950915DXA*	46,000	33,100	14.0	11.5	4199637
	CHPF4860D6D*		G*VC950915DXA*	41,000	29,500	14.0	11.6	4594770
	CHPF4860D6D*		A*VC950915DXA*	41,000	29,500	14.0	11.6	4199590
	CHPF4860D6D*		G*VC950915DXA*	41,000	29,500	14.0	11.6	4594771
	CHPF4860D6D*		A*VC950915DXA*	41,000	29,500	14.0	11.6	4199603
	CHPF4860D6D*		G*VC950915DXA*	41,000	29,500	14.0	11.6	4594772
	CHPF4860D6D*		A*VC950714CXA*	41,000	29,500	14.0	11.6	4202269
	CHPF4860D6D*		A*VC950905CXA*	41,000	29,500	14.0	11.6	4200279
	CHPF4860D6D*		A*VC950915DXA*	41,000	29,500	14.0	11.6	4199612
	CHPF4860D6D*		MBVC1600**-1A*	41,000	29,500	14.0	11.6	3839190
	CHPF4860D6D*		MBE1600**-1B*	41,000	29,500	14.0	11.6	3839189
	CHPF4860D6D*		A*VC951155DXA*	41,000	29,500	14.0	11.6	3839188
	CHPF4860D6D*		A*VC950905DXA*	41,000	29,500	14.0	11.6	3839187
	CHPF4860D6D*		A*VC90905DXA*	41,000	29,500	14.0	11.6	3839186
	CHPF4860D6D*		A*V91155DX**	41,000	29,500	14.0	11.6	3839185
	CHPF4860D6D*		A*V90905DX**	41,000	29,500	14.0	11.6	3839184
	CHPF4860D6D*		MBE2000**-1B*	46,000	33,100	14.0	11.5	3839213
	CHPF4860D6D*		MBVC2000**-1A*	57,000	41,000	13.7	11.5	3839270
	CHPF4860D6D*		MBE2000**-1B*	57,000	41,000	13.7	11.5	3839268
	CHPF4860D6D*+EEP			46,000	33,100	13.0	11.2	3839212
	CHPF4860D6D*+EEP			57,000	41,000	13.0	11.1	3839267
	CHPF4860D6D*		MBVC2000**-1A*	46,000	33,100	14.0	11.5	3839214
	CHPF4860D6D*+TXV		G*VC950915DXA*	46,000	33,100	14.0	11.5	4199629
	CHPF4860D6D*+TXV		A*VC950915DXA*	46,000	33,100	14.0	11.5	4199627
	CHPF4860D6D*+TXV		G*VC950915DXA*	46,000	33,100	14.0	11.5	4594781
	CHPF4860D6D*+TXV		A*VC950915DXA*	46,000	33,100	14.0	11.5	4199639
	CHPF4860D6D*+TXV		G*VC950915DXA*	46,000	33,100	14.0	11.5	4594782
	CHPF4860D6D*+TXV		A*VC950714CXA*	46,000	33,100	14.0	11.5	4202286
	CHPF4860D6D*+TXV		A*VC950905CXA*	46,000	33,100	14.0	11.5	4200317
	CHPF4860D6D*+TXV		A*VC950915DXA*	46,000	33,100	14.0	11.5	4199648
CHPF4860D6D*+TXV		A*VC951155DXA*	46,000	33,100	14.0	11.5	3839219	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CHPF4860D6D*+TXV	A*VC950905DXA*	46,000	33,100	14.0	11.5	3839218
	CHPF4860D6D*+TXV	A*VC90905DXA*	46,000	33,100	14.0	11.5	3839217
	CHPF4860D6D*+TXV	A*V91155DX**	46,000	33,100	14.0	11.5	3839216
	CHPF4860D6D*+TXV	A*V90905DX**	46,000	33,100	14.0	11.5	3839215
	CHPF4860D6D*+TXV	A*VC950915DXA*	56,500	40,700	13.0	11.0	4199661
	CHPF4860D6D*+TXV	G*VC950915DXA*	56,500	40,700	13.0	11.0	4199659
	CHPF4860D6D*+TXV	A*VC950714CXA*	57,000	41,000	13.2	11.0	4202302
	CHPF4860D6D*+TXV	G*VC950905CXA*	56,500	40,700	13.0	11.0	4200339
	CHPF4860D6D*+TXV	A*VC950905CXA*	56,500	40,700	13.0	11.0	4200337
	CHPF4860D6D*+TXV	G*VC950915DXA*	56,500	40,700	13.0	11.0	4199669
	CHPF4860D6D*+TXV	A*VC950915DXA*	56,500	40,700	13.0	11.0	4199667
	CHPF4860D6D*+TXV	G*VC951155DXA*	56,500	40,700	13.4	11.3	3839281
	CHPF4860D6D*+TXV	G*VC950905DXA*	57,000	41,000	13.2	11.0	3839280
	CHPF4860D6D*+TXV	G*VC81155CXA*	57,000	41,000	13.5	11.4	3839279
	CHPF4860D6D*+TXV	G*VC80905CXA*	57,000	41,000	13.5	11.5	3839278
	CHPF4860D6D*+TXV	G*E81155C**	57,000	41,000	13.7	11.5	3839277
	CHPF4860D6D*+TXV	G*E80905C**	57,000	41,000	13.7	11.5	3839276
	CHPF4860D6D*+TXV	A*VC951155DXA*	56,500	40,700	13.4	11.3	3839275
	CHPF4860D6D*+TXV	A*VC950905DXA*	57,000	41,000	13.2	11.0	3839274
	CHPF4860D6D*+TXV	A*VC81155CXA*	57,000	41,000	13.5	11.4	3839273
	CHPF4860D6D*+TXV	A*VC80905CXA*	57,000	41,000	13.5	11.5	3839272
	CHPF4860D6D*+TXV	MBVC2000**-1A*	57,000	41,000	13.8	11.7	3839271
	CHPF4860D6D*+TXV	MBE2000**-1B*	57,000	41,000	13.8	11.7	3839269
	CSCF1824N6B*	A*VC950453BXA*	18,000	13,000	14.0	10.4	3838994
	CSCF1824N6B*	A*VC80704BXA*	18,000	13,000	14.0	10.4	3838993
	CSCF1824N6B*	A*V90453BX**	18,000	13,000	14.0	10.4	3838992
	CSCF1824N6B*	A*V80704BX**	18,000	13,000	14.0	10.4	3838991
	CSCF1824N6B*	A*VC950453BXA*	23,000	16,600	14.0	11.6	3839036
	CSCF1824N6B*	A*VC80704BXA*	23,000	16,600	13.0	11.0	3839035
	CSCF1824N6B*	A*V90453BX**	23,000	16,600	14.0	11.6	3839034
	CSCF1824N6B*	A*V80704BX**	23,000	16,600	13.0	11.0	3839033
	CSCF1824N6B*+EEP		18,000	13,000	13.0	9.8	3838995
	CSCF1824N6B*+EEP		23,000	16,600	13.0	11.0	3839037
	CSCF3036N6B*	A*VC950453BXA*	28,400	20,400	14.0	11.6	3839083
	CSCF3036N6B*	A*VC80704BXA*	28,400	20,400	14.0	11.6	3839082
	CSCF3036N6B*	A*V90453BX**	28,400	20,400	14.0	11.6	3839081
	CSCF3036N6B*	A*V80704BX**	28,400	20,400	14.0	11.6	3839080
	CSCF3036N6B*+EEP		28,400	20,400	13.0	11.0	3839084
	CSCF3036N6B*+EEP		35,000	25,200	13.0	11.0	3839146
	CSCF3642N6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4199539
	CSCF3642N6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199537
	CSCF3642N6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594753
	CSCF3642N6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199556
	CSCF3642N6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594754
	CSCF3642N6C*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586536
	CSCF3642N6C*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202255
	CSCF3642N6C*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200241
	CSCF3642N6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199571
	CSCF3642N6C*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3839151
	CSCF3642N6C*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3839150
CSCF3642N6C*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3839149	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CSCF3642N6C*	A*V91155DX**	35,400	25,500	14.0	11.6	3839148
	CSCF3642N6C*	A*V90905DX**	35,400	25,500	14.0	11.6	3839147
	CSCF3642N6C*+EEP		35,400	25,500	13.0	11.0	3839152
	CSCF4860N6C*	G*VC950915DXA*	41,000	29,500	14.0	11.3	4594773
	CSCF4860N6C*	A*VC950915DXA*	41,000	29,500	14.0	11.3	4199592
	CSCF4860N6C*	A*VC951155DXA*	41,000	29,500	14.0	11.3	3839192
	CSCF4860N6C*	A*V91155DX**	41,000	29,500	14.0	11.3	3839191
	CSCF4860N6C*	MBVC2000**-1A*	57,000	41,000	14.0	12.0	3839284
	CSCF4860N6C*	MBE2000**-1B*	57,000	41,000	14.0	12.0	3839282
	CSCF4860N6C*+EEP		46,000	33,100	13.0	11.2	3839220
	CSCF4860N6C*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4199632
	CSCF4860N6C*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199631
	CSCF4860N6C*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594783
	CSCF4860N6C*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199641
	CSCF4860N6C*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594784
	CSCF4860N6C*+TXV	A*VC950714CXA*	46,000	33,100	14.0	11.5	4202287
	CSCF4860N6C*+TXV	A*VC950905CXA*	46,000	33,100	14.0	11.5	4200319
	CSCF4860N6C*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199650
	CSCF4860N6C*+TXV	A*VC951155DXA*	46,000	33,100	14.0	11.5	3839225
	CSCF4860N6C*+TXV	A*VC950905DXA*	46,000	33,100	14.0	11.5	3839224
	CSCF4860N6C*+TXV	A*VC90905DXA*	46,000	33,100	14.0	11.5	3839223
	CSCF4860N6C*+TXV	A*V91155DX**	46,000	33,100	14.0	11.5	3839222
	CSCF4860N6C*+TXV	A*V90905DX**	46,000	33,100	14.0	11.5	3839221
	CSCF4860N6C*+TXV	MBVC2000**-1A*	57,000	41,000	14.0	12.0	3839285
	CSCF4860N6C*+TXV	MBE2000**-1B*	57,000	41,000	14.0	12.0	3839283
	CT*F3030*6A*	A*VC950714CXA*	28,400	20,400	14.0	11.6	4202229
	CT*F3030*6A*	A*VC950704CXA*	28,400	20,400	14.0	11.6	3839091
	CT*F3030*6A*	A*VC950453BXA*	28,400	20,400	14.0	11.6	3839090
	CT*F3030*6A*	A*VC90704CXA*	28,400	20,400	14.0	11.6	3839089
	CT*F3030*6A*	A*VC80704BXA*	28,400	20,400	13.5	11.3	3839088
	CT*F3030*6A*	A*V90704CX**	28,400	20,400	14.0	11.6	3839087
	CT*F3030*6A*	A*V90453BX**	28,400	20,400	14.0	11.6	3839086
	CT*F3030*6A*	A*V80704BX**	28,400	20,400	13.5	11.3	3839085
	CT*F3030*6A*+EEP		28,400	20,400	13.0	11.0	3839092
	CT*F3131*6A*	A*VC950714CXA*	28,600	20,600	14.0	11.6	4202230
	CT*F3131*6A*	MBVC1200**-1A*	28,400	20,400	14.0	11.6	3839102
	CT*F3131*6A*	MBE1200**-1B*	28,400	20,400	14.0	11.6	3839101
	CT*F3131*6A*	A*VC950704CXA*	28,600	20,600	14.0	11.6	3839099
	CT*F3131*6A*	A*VC950453BXA*	28,600	20,600	14.0	11.6	3839098
	CT*F3131*6A*	A*VC90704CXA*	28,600	20,600	14.0	11.6	3839097
	CT*F3131*6A*	A*VC80704BXA*	28,600	20,600	14.0	11.6	3839096
	CT*F3131*6A*	A*V90704CX**	28,600	20,600	14.0	11.6	3839095
	CT*F3131*6A*	A*V90453BX**	28,600	20,600	14.0	11.6	3839094
	CT*F3131*6A*	A*V80704BX**	28,600	20,600	14.0	11.6	3839093
	CT*F3131*6A*+EEP		28,600	20,600	13.0	11.0	3839100
	CT*F3636*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594755
	CT*F3636*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199558
	CT*F3636*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594756
	CT*F3636*6A*	A*VC950714CXA*	35,000	25,200	14.0	11.6	4586537
	CT*F3636*6A*	G*VC950714CXA*	35,000	25,200	14.0	11.6	4202248
CT*F3636*6A*	A*VC950905CXA*	35,000	25,200	13.5	11.3	4200244	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0181C* (cont.)	CT*F3636*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199573
	CT*F3636*6A*	A*VC951155DXA*	35,000	25,200	13.5	11.3	3839157
	CT*F3636*6A*	A*VC950905DXA*	35,000	25,200	13.5	11.3	3839156
	CT*F3636*6A*	A*VC950905DXA*	35,000	25,200	13.5	11.3	3839155
	CT*F3636*6A*	A*V91155DX**	35,000	25,200	13.5	11.3	3839154
	CT*F3636*6A*	A*V90905DX**	35,000	25,200	13.5	11.3	3839153
	CT*F3636*6A*+EEP		35,000	25,200	13.0	11.0	3839158
	CT*F3642*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594757
	CT*F3642*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199560
	CT*F3642*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594758
	CT*F3642*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199575
	CT*F4860*6A*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4594774
	CT*F4860*6A*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199605
	CT*F4860*6A*	G*VC950915DXA*	41,000	29,500	14.0	11.6	4594775
	CT*F4860*6A*	A*VC950915DXA*	41,000	29,500	14.0	11.6	4199614
	CT*F4860*6A*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594785
	CT*F4860*6A*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199643
	CT*F4860*6A*+TXV	G*VC950915DXA*	46,000	33,100	14.0	11.5	4594786
CT*F4860*6A*+TXV	A*VC950915DXA*	46,000	33,100	14.0	11.5	4199652	
ASX13 0241B*	ADPF182416B*		23,000	16,800	13	11	3540012
	AEPF183016C*		23,400	17,100	14	11.6	3540013
	AR*F182416B*		23,000	16,800	13	11	3540014
	ASPF183016B*		23,400	17,100	14	11.6	3540015
	AT*F182416A*		23,000	16,800	13	11	3540016
	AWUF24XX16A*		23,000	16,800	13	11	3540017
	AWUF24XX16B*		23,000	16,800	13	11	3620209
	AWUF30XX16A*		23,200	16,900	13	11	3541589
	AWUF31XX16A*		23,000	16,800	14	11.5	3629348
	AWUF32XX16A*		23,000	16,800	14	11.5	3629349
	CA*F1824*6B*	A*V90453B**	23,000	16,800	14	11.6	3540018
	CA*F1824*6B*	A*V90704C**	23,000	16,800	14	11.6	3540019
	CA*F1824*6B*	A*V80704B**	23,000	16,800	14	11.6	3540020
	CA*F1824*6B*	A*VC90704CXA*	23,000	16,800	14	11.6	3596113
	CA*F1824*6B*	A*VC950453BXA*	23,000	16,800	14	11.6	3596397
	CA*F1824*6B*	A*VC950704CXA*	23,000	16,800	14	11.6	3596503
	CA*F1824*6B*	A*VC80704BXA*	23,000	16,800	14	11.6	3629801
	CA*F1824*6B*+EEP		23,000	16,800	13	11	3539970
	CA*F1824*6C*	A*V80704B**	23,000	16,800	14	11.6	3620200
	CA*F1824*6C*	A*V90453B**	23,000	16,800	14	11.6	3620201
	CA*F1824*6C*	A*V90704C**	23,000	16,800	14	11.6	3620202
	CA*F1824*6C*	A*VC90704CXA*	23,000	16,800	14	11.6	3620203
	CA*F1824*6C*	A*VC950453BXA*	23,000	16,800	14	11.6	3620204
	CA*F1824*6C*	A*VC950704CXA*	23,000	16,800	14	11.6	3620205
	CA*F1824*6C*+EEP		23,000	16,800	13	11	3620196
	CHPF1824A6B*+EEP		23,000	16,800	13	11	3540021
	CHPF2430B6B*	A*V90453B**	23,400	17,100	14	11.6	3540023
	CHPF2430B6B*	A*V80704B**	23,400	17,100	14	11.6	3540024
	CHPF2430B6B*	A*VC950453BXA*	23,400	17,100	14	11.6	3596405
	CHPF2430B6B*+EEP		23,000	16,800	13	11	3540022
	CHPF2430B6B*	MBE1200**-1B*	23,400	17,100	14	11.6	3541590
	CSCF1824N6B*	A*V80704B**	23,000	16,800	13	11	3540025
	CSCF1824N6B*	A*V90453B**	23,000	16,800	14	11.6	3540026
CSCF1824N6B*	A*VC950453BXA*	23,000	16,800	14	11.6	3596398	
CSCF1824N6B*	A*VC80704BXA*	23,000	16,800	13	11	3629802	
CSCF1824N6B*+EEP		23,000	16,800	13	11	3540027	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0241B* (cont.)	CT*F1824*6A*	A*V80704B**	23,000	16,800	14	11.6	3540028
	CT*F1824*6A*	A*V90704C**	23,000	16,800	14	11.6	3540029
	CT*F1824*6A*	A*V90453B**	23,000	16,800	14	11.6	3540030
	CT*F1824*6A*	A*VC90704CXA*	23,000	16,800	14	11.6	3596114
	CT*F1824*6A*	A*VC950453BXA*	23,000	16,800	14	11.6	3596399
	CT*F1824*6A*	A*VC950704CXA*	23,000	16,800	14	11.6	3596504
	CT*F1824*6A*	A*VC80704BXA*	23,000	16,800	14	11.6	3629803
	CT*F1824*6A*+EEP		23,000	16,800	13	11	3540031
	CT*F1824*6A*	MBE1200**-1B*	23,000	16,800	14	11.6	3541591
	CT*F1824*6A*	MBVC1200**-1A*	23,000	16,800	14	11.6	3610285
ASX13 0241C*	ADPF182416B*		23,000	16,800	13.0	11.0	3839003
	ADPF182416C*		23,000	16,800	13.0	11.0	3896005
	AEPF183016C*		23,400	17,100	14.0	11.6	3839004
	AR*F182416B*		23,000	16,800	13.0	11.0	3839005
	AR*F182416C*		23,000	16,800	13.0	11.0	3896006
	ASPF183016B*		23,400	17,100	14.0	11.6	3839006
	ASPF183016C*		23,400	17,100	14.0	11.6	4244320
	ASPF183016D*		23,400	17,100	14.0	11.6	4149332
	ASPF183016E*		23,400	17,100	14.0	11.6	4244321
	AVPTC183014A*		23,400	17,100	14.0	11.6	4431332
	AWUF24XX16B*		23,000	16,800	13.0	11.0	3839009
	AWUF31XX16A*		23,000	16,800	14.0	11.5	3839010
	AWUF32XX16A*		23,000	16,800	14.0	11.5	3839011
	CA*F1824*6B*	A*VC950714CXA*	23,000	16,800	14.0	11.6	4202211
	CA*F1824*6B*	A*VC950704CXA*	23,000	16,800	14.0	11.6	3839018
	CA*F1824*6B*	A*VC950453BXA*	23,000	16,800	14.0	11.6	3839017
	CA*F1824*6B*	A*VC90704CXA*	23,000	16,800	14.0	11.6	3839016
	CA*F1824*6B*	A*VC80704BXA*	23,000	16,800	14.0	11.6	3839015
	CA*F1824*6B*	A*V90704CX**	23,000	16,800	14.0	11.6	3839014
	CA*F1824*6B*	A*V90453BX**	23,000	16,800	14.0	11.6	3839013
	CA*F1824*6B*	A*V80704BX**	23,000	16,800	14.0	11.6	3839012
	CA*F1824*6B*+EEP		23,000	16,800	13.0	11.0	3839019
	CA*F1824*6C*	A*VC950714CXA*	23,000	16,800	14.0	11.6	4202212
	CA*F1824*6C*	A*VC950704CXA*	23,000	16,800	14.0	11.6	3839025
	CA*F1824*6C*	A*VC950453BXA*	23,000	16,800	14.0	11.6	3839024
	CA*F1824*6C*	A*VC90704CXA*	23,000	16,800	14.0	11.6	3839023
	CA*F1824*6C*	A*V90704CX**	23,000	16,800	14.0	11.6	3839022
	CA*F1824*6C*	A*V90453BX**	23,000	16,800	14.0	11.6	3839021
	CA*F1824*6C*	A*V80704BX**	23,000	16,800	14.0	11.6	3839020
	CA*F1824*6C*+EEP		23,000	16,800	13.0	11.0	3839026
	CA*F1824*6D*	A*VC950704CXA*	23,000	16,800	14.0	11.6	4150348
	CA*F1824*6D*	A*VC950453BXA*	23,000	16,800	14.0	11.6	4150347
	CA*F1824*6D*	A*VC90704CXA*	23,000	16,800	14.0	11.6	4150346
	CA*F1824*6D*	A*VC80704BXA*	23,000	16,800	14.0	11.6	4150345
	CA*F1824*6D*+EEP		23,000	16,800	13.0	11.0	4150349
	CHPF1824A6C*+EEP		23,000	16,800	13.0	11.0	3839027
	CHPF2430B6C*	A*VC950453BXA*	23,400	17,100	14.0	11.6	3839030
	CHPF2430B6C*	A*V90453BX**	23,400	17,100	14.0	11.6	3839029
	CHPF2430B6C*	A*V80704BX**	23,400	17,100	14.0	11.6	3839028
	CHPF2430B6C*+EEP		23,000	16,800	13.0	11.0	3839031
CHPF2430B6C*	MBE1200**-1B*	23,400	17,100	14.0	11.6	3839032	
CSCF1824N6B*	A*VC950453BXA*	23,000	16,800	14.0	11.6	3839036	
CSCF1824N6B*	A*VC80704BXA*	23,000	16,800	13.0	11.0	3839035	
CSCF1824N6B*	A*V90453BX**	23,000	16,800	14.0	11.6	3839034	
CSCF1824N6B*	A*V80704BX**	23,000	16,800	13.0	11.0	3839033	
CSCF1824N6B*+EEP		23,000	16,800	13.0	11.0	3839037	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0301B*	AWUF30XX16B*		27,600	20,400	13.0	11.0	4559609
	AWUF36XX16B*		27,800	20,600	13.0	11.0	4559610
	AWUF37XX16B*		28,000	20,700	13.0	11.0	4559611
ASX13 0301C*	ADPF304216B*		28,400	21,000	13.0	11.0	3839048
	ADPF304216C*		28,400	21,000	13.0	11.0	3839049
	AEPF183016C*		28,400	21,000	14.0	11.6	3839050
	AR*F182416B*+TXV		27,400	20,300	13.0	11.0	3839051
	AR*F182416C*+TXV		27,400	20,300	13.0	11.0	4559612
	AR*F303016B*		28,400	21,000	13.0	11.0	3839052
	AR*F303016C*		28,400	21,000	13.0	11.0	4244309
	ASPF183016B*		28,400	21,000	14.0	11.6	3839053
	ASPF183016C*		28,400	21,000	14.0	11.6	4244325
	ASPF183016D*		28,400	21,000	14.0	11.6	4149334
	ASPF183016E*		28,400	21,000	14.0	11.6	4244326
	AT*F303016A*		28,400	21,000	13.0	11.0	3839055
	AVPTC183014A*		28,400	21,000	14.0	11.6	4431333
	AWUF30XX16B*		27,600	20,400	13.0	11.0	4559613
	AWUF36XX16B*		27,800	20,600	13.0	11.0	4559614
	AWUF37XX16B*		28,000	20,700	13.0	11.0	4559615
	CA*F3030*6B*	A*VC80703BXA*	28,400	21,000	13.0	11.3	4208056
	CA*F3030*6B*	A*VC950714CXA*	28,400	21,000	14.0	11.6	4202227
	CA*F3030*6B*	A*VC950704CXA*	28,400	21,000	14.0	11.6	3839063
	CA*F3030*6B*	A*VC950453BXA*	28,400	21,000	14.0	11.6	3839062
	CA*F3030*6B*	A*VC90704CXA*	28,400	21,000	14.0	11.6	3839061
	CA*F3030*6B*	A*VC80704BXA*	28,400	21,000	13.0	11.3	3839060
	CA*F3030*6B*	A*V90704CX**	28,400	21,000	14.0	11.6	3839059
	CA*F3030*6B*	A*V90453BX**	28,400	21,000	14.0	11.6	3839058
	CA*F3030*6B*	A*V80704BX**	28,400	21,000	13.0	11.3	3839057
	CA*F3030*6B*+EEP		28,400	21,000	13.0	11.0	3839064
	CA*F3030*6D*	A*VC80704BXA*	28,400	21,000	13.0	11.3	4355523
	CA*F3030*6D*	A*VC80703BXA*	28,400	21,000	13.0	11.3	4355522
	CA*F3030*6D*	A*VC950714CXA*	28,400	21,000	14.0	11.6	4355521
	CA*F3030*6D*	A*VC950453BXA*	28,400	21,000	14.0	11.6	4355520
	CA*F3030*6D*	A*VC950704CXA*	28,400	21,000	14.0	11.6	4355519
	CA*F3030*6D*	A*VC90704CXA*	28,400	21,000	14.0	11.6	4355518
	CA*F3030*6D*+EEP		28,400	21,000	13.0	11.0	4355524
	CA*F3131*6C*	A*VC80703BXA*	28,600	21,200	14.0	11.6	4208057
	CA*F3131*6C*	A*VC950714CXA*	28,600	21,200	14.0	11.6	4202228
	CA*F3131*6C*	A*VC950704CXA*	28,600	21,200	14.0	11.6	3839071
	CA*F3131*6C*	A*VC950453BXA*	28,600	21,200	14.0	11.6	3839070
	CA*F3131*6C*	A*VC90704CXA*	28,600	21,200	14.0	11.6	3839069
	CA*F3131*6C*	A*VC80704BXA*	28,600	21,200	14.0	11.6	3839068
	CA*F3131*6C*	A*V90704CX**	28,600	21,200	14.0	11.6	3839067
	CA*F3131*6C*	A*V90453BX**	28,600	21,200	14.0	11.6	3839066
	CA*F3131*6C*	A*V80704BX**	28,600	21,200	14.0	11.6	3839065
CA*F3131*6C*+EEP		28,600	21,200	13.0	11.0	3839072	
CA*F3131*6C*	MBE1200**-1B*	28,400	21,000	14.0	11.6	3839073	
CA*F3131*6C*	MBVC1200**-1A*	28,400	21,000	14.0	11.6	3839074	
CA*F3131*6D*	A*VC80703BXA*	28,600	21,200	14.0	11.6	4385599	
CA*F3131*6D*	A*VC950714CXA*	28,600	21,200	14.0	11.6	4385598	
CA*F3131*6D*	A*VC90704CXA*	28,600	21,200	14.0	11.6	4385597	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0301C* (cont.)	CA*F3131*6D*	A*VC950453BXA*	28,600	21,200	14.0	11.6	4385596
	CA*F3131*6D*	A*VC950704CXA*	28,400	21,000	14.0	11.6	4385595
	CA*F3131*6D*	A*VC80704BXA*	28,600	21,200	14.0	11.6	4385594
	CA*F3131*6D*+EEP		28,600	21,200	13.0	11.0	4385600
	CA*F3131*6D*	MBVC1200**-1A*	28,400	21,000	14.0	11.6	4385601
	CHPF2430B6C*	A*VC950453BXA*	28,400	21,000	14.0	11.6	3839077
	CHPF2430B6C*	A*V90453BX**	28,400	21,000	14.0	11.6	3839076
	CHPF2430B6C*	A*V80704BX**	28,400	21,000	14.0	11.6	3839075
	CHPF2430B6C*+EEP		28,400	21,000	13.0	11.0	3839078
	CHPF2430B6C*	MBE1200**-1B*	28,400	21,000	14.0	11.6	3839079
	CSCF3036N6B*	A*VC950453BXA*	28,400	21,000	14.0	11.6	3839083
	CSCF3036N6B*	A*VC80704BXA*	28,400	21,000	14.0	11.6	3839082
	CSCF3036N6B*	A*V90453BX**	28,400	21,000	14.0	11.6	3839081
	CSCF3036N6B*	A*V80704BX**	28,400	21,000	14.0	11.6	3839080
	CSCF3036N6B*+EEP		28,400	21,000	13.0	11.0	3839084
	CT*F3030*6A*	A*VC950714CXA*	28,400	21,000	14.0	11.6	4202229
	CT*F3030*6A*	A*VC950704CXA*	28,400	21,000	14.0	11.6	3839091
	CT*F3030*6A*	A*VC950453BXA*	28,400	21,000	14.0	11.6	3839090
	CT*F3030*6A*	A*VC90704CXA*	28,400	21,000	14.0	11.6	3839089
	CT*F3030*6A*	A*VC80704BXA*	28,400	21,000	13.5	11.3	3839088
	CT*F3030*6A*	A*V90704CX**	28,400	21,000	14.0	11.6	3839087
	CT*F3030*6A*	A*V90453BX**	28,400	21,000	14.0	11.6	3839086
	CT*F3030*6A*	A*V80704BX**	28,400	21,000	13.5	11.3	3839085
	CT*F3030*6A*+EEP		28,400	21,000	13.0	11.0	3839092
	CT*F3131*6A*	A*VC950714CXA*	28,600	21,200	14.0	11.6	4202230
	CT*F3131*6A*	A*VC950704CXA*	28,600	21,200	14.0	11.6	3839099
	CT*F3131*6A*	A*VC950453BXA*	28,600	21,200	14.0	11.6	3839098
	CT*F3131*6A*	A*VC90704CXA*	28,600	21,200	14.0	11.6	3839097
	CT*F3131*6A*	A*VC80704BXA*	28,600	21,200	14.0	11.6	3839096
	CT*F3131*6A*	A*V90704CX**	28,600	21,200	14.0	11.6	3839095
CT*F3131*6A*	A*V90453BX**	28,600	21,200	14.0	11.6	3839094	
CT*F3131*6A*	A*V80704BX**	28,600	21,200	14.0	11.6	3839093	
CT*F3131*6A*+EEP		28,600	21,200	13.0	11.0	3839100	
CT*F3131*6A*	MBE1200**-1B*	28,400	21,000	14.0	11.6	3839101	
CT*F3131*6A*	MBVC1200**-1A*	28,400	21,000	14.0	11.6	3839102	
ASX13 0361B*	CA*F3636*6B*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594740
	CA*F3636*6B*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199541
	CA*F3636*6C*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594741
	CA*F3636*6C*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199542
	CA*F3642*6B*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594743
	CA*F3642*6B*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199544
	CA*F3642*6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594744
	CA*F3642*6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199546
	CA*F3642*6D*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594746
	CA*F3642*6D*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199548
	CA*F3743*6A*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594748
	CA*F3743*6A*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199550
	CHPF3642D6B*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4594750
	CHPF3642D6B*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199552
	CHPF3642D6C*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4594751
	CHPF3642D6C*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199554

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0361B* (cont.)	CSCF3642N6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594753
	CSCF3642N6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199556
	CT*F3636*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594755
	CT*F3636*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199558
	CT*F3642*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594757
	CT*F3642*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199560
	CT*F3642*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594758
ASX13 0361C*	CT*F3636*6A*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594756
	CSCF3642N6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594754
	CHPF3642D6C*	G*VC950915DXA*	35,000	25,200	14.0	11.6	4594752
	CA*F3743*6A*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594749
	CA*F3642*6D*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594747
	CA*F3642*6C*	G*VC950915DXA*	35,400	25,500	14.0	11.6	4594745
	CA*F3636*6C*	G*VC950915DXA*	35,000	25,200	13.5	11.3	4594742
	CT*F3636*6A*	A*VC950714CXA*	35,000	25,200	14.0	11.6	4586537
	CSCF3642N6C*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586536
	CHPF3642D6C*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586535
	CA*F3743*6D*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586534
	CA*F3743*6A*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586533
	CA*F3642*6D*	A*VC950714CXA*	35,400	25,500	14.0	11.6	4586532
	CA*F3642*6C*	A*VC950714CXA*	35,000	25,200	13.5	11.3	4586531
	CA*F3636*6D*	A*VC950714CXA*	35,000	25,200	13.5	11.3	4586530
	CA*F3636*6C*	A*VC950714CXA*	35,000	25,200	13.5	11.3	4586529
	AVPTC313714A*		35,000	25,200	14.0	11.6	4431334
	CA*F3743*6D*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4415264
	CA*F3743*6D*	A*VC951155DXA*	35,400	25,500	14.0	11.6	4415263
	CA*F3743*6D*	A*VC950905DXA*	35,400	25,500	14.0	11.6	4415262
	CA*F3743*6D*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4415261
	CA*F3743*6D*	A*VC90905DXA*	35,400	25,500	14.0	11.6	4415260
	CA*F3743*6D*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	4415256
	CA*F3636*6D*+EEP		35,000	25,200	13.0	11.0	4392702
	CA*F3636*6D*	G*VC950714CXA*	35,000	25,200	13.5	11.3	4392701
	CA*F3636*6D*	A*VC951155DXA*	35,000	25,200	13.5	11.3	4392700
	CA*F3636*6D*	A*VC950905DXA*	35,000	25,200	13.5	11.3	4392699
	CA*F3636*6D*	A*VC950905CXA*	35,000	25,200	13.5	11.3	4392698
	CA*F3636*6D*	A*VC90905DXA*	35,000	25,200	13.5	11.3	4392697
	ASPF313716E*		35,000	25,200	14.0	11.6	4355489
	ASPF313716C*		35,000	25,200	14.0	11.6	4355486
	AR*F363616C*		34,400	24,800	13.0	11.0	4260518
	CSCF3642N6C*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202255
	CHPF3642D6C*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202254
	CA*F3743*6A*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202253
	CA*F3642*6D*	G*VC950714CXA*	35,400	25,500	14.0	11.6	4202252
	CA*F3642*6C*	G*VC950714CXA*	35,000	25,200	13.5	11.3	4202251
	CA*F3636*6C*	G*VC950714CXA*	35,000	25,200	13.5	11.3	4202250
	CT*F3636*6A*	G*VC950714CXA*	35,000	25,200	14.0	11.6	4202248
	CT*F3636*6A*	A*VC950905CXA*	35,000	25,200	13.5	11.3	4200244
	CSCF3642N6C*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200241
	CHPF3642D6C*	A*VC950905CXA*	35,000	25,200	14.0	11.6	4200240
CA*F3743*6A*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200238	
CA*F3642*6D*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200236	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0361C* (cont.)	CA*F3642*6C*	A*VC950905CXA*	35,400	25,500	14.0	11.6	4200234
	CA*F3636*6C*	A*VC950905CXA*	35,000	25,200	13.5	11.3	4200232
	CT*F3642*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199575
	CT*F3636*6A*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199573
	CSCF3642N6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199571
	CHPF3642D6C*	A*VC950915DXA*	35,000	25,200	14.0	11.6	4199569
	CA*F3743*6A*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199567
	CA*F3642*6D*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199565
	CA*F3642*6C*	A*VC950915DXA*	35,400	25,500	14.0	11.6	4199563
	CA*F3636*6C*	A*VC950915DXA*	35,000	25,200	13.5	11.3	4199561
	ASPF313716D*		35,000	25,200	14.0	11.6	4149336
	CA*F3642*6D*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3880864
	CA*F3642*6D*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3880862
	CA*F3642*6D*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3880855
	CA*F3642*6D*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3880854
	CA*F3642*6D*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3880853
	CA*F3642*6D*	A*V91155DX**	35,400	25,500	14.0	11.6	3880852
	CA*F3642*6D*	A*V90905DX**	35,400	25,500	14.0	11.6	3880851
	CT*F3636*6A*+EEP		35,000	25,200	13.0	11.0	3839158
	CT*F3636*6A*	A*VC951155DXA*	35,000	25,200	13.5	11.3	3839157
	CT*F3636*6A*	A*VC950905DXA*	35,000	25,200	13.5	11.3	3839156
	CT*F3636*6A*	A*VC90905DXA*	35,000	25,200	13.5	11.3	3839155
	CT*F3636*6A*	A*V91155DX**	35,000	25,200	13.5	11.3	3839154
	CT*F3636*6A*	A*V90905DX**	35,000	25,200	13.5	11.3	3839153
	CSCF3642N6C*+EEP		35,400	25,500	13.0	11.0	3839152
	CSCF3642N6C*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3839151
	CSCF3642N6C*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3839150
	CSCF3642N6C*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3839149
	CSCF3642N6C*	A*V91155DX**	35,400	25,500	14.0	11.6	3839148
	CSCF3642N6C*	A*V90905DX**	35,400	25,500	14.0	11.6	3839147
	CSCF3036N6B*+EEP		35,000	25,200	13.0	11.0	3839146
	CHPF3642D6C*+EEP		35,400	25,500	13.0	11.0	3839145
	CHPF3642D6C*	A*VC951155DXA*	35,000	25,200	14.0	11.6	3839144
	CHPF3642D6C*	A*VC950905DXA*	35,000	25,200	14.0	11.6	3839143
	CHPF3642D6C*	A*VC90905DXA*	35,000	25,200	14.0	11.6	3839142
	CHPF3642D6C*	A*V91155DX**	35,000	25,200	14.0	11.6	3839141
	CHPF3642D6C*	A*V90905DX**	35,000	25,200	14.0	11.6	3839140
	CHPF3642C6C*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3839139
	CHPF3642C6C*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3839138
	CHPF3642C6C*+EEP		35,400	25,500	13.0	11.0	3839137
	CHPF3636B6C*+EEP		35,400	25,500	13.0	11.0	3839136
	CA*F3743*6A*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3839135
	CA*F3743*6A*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3839134
	CA*F3743*6A*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3839133
	CA*F3743*6A*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3839132
	CA*F3743*6A*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3839131
	CA*F3743*6A*	A*V91155DX**	35,400	25,500	14.0	11.6	3839130
	CA*F3743*6A*	A*V90905DX**	35,400	25,500	14.0	11.6	3839129
	CA*F3642*6C*	MBVC1600**-1A*	35,400	25,500	14.0	11.6	3839128
	CA*F3642*6C*	MBE1600**-1B*	35,400	25,500	14.0	11.6	3839127
CA*F3642*6C*	A*VC951155DXA*	35,400	25,500	14.0	11.6	3839126	

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0361C* (cont.)	CA*F3642*6C*	A*VC950905DXA*	35,400	25,500	14.0	11.6	3839125
	CA*F3642*6C*	A*VC90905DXA*	35,400	25,500	14.0	11.6	3839124
	CA*F3642*6C*	A*V91155DX**	35,400	25,500	14.0	11.6	3839123
	CA*F3642*6C*	A*V90905DX**	35,400	25,500	14.0	11.6	3839122
	CA*F3636*6C*+EEP		35,000	25,200	13.0	11.0	3839121
	CA*F3636*6C*	A*VC951155DXA*	35,000	25,200	13.5	11.3	3839120
	CA*F3636*6C*	A*VC950905DXA*	35,000	25,200	13.5	11.3	3839119
	CA*F3636*6C*	A*VC90905DXA*	35,000	25,200	13.5	11.3	3839118
	CA*F3636*6C*	A*V91155DX**	35,000	25,200	13.5	11.3	3839117
	CA*F3636*6C*	A*V90905DX**	35,000	25,200	13.5	11.3	3839116
	AWUF37XX16B*		34,000	24,500	13.0	11.0	3839115
	AWUF36XX16B*		33,400	24,000	13.0	11.0	3839113
	AT*F364216A*		35,000	25,200	13.0	11.0	3839112
	AT*F363616A*		34,400	24,800	13.0	11.0	3839111
	AR*F364216C*		35,000	25,200	13.0	11.0	3839108
	AR*F364216B*		35,000	25,200	13.0	11.0	3839107
	AR*F363616B*		34,400	24,800	13.0	11.0	3839106
	AEPF313716A*		35,000	25,200	14.0	11.6	3839105
ADPF304216C*		35,000	25,200	13.0	11.0	3839104	
ADPF304216B*		35,000	25,200	13.0	11.0	3839103	
ASX13 0421B*	ASPF426016C*		41,000	29,900	14.0	11.6	4358391
	ASPF426016E*		41,000	29,900	14.0	11.6	4358392
	CA*F4860*6B*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594759
	CA*F4860*6B*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199594
	CA*F4860*6D*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594761
	CA*F4860*6D*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199595
	CHPF3642D6B*	G*VC950915DXA*	40,000	29,200	13.5	11.3	4594764
	CHPF3642D6B*	A*VC950915DXA*	40,000	29,200	13.5	11.3	4199597
	CHPF3642D6C*	G*VC950915DXA*	40,000	29,200	13.5	11.3	4594766
	CHPF3642D6C*	A*VC950915DXA*	40,000	29,200	13.5	11.3	4199599
	CHPF4860D6C*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594769
	CHPF4860D6C*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199601
	CHPF4860D6D*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594771
	CHPF4860D6D*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199603
	CT*F4860*6A*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594774
	CT*F4860*6A*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199605
ASX13 0421C*	ADPF304216B*		40,000	29,200	13.0	11.1	3839166
	ADPF304216C*		40,000	29,200	13.0	11.1	3839167
	AEPF426016C*		41,000	29,900	14.0	11.6	3839168
	AR*F364216B*		40,000	29,200	13.0	11.1	3839169
	AR*F364216C*		40,000	29,200	13.0	11.1	3839170
	ASPF426016B*		41,000	29,900	14.0	11.6	3839171
	ASPF426016C*		41,000	29,900	14.0	11.6	4358393
	ASPF426016D*		41,000	29,900	14.0	11.6	4149338
	ASPF426016E*		41,000	29,900	14.0	11.6	4358394
	AT*F364216A*		40,000	29,200	13.0	11.1	3839172
	AVPTC426014A*		41,000	29,900	14.0	11.6	4431335
	CA*F3642*6C*+EEP		40,000	29,200	13.0	11.1	3839173
	CA*F4860*6B*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594760
	CA*F4860*6B*	A*VC950714CXA*	41,000	29,900	14.0	11.6	4202272
	CA*F4860*6B*	A*VC950905CXA*	41,000	29,900	14.0	11.6	4200274

See Notes on Page 39.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0421C* (cont.)	CA*F4860*6B*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199607
	CA*F4860*6B*	A*VC951155DXA*	41,000	29,900	14.0	11.6	3839178
	CA*F4860*6B*	A*VC950905DXA*	41,000	29,900	14.0	11.6	3839177
	CA*F4860*6B*	A*VC90905DXA*	41,000	29,900	14.0	11.6	3839176
	CA*F4860*6B*	A*V91155DX**	41,000	29,900	14.0	11.6	3839175
	CA*F4860*6B*	A*V90905DX**	41,000	29,900	14.0	11.6	3839174
	CA*F4860*6B*	MBE1600**-1B*	41,000	29,900	14.0	11.6	3839179
	CA*F4860*6B*	MBVC1600**-1A*	41,000	29,900	14.0	11.6	3839180
	CA*F4860*6D*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594762
	CA*F4860*6D*	A*VC950714CXA*	41,000	29,900	14.0	11.6	4202273
	CA*F4860*6D*	A*VC950905CXA*	41,000	29,900	14.0	11.6	4200276
	CA*F4860*6D*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199608
	CA*F4860*6D*	A*VC951155DXA*	41,000	29,900	14.0	11.6	3880893
	CA*F4860*6D*	A*VC950905DXA*	41,000	29,900	14.0	11.6	3880892
	CA*F4860*6D*	A*VC90905DXA*	41,000	29,900	14.0	11.6	3880891
	CA*F4860*6D*	A*V91155DX**	41,000	29,900	14.0	11.6	3880890
	CA*F4860*6D*	A*V90905DX**	41,000	29,900	14.0	11.6	3880889
	CA*F4860*6D*	MBE1600**-1B*	41,000	29,900	14.0	11.6	3880899
	CA*F4860*6D*	MBVC1600**-1A*	41,000	29,900	14.0	11.6	3880907
	CHPF3642D6C*	G*VC950915DXA*	40,000	29,200	13.5	11.3	4594767
	CHPF3642D6C*	A*VC950714CXA*	40,000	29,200	13.5	11.3	4202271
	CHPF3642D6C*	A*VC950905CXA*	40,000	29,200	13.5	11.3	4200278
	CHPF3642D6C*	A*VC950915DXA*	40,000	29,200	13.5	11.3	4199610
	CHPF3642D6C*	A*VC950905DXA*	40,000	29,200	13.5	11.3	3839183
	CHPF3642D6C*	A*VC90905DXA*	40,000	29,200	13.5	11.3	3839182
	CHPF3642D6C*	A*V90905DX**	40,000	29,200	13.5	11.3	3839181
	CHPF4860D6D*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594772
	CHPF4860D6D*	A*VC950714CXA*	41,000	29,900	14.0	11.6	4202269
	CHPF4860D6D*	A*VC950905CXA*	41,000	29,900	14.0	11.6	4200279
	CHPF4860D6D*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199612
	CHPF4860D6D*	A*VC951155DXA*	41,000	29,900	14.0	11.6	3839188
	CHPF4860D6D*	A*VC950905DXA*	41,000	29,900	14.0	11.6	3839187
	CHPF4860D6D*	A*VC90905DXA*	41,000	29,900	14.0	11.6	3839186
	CHPF4860D6D*	A*V91155DX**	41,000	29,900	14.0	11.6	3839185
	CHPF4860D6D*	A*V90905DX**	41,000	29,900	14.0	11.6	3839184
	CHPF4860D6D*	MBE1600**-1B*	41,000	29,900	14.0	11.6	3839189
	CHPF4860D6D*	MBVC1600**-1A*	41,000	29,900	14.0	11.6	3839190
	CSCF4860N6C*	A*VC951155DXA*	41,000	29,900	14.0	11.3	3839192
	CSCF4860N6C*	A*V91155DX**	41,000	29,900	14.0	11.3	3839191
	CT*F4860*6A*	G*VC950915DXA*	41,000	29,900	14.0	11.6	4594775
CT*F4860*6A*	A*VC950915DXA*	41,000	29,900	14.0	11.6	4199614	

<sup>1</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>2</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0481B*	ADPF486016C*		46,000	34,500	13.0	11.2	4358395
	AR*F496116C*		46,000	34,500	13.0	11.2	4358396
	ASPF426016C*		46,000	34,500	14.0	11.5	4358397
	ASPF426016E*		46,000	34,500	14.0	11.5	4358398
	CA*F4860*6B*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594776
	CA*F4860*6B*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199634
	CA*F4860*6D*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594778
	CA*F4860*6D*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199635
	CHPF4860D6C*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594780
	CHPF4860D6C*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199637
	CHPF4860D6D*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594781
	CHPF4860D6D*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199639
	CSCF4860N6C*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594783
	CSCF4860N6C*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199641
	CT*F4860*6A*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594785
	CT*F4860*6A*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199643
	ASX13 0481C*	ADPF486016B*		46,000	34,500	13.0	11.2
ADPF486016C*			46,000	34,500	13.0	11.2	4358399
AEPF426016C*			46,000	34,500	14.0	11.5	3839201
AR*F486016B*			46,000	34,500	13.0	11.2	3839202
AR*F486016C*			46,000	34,500	13.0	11.2	3896010
AR*F496116A*			46,000	34,500	13.0	11.2	3839203
AR*F496116C*			46,000	34,500	13.0	11.2	4358400
ASPF426016B*			46,000	34,500	14.0	11.5	3839204
ASPF426016C*			46,000	34,500	14.0	11.5	4358401
ASPF426016D*			46,000	34,500	14.0	11.5	4149340
ASPF426016E*			46,000	34,500	14.0	11.5	4358402
AVPTC426014A*			46,000	34,500	14.0	11.5	4431336
CA*F4860*6B*+EEP			46,000	34,500	13.0	11.2	3839206
CA*F4860*6B*+TXV		G*VC950915DXA*	46,000	34,500	14.0	11.5	4594777
CA*F4860*6B*+TXV		A*VC950714CXA*	46,000	34,500	14.0	11.5	4202285
CA*F4860*6B*+TXV		A*VC950905CXA*	46,000	34,500	14.0	11.5	4200313
CA*F4860*6B*+TXV		A*VC950915DXA*	46,000	34,500	14.0	11.5	4199645
CA*F4860*6B*+TXV		A*VC951155DXA*	46,000	34,500	14.0	11.5	3839211
CA*F4860*6B*+TXV		A*VC950905DXA*	46,000	34,500	14.0	11.5	3839210
CA*F4860*6B*+TXV		A*VC90905DXA*	46,000	34,500	14.0	11.5	3839209
CA*F4860*6B*+TXV		A*V91155DX**	46,000	34,500	14.0	11.5	3839208
CA*F4860*6B*+TXV		A*V90905DX**	46,000	34,500	14.0	11.5	3839207
CA*F4860*6D*+TXV		G*VC950915DXA*	46,000	34,500	14.0	11.5	4594779
CA*F4860*6D*+TXV		A*VC950714CXA*	46,000	34,500	14.0	11.5	4202289
CA*F4860*6D*+TXV		A*VC950905CXA*	46,000	34,500	14.0	11.5	4200315
CA*F4860*6D*+TXV		A*VC950915DXA*	46,000	34,500	14.0	11.5	4199646
CA*F4860*6D*+TXV		A*VC951155DXA*	46,000	34,500	14.0	11.5	3880943
CA*F4860*6D*+TXV		A*VC950905DXA*	46,000	34,500	14.0	11.5	3880942
CA*F4860*6D*+TXV		A*VC90905DXA*	46,000	34,500	14.0	11.5	3880941
CA*F4860*6D*+TXV		A*V91155DX**	46,000	34,500	14.0	11.5	3880940
CA*F4860*6D*+TXV		A*V90905DX**	46,000	34,500	14.0	11.5	3880939
CHPF4860D6D*+EEP			46,000	34,500	13.0	11.2	3839212
CHPF4860D6D*		MBE2000**-1B*	46,000	34,500	14.0	11.5	3839213
CHPF4860D6D*	MBVC2000**-1A*	46,000	34,500	14.0	11.5	3839214	
CHPF4860D6D*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594782	

See Notes on Page 42.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0481C* (cont.)	CHPF4860D6D*+TXV	A*VC950714CXA*	46,000	34,500	14.0	11.5	4202286
	CHPF4860D6D*+TXV	A*VC950905CXA*	46,000	34,500	14.0	11.5	4200317
	CHPF4860D6D*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199648
	CHPF4860D6D*+TXV	A*VC951155DXA*	46,000	34,500	14.0	11.5	3839219
	CHPF4860D6D*+TXV	A*VC950905DXA*	46,000	34,500	14.0	11.5	3839218
	CHPF4860D6D*+TXV	A*VC90905DXA*	46,000	34,500	14.0	11.5	3839217
	CHPF4860D6D*+TXV	A*V91155DX**	46,000	34,500	14.0	11.5	3839216
	CHPF4860D6D*+TXV	A*V90905DX**	46,000	34,500	14.0	11.5	3839215
	CSCF4860N6C*+EEP		46,000	34,500	13.0	11.2	3839220
	CSCF4860N6C*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594784
	CSCF4860N6C*+TXV	A*VC950714CXA*	46,000	34,500	14.0	11.5	4202287
	CSCF4860N6C*+TXV	A*VC950905CXA*	46,000	34,500	14.0	11.5	4200319
	CSCF4860N6C*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199650
	CSCF4860N6C*+TXV	A*VC951155DXA*	46,000	34,500	14.0	11.5	3839225
	CSCF4860N6C*+TXV	A*VC950905DXA*	46,000	34,500	14.0	11.5	3839224
	CSCF4860N6C*+TXV	A*VC90905DXA*	46,000	34,500	14.0	11.5	3839223
	CSCF4860N6C*+TXV	A*V91155DX**	46,000	34,500	14.0	11.5	3839222
	CSCF4860N6C*+TXV	A*V90905DX**	46,000	34,500	14.0	11.5	3839221
	CT*F4860*6A*+TXV	G*VC950915DXA*	46,000	34,500	14.0	11.5	4594786
	CT*F4860*6A*+TXV	A*VC950915DXA*	46,000	34,500	14.0	11.5	4199652
ASX13 0601A*	ADPF486016B*		57,000	39,900	13	11.1	3056308
	AEPF426016C*		57,000	39,900	13.5	11.4	3204584
	AR*F486016B*		57,000	39,900	13	11.1	3056312
	ASPF426016B*		57,000	39,900	13.5	11.4	3056314
	CA*F4860*6B*+EEP		57,000	39,900	13	11.1	3056324
	CA*F4860*6B*	MBE2000**-1	57,000	39,900	13.5	11.4	3056325
	CA*F4860*6B*	MBVC2000**-1A*	57,000	39,900	13.5	11.4	3610206
	CA*F4860*6B*+TXV	G*E80905C**	57,000	39,900	13.5	11.4	3056326
	CA*F4860*6B*+TXV	G*E81155C**	57,000	39,900	13.5	11.4	3056327
	CA*F4860*6B*+TXV	G*V80905C**	57,000	39,900	13.5	11.4	3056328
	CA*F4860*6B*+TXV	G*V81155C**	57,000	39,900	13.5	11.4	3056329
	CA*F4860*6B*+TXV	G*V90905D**	57,000	39,900	13.5	11.4	3056330
	CA*F4860*6B*+TXV	G*V950905D**	57,000	39,900	13.5	11.4	3056331
	CA*F4860*6B*+TXV	G*V951155D**	57,000	39,900	13.5	11.4	3056332
	CA*F4860*6B*+TXV	A*V80905C**	57,000	39,900	13.5	11.4	3072157
	CA*F4860*6B*+TXV	A*V81155C**	57,000	39,900	13.5	11.4	3072172
	CA*F4860*6B*+TXV	A*V90905D**	57,000	39,900	13.5	11.4	3072212
	CA*F4860*6B*+TXV	A*V91155D**	57,000	39,900	13.5	11.4	3072229
	CA*F4860*6B*+TXV	A*VC90905DXA*	57,000	39,900	13.5	11.4	3596357
	CA*F4860*6B*+TXV	A*VC950905DXA*	57,000	39,900	13.5	11.4	3596747
	CA*F4860*6B*+TXV	A*VC951155DXA*	57,000	39,900	13.5	11.4	3596870
	CA*F4860*6B*+TXV	G*VC90905DXA*	57,000	39,900	13.5	11.4	3596916
	CA*F4860*6B*+TXV	G*VC950905DXA*	57,000	39,900	13.5	11.4	3597008
	CA*F4860*6B*+TXV	G*VC951155DXA*	57,000	39,900	13.5	11.4	3597040
	CHPF4860D6C*+EEP		57,000	39,900	13	11.1	3056333
	CHPF4860D6C*	MBE2000**-1	57,000	39,900	13.5	11.4	3059452
	CHPF4860D6C*+TXV	G*E80905C**	57,000	39,900	13.5	11.4	3056334
	CHPF4860D6C*+TXV	G*E81155C**	57,000	39,900	13.5	11.4	3056335
	CHPF4860D6C*+TXV	G*V80905C**	57,000	39,900	13.5	11.4	3056336
	CHPF4860D6C*+TXV	G*V81155C**	57,000	39,900	13.5	11.4	3056337
	CHPF4860D6C*+TXV	G*V90905D**	57,000	39,900	13.5	11.4	3056339

See Notes on Page 42.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0601A* (cont.)	CHPF4860D6C*+TXV	G*V951155D**	57,000	39,900	13.5	11.4	3056340
	CHPF4860D6C*+TXV	A*V80905C**	57,000	39,900	13.5	11.4	3072158
	CHPF4860D6C*+TXV	A*V81155C**	57,000	39,900	13.5	11.4	3072173
	CHPF4860D6C*+TXV	A*V91155D**	57,000	39,900	13.5	11.4	3072230
	CHPF4860D6C*+TXV	A*VC951155DXA*	57,000	39,900	13.5	11.4	3596871
	CHPF4860D6C*+TXV	G*VC90905DXA*	57,000	39,900	13.5	11.4	3596917
	CHPF4860D6C*+TXV	G*VC951155DXA*	57,000	39,900	13.5	11.4	3597041
	CHPF4860D6D*+EEP		57,000	39,900	13	11.1	3299814
	CHPF4860D6D*	MBE2000**-1B*	57,000	39,900	13.5	11.4	3299815
	CHPF4860D6D*	MBVC2000**-1A*	57,000	39,900	13.5	11.4	3610257
	CHPF4860D6D*+TXV	A*V80905C**	57,000	39,900	13.5	11.4	3299816
	CHPF4860D6D*+TXV	A*V81155C**	57,000	39,900	13.5	11.4	3299817
	CHPF4860D6D*+TXV	A*V91155D**	57,000	39,900	13.5	11.4	3299818
	CHPF4860D6D*+TXV	G*E80905C**	57,000	39,900	13.5	11.4	3299819
	CHPF4860D6D*+TXV	G*E81155C**	57,000	39,900	13.5	11.4	3299820
	CHPF4860D6D*+TXV	G*V80905C**	57,000	39,900	13.5	11.4	3299821
	CHPF4860D6D*+TXV	G*V81155C**	57,000	39,900	13.5	11.4	3299822
	CHPF4860D6D*+TXV	G*V90905D**	57,000	39,900	13.5	11.4	3299823
	CHPF4860D6D*+TXV	G*V91155D**	57,000	39,900	13.5	11.4	3299824
	CHPF4860D6D*+TXV	G*V951155D**	57,000	39,900	13.5	11.4	3299825
	CHPF4860D6D*+TXV	A*VC951155DXA*	57,000	39,900	13.5	11.4	3596873
	CHPF4860D6D*+TXV	G*VC90905DXA*	57,000	39,900	13.5	11.4	3596919
	CHPF4860D6D*+TXV	G*VC91155DXA*	57,000	39,900	13.5	11.4	3596926
	CHPF4860D6D*+TXV	G*VC951155DXA*	57,000	39,900	13.5	11.4	3597043
	CSCF4860N6C*+EEP		57,000	39,900	13	11.4	3056341
	CSCF4860N6C*+TXV	G*E80905C**	57,000	39,900	13.5	11.4	3056342
	CSCF4860N6C*+TXV	G*E81155C**	57,000	39,900	13.5	11.4	3056343
	CSCF4860N6C*+TXV	G*V80905C**	57,000	39,900	13.5	11.4	3056344
	CSCF4860N6C*+TXV	G*V81155C**	57,000	39,900	13.5	11.4	3056345
	CSCF4860N6C*+TXV	G*V90905D**	57,000	39,900	13.5	11.4	3056347
	CSCF4860N6C*+TXV	G*V951155D**	57,000	39,900	13.5	11.4	3056348
	CSCF4860N6C*+TXV	A*V80905C**	57,000	39,900	13.5	11.4	3072159
CSCF4860N6C*+TXV	A*V81155C**	57,000	39,900	13.5	11.4	3072174	
CSCF4860N6C*+TXV	A*V91155D**	57,000	39,900	13.5	11.4	3072231	
CSCF4860N6C*+TXV	A*VC951155DXA*	57,000	39,900	13.5	11.4	3596872	
CSCF4860N6C*+TXV	G*VC90905DXA*	57,000	39,900	13.5	11.4	3596918	
CSCF4860N6C*+TXV	G*VC951155DXA*	57,000	39,900	13.5	11.4	3597042	
ASX13 0601B*	ADPF486016C*		57,000	39,900	13.0	11.1	4358403
	AR*F496116C*		57,000	39,900	13.0	11.1	4358404
	ASPF426016C*		57,500	40,300	13.4	11.4	4358405
	ASPF426016E*		57,500	40,300	13.4	11.4	4358406
	CA*F4961*6A*+TXV	A*VC950915DXA*	56,500	39,600	13.0	11.0	4199657
	CA*F4961*6A*+TXV	G*VC950915DXA*	56,500	39,600	13.0	11.0	4199655
	CHPF4860D6D*+TXV	A*VC950915DXA*	56,500	39,600	13.0	11.0	4199661
	CHPF4860D6D*+TXV	G*VC950915DXA*	56,500	39,600	13.0	11.0	4199659

<sup>1</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>2</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #	
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>		
ASX13 0601C*	ADPF486016B*		57,000	39,900	13.0	11.1	3839234	
	ADPF486016C*		57,000	39,900	13.0	11.1	4358407	
	AEPF426016C*		57,500	40,300	13.4	11.3	3839235	
	AR*F486016B*		56,000	39,200	13.0	11.1	3839236	
	AR*F486016C*		56,000	39,200	13.0	11.1	3896011	
	AR*F496116A*		57,000	39,900	13.0	11.1	3839237	
	AR*F496116C*		57,000	39,900	13.0	11.1	4358408	
	ASPF426016B*		57,500	40,300	13.4	11.4	3839238	
	ASPF426016C*		57,500	40,300	13.4	11.4	4358409	
	ASPF426016D*		57,500	40,300	13.4	11.4	4149342	
	ASPF426016E*		57,500	40,300	13.4	11.4	4358410	
	AVPTC426014A*		57,500	40,300	13.4	11.3	4431337	
	CA*F4860*6B*+EEP			55,500	38,900	13.0	11.0	3839239
	CA*F4860*6B*	MBE2000**-1B*		56,500	39,600	13.5	11.5	3839240
	CA*F4860*6B*+TXV	MBE2000**-1B*		56,000	39,200	13.7	11.5	3839241
	CA*F4860*6B*	MBVC2000**-1A*		56,500	39,600	13.5	11.5	3839242
	CA*F4860*6B*+TXV	MBVC2000**-1A*		56,000	39,200	13.7	11.5	3839243
	CA*F4860*6B*+TXV	G*VC951155DXA*		55,000	38,500	13.1	11.0	3839251
	CA*F4860*6B*+TXV	G*VC81155CXA*		56,000	39,200	13.5	11.4	3839250
	CA*F4860*6B*+TXV	G*VC80905CXA*		56,000	39,200	13.5	11.4	3839249
	CA*F4860*6B*+TXV	G*E81155C**		55,500	38,900	13.4	11.3	3839248
	CA*F4860*6B*+TXV	G*E80905C**		55,500	38,900	13.4	11.3	3839247
	CA*F4860*6B*+TXV	A*VC951155DXA*		55,000	38,500	13.1	11.0	3839246
	CA*F4860*6B*+TXV	A*VC81155CXA*		56,000	39,200	13.5	11.4	3839245
	CA*F4860*6B*+TXV	A*VC80905CXA*		56,000	39,200	13.5	11.4	3839244
	CA*F4860*6D*+EEP			55,500	38,900	13.0	11.0	3880896
	CA*F4860*6D*	MBE2000**-1B*		56,500	39,600	13.5	11.5	3880903
	CA*F4860*6D*+TXV	MBE2000**-1B*		56,000	39,200	13.7	11.5	3880905
	CA*F4860*6D*	MBVC2000**-1A*		56,500	39,600	13.5	11.5	3880910
	CA*F4860*6D*+TXV	MBVC2000**-1A*		56,000	39,200	13.7	11.5	3880912
	CA*F4860*6D*+TXV	G*VC951155DXA*		55,000	38,500	13.1	11.0	3880977
	CA*F4860*6D*+TXV	G*VC81155CXA*		56,000	39,200	13.5	11.4	3880976
	CA*F4860*6D*+TXV	G*VC80905CXA*		56,000	39,200	13.5	11.4	3880975
	CA*F4860*6D*+TXV	G*E81155C**		55,500	38,900	13.4	11.3	3880974
	CA*F4860*6D*+TXV	G*E80905C**		55,500	38,900	13.4	11.3	3880973
	CA*F4860*6D*+TXV	A*VC951155DXA*		55,000	38,500	13.1	11.0	3880972
	CA*F4860*6D*+TXV	A*VC81155CXA*		56,000	39,200	13.5	11.4	3880971
	CA*F4860*6D*+TXV	A*VC80905CXA*		56,000	39,200	13.5	11.4	3880970
	CA*F4961*6A*+EEP			57,000	39,900	13.0	11.1	3839252
	CA*F4961*6A*	MBE2000**-1B*		57,500	40,300	13.7	11.6	3839253
	CA*F4961*6A*+TXV	MBE2000**-1B*		57,500	40,300	13.8	11.6	3839254
	CA*F4961*6A*	MBVC2000**-1A*		57,500	40,300	13.7	11.6	3839255
	CA*F4961*6A*+TXV	MBVC2000**-1A*		57,500	40,300	13.8	11.6	3839256
	CA*F4961*6A*+TXV	A*VC950714CXA*		56,500	39,600	13.0	11.0	4202301
	CA*F4961*6A*+TXV	G*VC950905CXA*		56,500	39,600	13.0	11.0	4200336
	CA*F4961*6A*+TXV	A*VC950905CXA*		56,500	39,600	13.0	11.0	4200333
	CA*F4961*6A*+TXV	G*VC950915DXA*		56,500	39,600	13.0	11.0	4199665
	CA*F4961*6A*+TXV	A*VC950915DXA*		56,500	39,600	13.0	11.0	4199663
	CA*F4961*6A*+TXV	G*VC951155DXA*		56,000	39,200	13.4	11.2	3839266
	CA*F4961*6A*+TXV	G*VC950905DXA*		56,500	39,600	13.0	11.0	3839265
CA*F4961*6A*+TXV	G*VC81155CXA*		57,000	39,900	13.5	11.3	3839264	
CA*F4961*6A*+TXV	G*VC80905CXA*		57,000	39,900	13.6	11.4	3839263	

See Notes on Page 42.

# AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING CAPACITY (BTU/H)				AHRI #
	COIL / BLOWER UNITS	FURNACE	TOTAL	SENSIBLE	SEER <sup>1</sup>	EER <sup>2</sup>	
ASX13 0601C* (cont.)	CA*F4961*6A*+TXV	G*E81155C**	57,000	39,900	13.5	11.5	3839262
	CA*F4961*6A*+TXV	G*E80905C**	57,000	39,900	13.6	11.5	3839261
	CA*F4961*6A*+TXV	A*VC951155DXA*	56,000	39,200	13.4	11.2	3839260
	CA*F4961*6A*+TXV	A*VC950905DXA*	56,500	39,600	13.0	11.0	3839259
	CA*F4961*6A*+TXV	A*VC81155CXA*	57,000	39,900	13.5	11.3	3839258
	CA*F4961*6A*+TXV	A*VC80905CXA*	57,000	39,900	13.6	11.4	3839257
	CA*F4961*6D*+EEP		57,000	39,900	13.0	11.1	4431384
	CA*F4961*6D*	MBVC2000**-1A*	57,500	40,300	13.7	11.6	4431385
	CA*F4961*6D*+TXV	MBVC2000**-1A*	57,500	40,300	13.8	11.6	4431386
	CA*F4961*6D*+TXV	G*VC951155DXA*	56,000	39,200	13.4	11.2	4431399
	CA*F4961*6D*+TXV	G*VC950905DXA*	56,500	39,600	13.0	11.0	4431398
	CA*F4961*6D*+TXV	G*VC950905CXA*	56,500	39,600	13.0	11.0	4431397
	CA*F4961*6D*+TXV	G*VC81155CXA*	57,000	39,900	13.5	11.3	4431396
	CA*F4961*6D*+TXV	G*VC80905CXA*	57,000	39,900	13.6	11.4	4431395
	CA*F4961*6D*+TXV	G*E81155C**	57,000	39,900	13.5	11.5	4431394
	CA*F4961*6D*+TXV	G*E80905C**	57,000	39,900	13.6	11.5	4431393
	CA*F4961*6D*+TXV	A*VC951155DXA*	56,000	39,200	13.4	11.2	4431392
	CA*F4961*6D*+TXV	A*VC950905DXA*	56,500	39,600	13.0	11.0	4431391
	CA*F4961*6D*+TXV	A*VC950905CXA*	56,500	39,600	13.0	11.0	4431390
	CA*F4961*6D*+TXV	A*VC950714CXA*	56,500	39,600	13.0	11.0	4431389
	CA*F4961*6D*+TXV	A*VC81155CXA*	57,000	39,900	13.5	11.3	4431388
	CA*F4961*6D*+TXV	A*VC80905CXA*	57,000	39,900	13.6	11.4	4431387
	CHPF4860D6D*+EEP		57,000	39,900	13.0	11.1	3839267
	CHPF4860D6D*	MBE2000**-1B*	57,000	39,900	13.7	11.5	3839268
	CHPF4860D6D*+TXV	MBE2000**-1B*	57,000	39,900	13.8	11.7	3839269
	CHPF4860D6D*	MBVC2000**-1A*	57,000	39,900	13.7	11.5	3839270
	CHPF4860D6D*+TXV	MBVC2000**-1A*	57,000	39,900	13.8	11.7	3839271
	CHPF4860D6D*+TXV	A*VC950714CXA*	57,000	39,900	13.2	11.0	4202302
	CHPF4860D6D*+TXV	G*VC950905CXA*	56,500	39,600	13.0	11.0	4200339
	CHPF4860D6D*+TXV	A*VC950905CXA*	56,500	39,600	13.0	11.0	4200337
	CHPF4860D6D*+TXV	G*VC950915DXA*	56,500	39,600	13.0	11.0	4199669
	CHPF4860D6D*+TXV	A*VC950915DXA*	56,500	39,600	13.0	11.0	4199667
	CHPF4860D6D*+TXV	G*VC951155DXA*	56,500	39,600	13.4	11.3	3839281
	CHPF4860D6D*+TXV	G*VC950905DXA*	57,000	39,900	13.2	11.0	3839280
	CHPF4860D6D*+TXV	G*VC81155CXA*	57,000	39,900	13.5	11.4	3839279
	CHPF4860D6D*+TXV	G*VC80905CXA*	57,000	39,900	13.5	11.5	3839278
	CHPF4860D6D*+TXV	G*E81155C**	57,000	39,900	13.7	11.5	3839277
	CHPF4860D6D*+TXV	G*E80905C**	57,000	39,900	13.7	11.5	3839276
	CHPF4860D6D*+TXV	A*VC951155DXA*	56,500	39,600	13.4	11.3	3839275
	CHPF4860D6D*+TXV	A*VC950905DXA*	57,000	39,900	13.2	11.0	3839274
	CHPF4860D6D*+TXV	A*VC81155CXA*	57,000	39,900	13.5	11.4	3839273
	CHPF4860D6D*+TXV	A*VC80905CXA*	57,000	39,900	13.5	11.5	3839272
	CSCF4860N6C*	MBE2000**-1B*	57,000	39,900	14.0	12.0	3839282
	CSCF4860N6C*+TXV	MBE2000**-1B*	57,000	39,900	14.0	12.0	3839283
	CSCF4860N6C*	MBVC2000**-1A*	57,000	39,900	14.0	12.0	3839284
	CSCF4860N6C*+TXV	MBVC2000**-1A*	57,000	39,900	14.0	12.0	3839285


<sup>1</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>2</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Goodman Gas Furnace contains the EEP cooling time delay


# DIMENSIONS

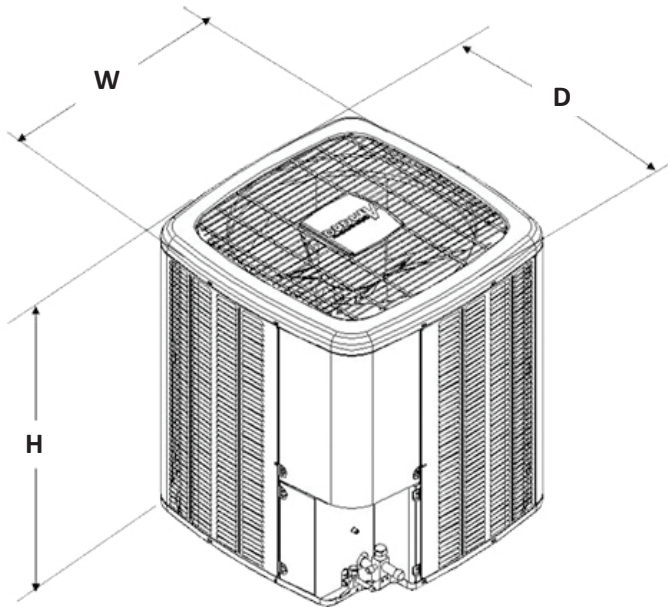

MODEL	DIMENSIONS		
	W	D	H
ASX130181B/C	26"	26"	27½"
ASX130241B/C	26"	26"	27½"
ASX130301B/C	26"	26"	27½"
ASX130361B/C	29"	29"	28¾"
ASX130421B/C	29"	29"	36¼"
ASX130481B/C	29"	29"	36¼"
ASX130601A*	35½"	35½"	38¼"
ASX130601B/C	29	29	40



# WIRING DIAGRAM — ASX13(018-060)1C

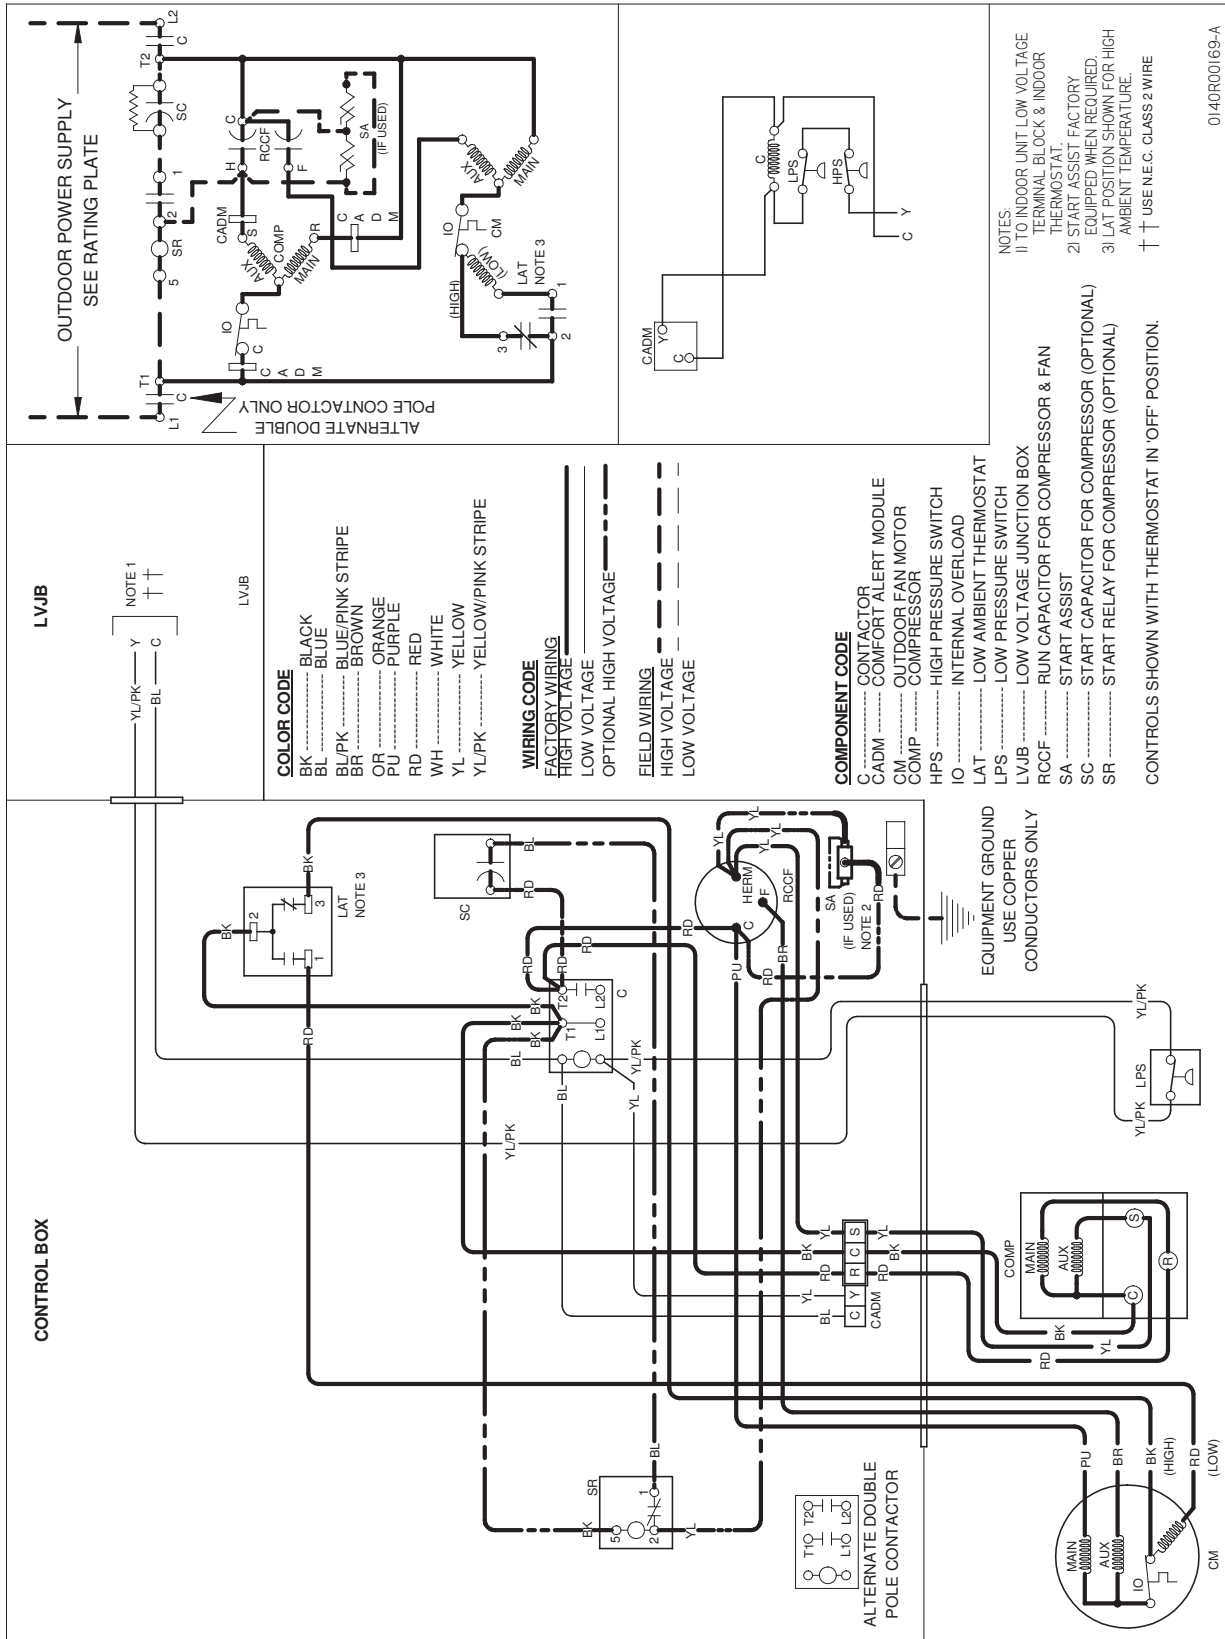

**WARNING**

High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

## ACCESSORIES

MODEL	DESCRIPTION	ASX13 018*	ASX13 024*	ASX13 030*	ASX13 036*	ASX13 042*	ASX13 048*	ASX13 060*
ABK-20	Anchor Bracket Kit <sup>0</sup>	X	X	X	X	X	X	X
ASC-01	Anti-Short Cycle Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X			
CSR-U-2	Hard-start Kit				X	X	X	X
CSR-U-3	Hard-start Kit						X	X
FSK01A <sup>1</sup>	Freeze Protection Kit	X	X	X	X	X	X	X
LSK01A	Liquid Line Solenoid Kit	X	X	X	X	X	X	X
OT18-60A	Outdoor Thermostat	X	X	X	X	X	X	X
TX2N4 <sup>2</sup>	TXV Kit	X						
TX2N4A <sup>2</sup>	TXV Kit	X	X					
TX3N4 <sup>2</sup>	TXV Kit			X	X			
TX5N4 <sup>2</sup>	TXV Kit					X	X	X

<sup>0</sup> Contains 20 brackets; four brackets needed to anchor unit to pad

<sup>1</sup> Installed on indoor coil

<sup>2</sup> Field-installed, non-bleed, expansion valve kit — Condensing units and heat pumps with reciprocating compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.

