



Air Conditioning & Heating

GME95

MULTI-POSITION, MULTI-SPEED GAS FURNACES

UP TO 95% AFUE

HEATING INPUT: 40,000–100,000 BTU/H

Standard Features

- Dual-diameter tubular heat exchanger
- Two-stage gas valve with Dual\$aver™ technology that allows installer to activate the two-stage valve with the flip of a dipswitch
- 110V Silicon Nitride igniter
- Energy-efficient circulator motor (EEM)
- Furnace control board with self-diagnostics, color-coded low-voltage terminals, and provisions for electronic air cleaner and 24-volt humidifiers
- Control board stores the last five diagnostic codes in memory; simple push-button activation outputs the fault history to a flashing red LED
- Low constant fan speed allows homeowner to activate the low-heat speed to efficiently circulate air throughout the home
- Self-adjusting feature automatically adjusts to high or low stage based on outside temperature without an outdoor temperature sensor
- Dual-certified for sealed combustion direct vent (2-pipe) or non-direct vent (1-pipe) applications
- All models comply with California NOx emissions standards

Cabinet Features

- Fully insulated, heavy-gauge steel cabinet with durable baked-enamel finish
- Foil-faced insulation lines the heat exchanger
- Easy-to-install top venting is standard; alternate flue/vent located on the right
- Designed for multi-position installation
- Airtight solid bottom for side-return applications and easy-cut tabs for effortless removal in bottom air inlet applications
- Convenient left/right connection for gas/electric service
- Coil and furnace fit flush for most installations



Applies to 95% furnaces only.

Contents

Nomenclature.....	2
Product Specifications	3
Dimensions	4
Airflow Data	5
Wiring Diagram	6
Dual\$aver Diagram	7
Accessories	8



* Complete warranty details available from your local dealer or at www.goodmanmfg.com. To receive the Lifetime Heat Exchanger Limited Warranty (good for as long as you own your home), 10-Year Unit Replacement Limited Warranty and 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.



NOMENCLATURE

	G	M	E	95	040	4	B	*	**	
	1	2	3	4,5	6,7,8	9	10	11	12,13	
Brand	G Goodman® Brand or Distinctions™									Revisions
										Major and Minor Revisions
Airflow Direction	C Downflow/Horizontal D Dedicated Downflow H High Airflow K Dedicated Upflow M Upflow/Horizontal									NOx
										N Natural Gas X Low NOx
Description/Motor	V Two-Stage/Variable-speed H Two-Stage/Multi-speed S Single-Stage/Multi-speed E Two-Stage/EEM Motor									Cabinet Width
										A 14" B 17½" C 21" D 24½"
AFUE	95 95% 9 93%+ 8 80%									Maximum CFM @ 0.5" ESP
										3 1200 4 1600 5 2000
										MBTU/h
										040: 40,000 100: 100,000 060: 60,000 120: 120,000 080: 80,000



Important EnergyStar Notice: EnergyStar ratings are dependent upon conditions beyond equipment installation. Proper sizing and installation of equipment is critical to achieve optimal performance. Split system air conditioners and heat pumps must be matched with appropriate coil components to meet EnergyStar criteria. Ask your contractor for details or visit www.energystar.gov.

SPECIFICATIONS

	GME95 0403BX*	GME95 0603BX*	GME95 0805CX*	GME95 1005DX*
HEATING CAPACITY				
Input ¹	40,000	60,000	80,000	100,000
Natural Gas Output ¹	38,000	57,000	76,000	95,000
LP Gas Output ¹	38,000	57,000	76,000	95,000
AFUE ²	95	95	95	95
Available AC @ 0.5" ESP	3	3	5	5
Temperature Rise Range (°F)	15-45	30-60	30-60	35-65
CIRCULATOR BLOWER				
Size (D x W)	10" x 8"	10" x 8"	10" x 10"	11" x 10"
Horsepower	½	½	1	1
Speed	5	5	5	5
Vent Diameter ³	2"	2"	3"	3"
No. of Burners	2	3	4	5
Disposable Filter Size (in ²)	580	580	960	960
ELECTRICAL DATA				
Min. Circuit Ampacity ⁵	7.9	9.2	10.0	11.1
Max. Overcurrent Device (amps) ⁶	15	15	15	15
SHIP WEIGHT (LBS)	116	121	130	155

¹ Natural Gas BTU/h. For altitudes above 2,000', reduce input rating 4% for each 1,000' above sea level.

Low-fire rate is 75% of high-fire rate

² DOE AFUE based upon Isolated Combustion System (ICS)

³ Vent and combustion air diameters may vary depending upon vent length. Refer to the latest editions of the National Fuel Gas Code NFPA 54/ANSI Z223.1 (in the USA) and the Canada National Standard of Canada, CAN/CSA B149.1 and CAN/CSA B142.2 (in Canada).

⁴ Permanent air filter size is based on 600 FPM velocity. Check with filter manufacturer for specific details.


⁵ Minimum Circuit Ampacity = (1.25 x Circulator Blower Amps) + ID Blower amps. Wire size should be determined in accordance with National Electrical Codes. Extensive wire runs will require larger wire sizes.

⁶ Maximum Overcurrent Protection Device refers to maximum recommended fuse or circuit breaker size. May use fuses or HACR-type circuit breakers of the same size as noted.

NOTES

- All furnaces are manufactured for use on 115 VAC, 60 Hz, single-phase electrical supply.
- Gas Service Connection ½" FPT
- Important: Size fuses and wires properly and make electrical connections in accordance with the National Electrical Code and/or all existing local codes.

DIMENSIONS

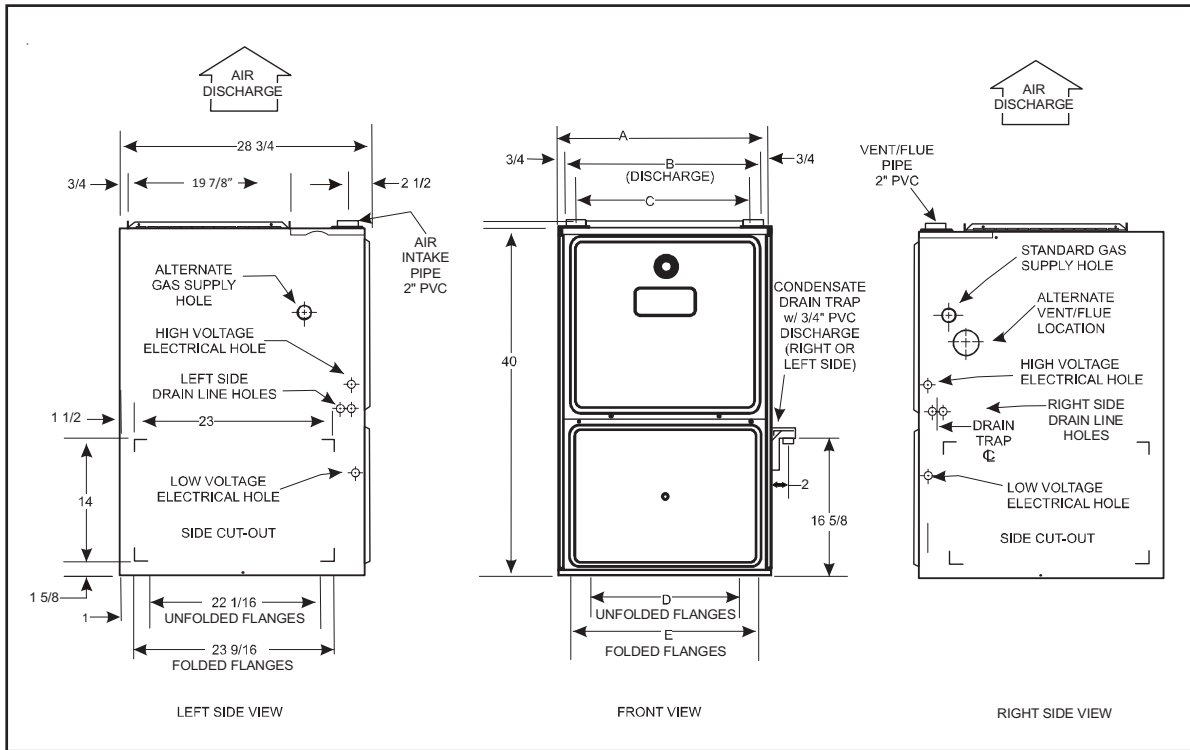

MODEL	A	B	C	D	E
GME950403BX*	17½"	16"	13⅞"	12⅞"	13⅞"
GME950603BX*	17½"	16"	13⅞"	12⅞"	13⅞"
GME950805CX*	21"	19½"	16⅞"	16"	17½"
GME951005DX*	24½"	23"	20⅝"	19⅜"	20⅝"

NOTES:

- Installer must supply one or two PVC pipes: one for combustion air (optional) and one for the flue outlet (required). Vent pipe must be either 2" or 3" in diameter, depending upon furnace input, number of elbows, length of run, and installation (1 or 2 pipes). The optional combustion air pipe is dependent on installation/code requirements and must be 2" or 3" diameter PVC.
- Line voltage wiring can enter through the right or left side of furnace. Low-voltage wiring can enter through the right or left side of furnace.
- Conversion kits for high-altitude natural gas operation are available. Contact your Goodman distributor or dealer for details.
- Installer must supply the following gas line fittings, according to which entrance is used:
 Left: One 90° street elbow; one 2½" pipe nipple; one 90° elbow; straight pipe; one ground joint union
 Right: Straight pipe to reach gas valve
- Installations using a bottom return: Failure to unfold duct flanges will reduce airflow area by approximately 18%. This could result in performance and noise issues.

MINIMUM CLEARANCES TO COMBUSTIBLE MATERIALS

POSITION	SIDES	REAR	FRONT	BOTTOM	FLUE	TOP
Upflow	0"	0"	1"	C	0"	1"
Horizontal	6"	0"	1"	C	0"	4"

- C = If placed on combustible floor, the floor MUST be wood ONLY.
- For servicing or cleaning, a 24" front clearance is recommended.
- Unit connections (electrical, flue, and drain) may necessitate greater clearances than the minimum clearances listed above.
- In all cases, accessibility clearance must take precedence over clearances from the enclosure where accessibility clearances are greater.
- Approved for line contact in the horizontal position

AIRFLOW DATA

(CFM & TEMPERATURE RISE VS. EXTERNAL STATIC PRESSURE)


MODEL	MOTOR SPEED	TONS AC ¹	EXTERNAL STATIC PRESSURE, (INCHES WATER COLUMN)												
			0.1		0.2		0.3		0.4		0.5		0.6	0.7	0.8
			CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	RISE	CFM	CFM	CFM
GME95 0403BX* (MED-HI \ T4)	T1	1.5	726	48	670	53	617	57	553	64	490	72	429	378	336
	T2	2.0	905	39	860	41	812	43	761	46	712	49	663	610	574
	T3	2.5	1,121	31	1,074	33	1,039	34	998	35	959	37	923	882	839
	T4	3.0	1,274	28	1,239	28	1,199	29	1,166	30	1,129	31	1,096	1,059	1,021
	T5	3.0	1,306	27	1,261	28	1,232	29	1,195	29	1,162	30	1,132	1,090	1,057
GME95 0603BX* (MED-HI \ T4)	T1	1.5	714	80	667	79	604	87	548	96	484	109	422	367	325
	T2	2.0	904	58	851	62	804	66	761	69	708	75	664	612	572
	T3	2.5	1,125	47	1,075	49	1,045	51	999	53	956	55	921	877	839
	T4	3.0	1,312	40	1,271	42	1,228	43	1,202	44	1,165	45	1,127	1,087	1,044
	T5	3.5	1,423	37	1,386	38	1,354	39	1,321	40	1,278	41	1,210	1,134	1,032
GME95 0805CX* (MED-HI \ T4)	T1	3.0	1,297	54	1,253	56	1,209	58	1,161	61	1,111	63	1,067	1,022	974
	T2	3.5	1,507	47	1,455	48	1,422	49	1,377	51	1,334	53	1,296	1,251	1,195
	T3	4.0	1,677	42	1,637	43	1,602	44	1,562	45	1,526	46	1,484	1,441	1,324
	T4	4.0	1,879	37	1,842	38	1,800	39	1,762	40	1,700	41	1,566	1,437	1,319
	T5	5.0	2,044	35	1,967	36	1,894	37	1,795	39	1,702	41	1,578	1,452	1,320
GME95 1005DX* (MED-HI \ T4)	T1	3.0	1,331	66	1,275	69	1,206	73	1,145	77	1,080	81	1,021	953	889
	T2	3.5	1,512	58	1,452	60	1,392	63	1,336	66	1,279	69	1,219	1,175	1,115
	T3	4.0	1,713	51	1,666	53	1,614	57	1,569	56	1,513	58	1,468	1,414	1,364
	T4	4.0	1,892	46	1,845	48	1,802	49	1,752	50	1,707	52	1,656	1,614	1,577
	T5	5.0	2,080	42	2,038	43	2,005	44	1,960	45	1,920	46	1,879	1,843	1,791

¹ @0.5" ESP

NOTES

- CFM in chart is without filter(s). Filters do not ship with this furnace, but must be provided by the installer.
- All furnaces ship as high-speed cooling and medium-speed heating. Installer must adjust blower cooling & heating speed as needed.
- For most applications, about 400 CFM per ton when cooling is desirable.
- INSTALLATION IS TO BE ADJUSTED TO OBTAIN TEMPERATURE RISE WITHIN THE RANGE SPECIFIED ON THE RATING PLATE.
- The chart is for information only. For satisfactory operation, external static pressure should not exceed value shown on the rating plate.
- The above chart is for furnaces installed at 0-2000 feet. At higher altitudes, a properly de-rated unit will have approximately the same temperature rise at a particular CFM, while ESP at the CFM will be lower.

WIRING DIAGRAM

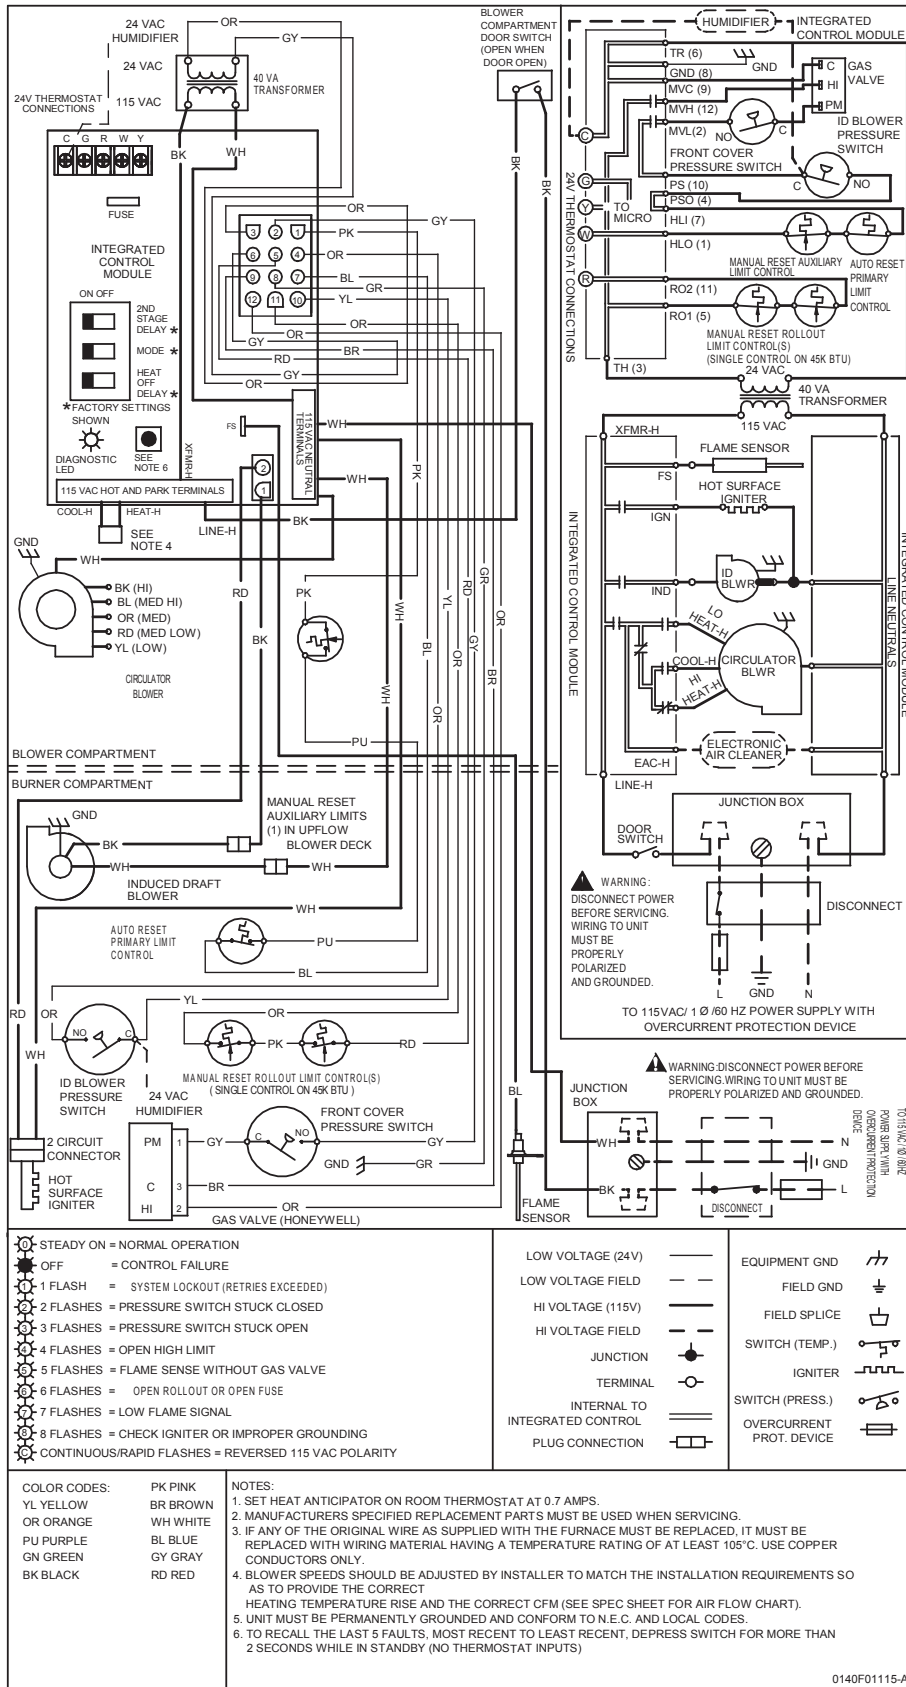


High Voltage: Disconnect all power before servicing or installing this unit. Multiple power sources may be present. Failure to do so may cause property damage, personal injury, or death.

WARNING

Wiring is subject to change. Always refer to the wiring diagram or the unit for the most up-to-date wiring.

DUAL\$AVER CONFIGURATION & OPERATION

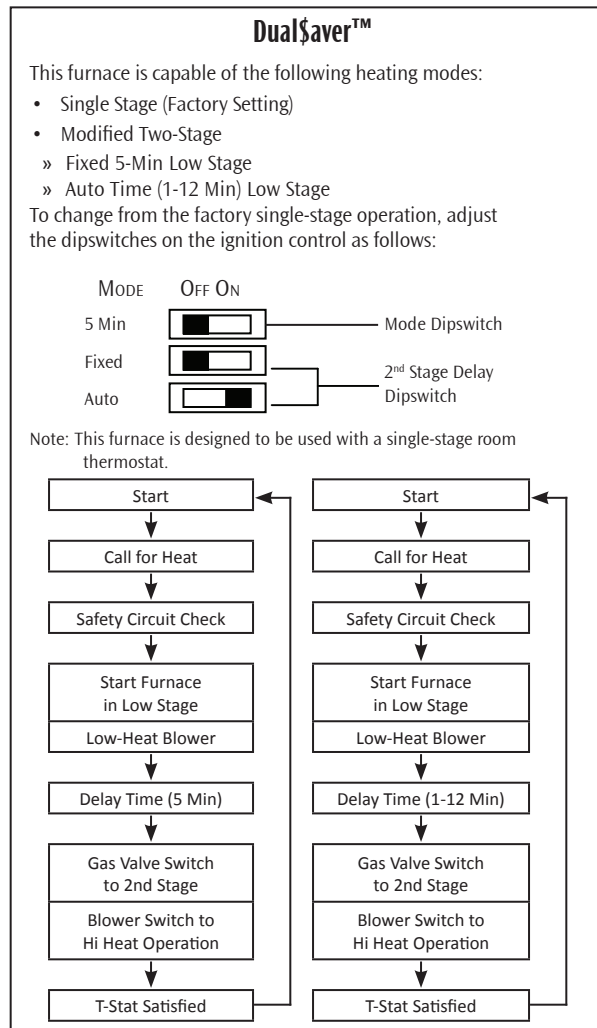

THERMOSTATS

MODEL	DESCRIPTION
CHT18-60	Cooling/Heating, Mechanical
CH70TG	Cooling/Heating, Digital, Non-programmable
CHSATG	Cooling/Heating, Mechanical
H20TWR	Heating Only, Mechanical

ACCESSORIES

ACCESSORY	DESCRIPTION	GME95 0403BX*	GME95 0603BX*	GME95 0805CX*	GME95 1005DX*
LPM-06	LP Conversion Kit (Springs & Orifice) ¹	√	√	√	√
LPLP02	LP Gas Low-Pressure Kit	√	√	√	√
GSAS	Electronic Air Cleaners (-10, -11, -12, -18)	√	√	√	√
GMU	Media Air Cleaners (1620, 2020, 1625, 2025)	√	√	√	√
FTK04	Twinning Kit	√	√	√	√
EFR01	External Filter Rack	√	√	√	√
DCVK-20	Horizontal/Vertical Concentric Vent Kit (2")	√	√	---	---
DCVK-30	Horizontal/Vertical Concentric Vent Kit (3")	√	√	√	√
0170K00000S	Flush-mount Vent Kit	√	√	√	√

¹ White-Rodgers and Honeywell valves

√ Indicates accessories available for this model

NOTE: All installations above 7,000' require a pressure switch change. For installation in Canada, furnaces are certified only to 4,500'.

